

Balancing Service Providers Contract for the Frequency Containment Reserve (FCR) Service

“BSP Contract FCR”

BSP Contract FCR

[ContractReference]

between

[Company], a company established under **[Country]** law with registered offices at **[Address]**, company registration number **[Number]** and validly represented by **[Name1]** and **[Name2]**, in their respective functions of **[Role1]** and **[Role2]**;

hereinafter referred to as the “**Service Provider**” or as the “**BSP**”,

and

Elia Transmission Belgium S.A./N.V., a public limited company under **Belgian** law with registered offices at **Boulevard de l'Empereur 20, B-1000 Brussels, Belgium**, registered under the crossroads bank for enterprises under number **731.852.231** and represented by **[Name1]** and **[Name2]**, in their respective functions of **[Role1]** and **[Role2]**;

hereinafter referred to as “**ELIA**”,

Elia and the **Service Provider** may also hereinafter be referred to individually as “the Party” and collectively as “the Parties”.

Whereas:

- Elia is responsible for the operation of the Belgian transmission system over which it has an ownership right or, at least, a right of use;
- Elia has been appointed as Transmission System Operator, in accordance with the Belgian law of 29 April 1999 concerning the organisation of the electricity market and supervises the safety, reliability and efficiency of the transmission system;
- Elia must therefore safeguard operational security, frequency quality and the efficient use of the interconnected system and resource – in particular the service of Frequency Containment Reserve (FCR) – in accordance with the relevant provisions of the European Regulations, such as the Commission Regulation (EU) 2017/2195 of 23 November 2017 establishing a guideline on electricity balancing, the Commission Regulation (EU) 2017/1485 of 2 August 2017 establishing a guideline on electricity transmission system operation, and the Belgian legislation;
- This BSP Contract FCR defines the mutual rights and obligations of ELIA and the Service Provider relating to the provision of FCR Services;
- This BSP Contract FCR falls under the Terms and Conditions for balancing service providers for the FCR Service.

the following points have been agreed:

Contents

Part I - General Conditions	6
Art. I.1 Definitions	6
Art. I.2 Scope of Services and contractual structure	8
Art. I.3 Additional rules of interpretation	8
Art. I.4 Entry into force and duration of this Contract	8
Art. I.5 Invoicing and payment	9
Art. I.6 Liability	10
Art. I.7 Emergency and Force Majeure.....	11
Art. I.8 Confidentiality.....	13
Art. I.9 Obligation of information	14
Art. I.10 Review	14
Art. I.11 Premature dissolution in case of serious default	15
Art. I.12 Miscellaneous clauses	15
Art. I.13 Applicable law – rules regarding disputes	16
Part II - Specific Conditions	17
Title 1: DEFINITIONS	18
Art. II.1 Definitions	18
Title 2: CONDITIONS FOR PARTICIPATION TO THE SERVICE.....	28
Art. II.2 Conditions for BSP.....	28
Art. II.3 Conditions for Delivery Points.....	29
Art. II.4 Combinability conditions	31
Title 3: COMMUNICATION TEST AND PREQUALIFICATION TEST	32
Art. II.5 Communication test	32
Art. II.6 Reserve Mode control	32
Art. II.7 Prequalification test.....	33
Title 4: CAPACITY PROCUREMENT	34
Art. II.8 Procurement of FCR Capacity	34
Art. II.9 Transfer of Obligation	34
Art. II.10 Submission of FCR Energy Bids.....	36

Title 5: ACTIVATION	38
Art. II.11 Activation.....	38
Art. II.12 Exchange of information	39
Title 6: AVAILABILITY AND ACTIVATION CONTROL	40
Art. II.13 Availability control	40
Art. II.14 Activation control.....	41
Title 7: REMUNERATION AND INCENTIVES	42
Art. II.15 Remuneration.....	42
Art. II.16 Incentives	43
Title 8: INVOICING	44
Art. II.17 Invoicing and payment	44
Title 9: OTHER DISPOSITIONS	47
Art. II.18 Contact Persons.....	47
Art. II.19 Duration.....	47
Part III - Annexes.....	49
Annex 1. Procedure for BSP Acceptance	50
Annex 2. Procedure for Delivery Point Acceptance	51
Annex 3. Measurement requirements	57
Annex 4. List of Delivery Points.....	58
Annex 5. Communication test.....	60
Annex 6. Reserve Mode Control	61
Annex 7. Prequalification test.....	62
Annex 8. Capacity auctions	67
Annex 9. Transfer of Obligation.....	69
Annex 10. FCR Energy Bid	70
Annex 11. Activation.....	72
Annex 12. Availability test.....	79
Annex 13. Activation control	85
Annex 14. Incentives	87
Annex 15. Appropriation structure	91
Annex 16. Contact details.....	92

PART I - GENERAL CONDITIONS

ART. I.1 DEFINITIONS

Except where there is further specification aimed at application for the purposes of the present Contract, and without ignoring the stipulations of public order, the concepts defined in the Electricity Act, the electricity decrees and/or ordinances in relation to the organization of the electricity market and/or the various applicable Grid Codes and EU network codes and guidelines, as amended from time to time, are also included for the purposes of the Contract in the sense of these statutory or regulatory definitions.

In addition, the following definitions apply for the purposes of the Contract:

Annex	Any annex to the present Contract;
Article or Art.	Any article of the present Contract;
CACM	The Commission Regulation (EU) 2015/1222 of 24 July 2015 establishing a guideline on capacity allocation and congestion management;
Contract	The present Contract, including its Annexes;
CREG	The Commission for Electricity and Gas Regulation, i.e. the Belgian national regulatory authority;
Direct Damage	Any damage, with the exclusion of Indirect Damage, directly and immediately resulting from any contractual breach and/or fault within the framework of or as a result of the execution of the Contract, on any grounds whatsoever (contractual or extra-contractual). The said fault being one, which under similar circumstances, an experienced, professional Service Provider or TSO, respectively, acting according to the rules and taking all reasonable precautions would in no case have committed;
EBGL	The Commission Regulation (EU) 2017/2195 of 23 November 2017 establishing a guideline on electricity balancing;
Electricity Act	The Belgian law of 29 April 1999 concerning the organisation of the electricity market (« Loi du 29 avril 1999 relative à l'organisation du marché de l'électricité, <i>M.B.</i> 11.05.1999 » / « Wet van 29 april 1999 betreffende de organisatie van de elektriciteitsmarkt, <i>B.S.</i> 11.05.1999 »), as amended from time to time;
E&R NC	Commission Regulation (EU) 2017/2196 of 24 November 2017 establishing a network code on electricity emergency and restoration;

Part I - General Conditions

General Conditions	Part I to the present Contract. The General Conditions are identical in the following contracts for ancillary services to be concluded by Elia: the contracts for balancing services (BSP – “Balancing Service Provider” contracts for FCR – “Frequency Containment Reserve”, aFRR “automatic Frequency Restoration Reserve” and mFRR – “manual Frequency Restoration Reserve”), the contracts for restoration services (RSP – “Restoration Service Provider”), the contracts for voltage and reactive power control services (VSP – “Voltage Service Provider”) and the contracts for services related to congestion management (OPA – “Outage Planning Agent” and SA – “Scheduling Agent”);
Grid Codes	The Federal Grid Code for Transmission (adopted in the form of royal decree on the basis of article 11 of the Electricity Act – currently the “Arrêté royal du 22 avril 2019 établissant un règlement technique pour la gestion du réseau de transport de l’électricité et l’accès à celui-ci, <i>M.B. 29.04.2019</i> ” / “Koninklijk besluit van 22 april 2019 houdende een technisch reglement voor het beheer van het transmissienet van elektriciteit en de toegang ertoe, <i>B.S. 29.04.2019</i> ”), as amended from time to time, and the grid codes for local and regional transmission, as amended from time to time;
Indirect Damage	Any indirect damage or consequential damage, such as, but not limited to loss of revenue, loss of profit, loss of data, loss of business opportunities, loss of (prospective) clients, missed savings;
Law of 2 August 2002	The Law of 2 August 2002 against payment arrears in commercial transactions (“Loi du 2 août 2002 concernant la lutte contre le retard de paiement dans les transactions commerciales, <i>M.B. 7.08.2002</i> ” / “Wet betreffende de bestrijding van de betalingsachterstand bij handelstransacties, <i>B.S. 7.08.2002</i> ”), as amended from time to time;
Service(s)	The service(s) and tasks as described in the Specific Conditions of the present Contract and as provided by the Service Provider;
Service Provider	The Service Provider as identified on the first page of the present Contract;
SOGL	The Commission Regulation (EU) 2017/1485 of 2 August 2017 establishing a guideline on electricity transmission system operation;
Specific Conditions	Part II of the present Contract, supplemented by any Annexes;
Terms and Conditions	The terms and conditions as required by, and developed in accordance with, the applicable European regulations. The present Contract constitutes an appendix to the Terms and Conditions as identified in the Whereas section of the present Contract;
Working Day	Any calendar day except for Saturday, Sunday and Belgian public holidays.

ART. I.2 SCOPE OF SERVICES AND CONTRACTUAL STRUCTURE

I.2.1 Scope of Services

By the signature of the present Contract, the Service Provider undertakes to provide the Service(s) in accordance with the General and Specific Conditions as provided for in this Contract.

The present Contract between the Parties lays down their mutual rights and obligations in relation to the procurement by Elia from the Service Provider and the eventual provision by the Service Provider to Elia of the Service(s).

I.2.2 Structure of the Contract

The present Contract is composed of a first part containing the General Conditions and of a second part containing the Specific Conditions for the Services, supplemented by any Annexes.

The Parties shall ensure that the proper performance of this Contract is always based on the existence and proper performance of the requisite contractual agreements, if any, with third parties involved.

ART. I.3 ADDITIONAL RULES OF INTERPRETATION

By signing this Contract, the Service Provider explicitly renounces to apply its own general conditions, special or otherwise, regardless of the time when they were issued or the form of their issuance.

The substantiation in this Contract of a specific obligation or stipulation listed in the applicable legislation shall in no way be considered as derogating from the obligations or stipulations which, under the applicable legislation, must be applied to the relevant situation.

In this Contract, including its annexes, unless the context require otherwise:

- The singular indicates the plural and vice versa;
- References to one gender include all other genders;
- The table of contents, titles and headings in this Contract are for convenience only and do not affect their interpretation;
- The word “including” and its variations are to be construed without limitation;
- Any reference to legislation, regulations, directive, order, instrument, code or any other enactment shall include any modification, extension or re-enactment of it then in force.

ART. I.4 ENTRY INTO FORCE AND DURATION OF THIS CONTRACT

I.4.1 Entry into force of this Contract

This Contract shall enter into force once it has been validly signed by all Parties, provided the Terms and Conditions to which this Contract relates have already entered into force. Otherwise, this Contract shall enter into force, once validly signed by all Parties, on the implementation date of such Terms and Conditions.

Once this Contract has entered into force between the Parties, the Parties shall be bound by the General Conditions as detailed under Part I and the Specific Conditions as detailed under Part II of this Contract, supplemented by any annexes. This is without prejudice to the fact that Part II might foresee a later start date for the provision of certain Services.

Part I - General Conditions

Once this Contract has entered into force between the Parties, it supersedes all previous agreements and documents exchanged between the Parties relating to the same subject matter.

I.4.2 Duration of the Contract

Without prejudice to Art. I.11 and without prejudice to the applicable legislation and regulations, the duration of this Contract is specified in Part II on the Specific Conditions.

ART. I.5 INVOICING AND PAYMENT

I.5.1 Invoicing matters – General instructions

Without prejudice to specific instructions regarding invoicing matters as may be provided for under the Specific Conditions of this Contract, each invoice sent under this Contract shall include at least the following items:

- 1) Full name and address of both the invoicing Party and the invoiced Party;
- 2) VAT number of both the invoicing Party and the invoiced Party;
- 3) Invoiced amount, valued in euro;
- 4) Bank account and bank address (including IBAN and BIC) on which the relevant payment shall be made;
- 5) Invoice number;
- 6) Invoice issue date;
- 7) Designation of the Service and the period on the invoice;
- 8) Tax rate and tax amount separately, if any;
- 9) Specific constraint for invoicing, required by article 226 of Directive 2006/112/CE, if any, e.g. indication of the reference to the applicable provision of the Directive where the supply of services is subject to the VAT reverse charge procedure;
- 10) Reference if required by the invoiced Party;
- 11) Payment term in accordance with Art. I.5.2 hereafter; and
- 12) Specific items as listed in any invoicing section provided for under the Specific Conditions of this Contract.

The absence of one of the abovementioned stipulations shall nullify the invoice and render it valueless. In such a case, the invoiced Party reserves the right to return the invoice to the invoicing Party within a period of 15 (fifteen) Working Days. Returning the invoice in this way shall constitute rejection of the invoice, without any other reaction from the invoiced Party being necessary. Failure by the invoicing Party to observe the abovementioned stipulations regarding invoicing will give rise to an incorrect invoice, which will be the subject of a credit note to invoiced Party. The invoicing Party may then send a new and corrected invoice.

Part I - General Conditions

I.5.2 Payment matters

Payments will be made within 30 calendar days following the end of the month in which the invoice is received (this is the due date of the invoice). The invoiced Party shall pay the invoicing Party by direct transfer to the stated bank account. Within the scope of this Article, an invoice will be considered received on the third Working Day following the date when the invoice was sent (postmark will serve as proof in case of a paper invoice sent by post – in case of an electronic invoice the date the invoice was submitted in the electronic system or sent by email will apply).

Any objection regarding the amount of an invoice must, in order to be admissible, be sent by registered letter to the invoicing Party before the due date of the disputed invoice as set above. The reasons for the objection shall be described as comprehensibly and in as much detail as is reasonably possible. If the value of the invoice is disputed, the undisputed part of the invoice shall still be paid. The Parties will discuss in good faith in order to reach an agreement on the disputed amount of the invoice within thirty (30) Working Days of the receipt of the registered letter, failure of which Art. I.13 will apply.

The amount subject of an objection shall be paid within 30 calendar days following the end of the month in which 1) the agreement is reached in respect of the dispute or 2) the decision has been adopted by which the dispute is definitively settled between the Parties according to Art.I.13. The Parties undertake not to invoke the exception of non-performance (“exceptio non adimpleti contractus”) in order to suspend the performance of their respective obligations during the dispute.

I.5.3 Interest for delayed payment

Late payment will automatically and without notice of default incur interest on the total amount of the invoice as specified in article 5 of the Law of 2 August 2002 from the day following the due date, up to and including the day when payment in full is made.

ART. I.6 LIABILITY

I.6.1 General principles

Without prejudice to any obligation of result provided for under this Contract (such as confidentiality and payment obligations), as the case may be, and without prejudice to the application of a penalty system as provided by the Contract, the provision of the Services by the Service Provider is an obligation of means (“middelenverbintenis – obligation de moyens”).

The Parties shall do their utmost effort, during the lifetime of the Contract, to prevent damage by one Party to the other and, as the case may be, to limit it.

I.6.2 Direct Damages

The Parties to this Contract shall be liable to one another for any Direct Damage. The Party in breach and/or at fault will indemnify the other Party and compensate it for any Direct Damage, including for claims by third parties in relation to such Direct Damage. Except in a case of deception or deliberate fault, the Parties will under no circumstances be liable to the other Party for compensating or indemnifying the other Party, including for claims by third parties, for Indirect Damage.

I.6.3 Process

As soon as one of the Parties has knowledge of any claim to pay compensation, including a claim for compensation arising from a claim by a third party, for which the latter might institute proceedings against

the other Party, that Party shall inform the other Party thereof without delay. This notification shall be made by means of a registered letter, mentioning the nature of the claim, the amount thereof (if known) and the method of calculation – all in reasonable detail and with reference to the legislative, regulatory or contractual provisions on which the claim might be based. In case of third party claim, the defaulting Party shall fully cooperate with the defending Party in such response and defense as reasonably required.

I.6.4 Caps

Any compensation due, as the case may be, by any Party is in any case limited to a maximum of twice the value of the Contract per year irrespective of the number of claims, the amount of which cannot exceed €12.5 million (twelve and a half million Euro) per year and per Party. This cap is without prejudice to the caps applicable for contractual third party claims.

ART. I.7 EMERGENCY AND FORCE MAJEURE

I.7.1 Emergency Situation

In case of an emergency situation (as defined in the applicable legislation and regulations), Elia is entitled and/or obliged to take all the measures provided for in the applicable legislation and regulations. In case of contradictions with the provisions of this Contract, such measures as foreseen in the applicable legislation and regulations shall prevail on the rights and obligations of this Contract.

I.7.2 Alert, Emergency, Black-out and Restoration state

When the system is in alert, emergency, black-out or restoration state (as defined in the applicable legislation and regulations¹), Elia is entitled and/or obliged to take all the measures provided for in the applicable legislation and regulations, including under certain circumstances the suspension of market activities as provided for in the applicable legislation and regulations. In case of contradictions with the provisions of this Contract, such measures as foreseen in the applicable legislation and regulations shall prevail on the rights and obligations of this Contract.

I.7.3 Force Majeure

Without prejudice to the rights and obligations of the Parties in the cases as referred to under Art. I.7.1 and I.7.2, and as defined in the applicable legislation and/or regulations, and without prejudice to the application of the rescue and restoration provisions, as defined in the applicable legislation and/or regulations, the Parties will be discharged of their respective obligations under this Contract in a case of force majeure that prevents the performance of their obligations under this Contract, either partly or entirely, with the exception of the financial obligations that arose before the force majeure event. This suspension of the obligations will only last as long as the force majeure event.

The term “force majeure” shall mean, without prejudice to the definition of force majeure in applicable legislation and/or regulations, any unforeseeable or unusual event or situation beyond the reasonable control of a Party, and not due to a fault of the Party, which cannot be avoided or overcome with reasonable foresight and diligence, which cannot be solved by measures which are from a technical, financial or economic point of view reasonably possible for the Party, which has actually happened and is objectively

¹ Including article 72 of CACM; article 16.2 of the Regulation (EC) No 714/2009 of the European Parliament and of the Council of 13 July 2009 on conditions for access to the network for cross-border exchanges in electricity and repealing Regulation (EC) No 1228/2003 and article 16.2 of the Regulation (EU) 2019/943 of the European Parliament and of the Council of 5 June 2019 on the internal market for electricity.

Part I - General Conditions

verifiable, and which makes it impossible for the Party to fulfil, temporarily or permanently, its obligations in accordance with this Contract and which occurred after conclusion of the Contract.

The application of market mechanisms, such as imbalance prices or the application of high prices in a normal market state, cannot be qualified as force majeure.

The following situations, among others, will be considered as force majeure, but only if they comply with the conditions for force majeure as provided for in the second paragraph of Art. I.7.3:

- natural disasters arising from earthquakes, floods, storms, cyclones or other climatologically exceptional situations recognized as such by a public authority habilitated for this;
- a nuclear or chemical explosion and its consequences;
- exceptional hazards (or "hors catégorie" hazards) during which the sudden unavailability of elements of the grid or of an electricity production unit is caused by reasons other than aging, lack of maintenance or qualification of the operators; including the unavailability of the IT system, whether or not caused by a virus, when all preventive measures have been taken considering the state of the art ;
- the temporary or continuing technical impossibility for the grid to exchange electricity because of disruptions within the control area caused by electrical currents resulting from energy exchanges within another control area or between two or more other control areas and of which the identity of the market participants involved in those energy exchanges is unknown by Elia and which Elia could not reasonably be expected to know;
- the impossibility to operate the grid, installations that from a functional point of view are part of it, or installations of the Service Provider, due to a collective dispute that gives rise to a unilateral measure by employees (or groups of employees) or any other labour dispute;
- fire, explosion, sabotage, acts of terrorism, acts of vandalism, damage caused by criminal acts, criminal coercion and threats of a similar nature or acts having the same consequences;
- state of war (declared or not), threat of war, invasion, armed conflict, blockade, revolution or uprising; and
- The situation in which a competent authority invokes urgency and imposes exceptional and temporary measures on the system operators and/or grid users, such as measures needed in order to maintain or restore the safe and efficient operation of the grids, including the order to shed load in case of a shortage.

The Party that invokes a situation of force majeure shall inform the other Party as soon as possible, by phone and/or by mail, of the circumstances following which it cannot fulfil its obligations, either wholly or in part, how long such non-fulfilment might reasonably be expected to last, and of the measures it has taken to counteract the situation.

Nevertheless, the Party that invokes a situation of force majeure shall do everything possible to limit the consequences of the non-fulfilment of its obligations towards the other Party, the transmission system and third parties and to once again fulfil its obligations.

If the period of force majeure persists for 30 (thirty) successive days or more, and a Party, as a result of the force majeure situation acknowledged by both Parties, is unable to fulfil its essential obligations of the Contract, the other Party may terminate the Contract with immediate effect by a reasoned registered letter.

ART. I.8 CONFIDENTIALITY**I.8.1 No divulgence of confidential information**

The Parties and/or their employees shall treat any information that they exchange with one another within the framework or in relation to the Contract in the strictest confidence and not divulge it to third parties unless at least one of the following conditions is met:

- if one of the Parties is called to give evidence in court or in their relations with the competent regulatory, administrative and judicial authorities. The Parties shall, as far as possible, inform each other of the situation in advance, and will reach an agreement concerning the form and content of the communication of this information;
- if a prior written agreement has been obtained from the Party issuing the confidential information;
- with regard to Elia, in consultation with operators of other grids or within the framework of contracts and/or rules with the foreign grid operators or regional security coordinators/regional coordination centers, insofar as necessary and where anonymization is not possible and insofar as the addressee of that information undertakes to accord the same degree of confidentiality to that information as that accorded by Elia;
- if such information is easily and normally accessible or available to the public;
- if the divulgence of such information by a Party to persons such as subcontractors and/or their employees and/or their representatives and/or regional security coordinators/regional coordination centers is essential for technical or safety reasons, insofar as those addressees are bound by rules of confidentiality that appropriately guarantee the protection of confidentiality;
- if the information is already legally known by a Party and/or their employees and work agents at the time of transmission, and which has not been communicated by the notifying Party, prior to the transmission, directly, indirectly, or by a third party by breaching an obligation of confidentiality;
- the information which, after transmission, has been brought to the attention of the recipient Party and/or its staff and work agents via a third party, without breaching an obligation of confidentiality with regard to the notifying Party;
- the divulgence of the information is foreseen by applicable legislation and/or regulation;
- the divulgence of aggregated and anonymized information and data.

This Article is without prejudice to the specific provisions on confidentiality obligations regarding the operator of the Belgian electricity transport network (at both federal and regional levels) imposed by the applicable legislation and regulation.

A Party must not, for reasons of confidentiality, refuse to divulge information that is essential and pertinent to the implementation of the Contract. The other Party to whom such information is communicated guarantees that it will maintain the confidential nature thereof.

The Service Provider declares and guarantees that the confidential information will only be used for the purposes of establishing the bid/performance of the Services and not for other purposes.

Both Parties shall take the requisite measures to ensure that this confidentiality obligation shall also be strictly observed by their employees, as well as any person who, without being an employee of one of the Parties but for whom that Party is nonetheless responsible, might properly receive such confidential information. In addition, confidential information shall only be divulged on a “need-to-know” basis, and reference will always be made thereby to the confidential nature of the information.

Part I - General Conditions

I.8.2 Infringements to confidentiality obligations

Any infringement to this confidentiality obligation shall be considered as serious misconduct by the Party that violates that obligation. Such infringement shall give rise to the payment of compensation for any Direct and Indirect, material and immaterial damage (in deviation from Art. I.6.2) that the other Party can reasonably demonstrate, subject to the caps of Art. I.6.4.

I.8.3 Ownership

Each of the Parties shall maintain full ownership of that confidential information, even when it has been divulged to other Parties. The transmission of the confidential information does not entail any transfer of property nor of any other right other than those mentioned in the Contract.

I.8.4 Duration

Without prejudice to the applicable legislation and regulations, the aforementioned confidentiality obligations remain in force for a period of 5 (five) years after termination of the Contract.

I.8.5 Phone recordings

The Parties agree that real-time telephone communications will be recorded at their respective dispatching centers. The Parties accept the need for this communication to be recorded and the principle underpinning it. As regards probative value, the Parties acknowledge that the recordings of these communications shall be admissible as proof in the event of a dispute settlement relating to this Contract. Both Parties shall notify their respective staff about the existence and/or possibility of recordings as well as about the existence and/or possibility of recordings by the other Party.

ART. I.9 OBLIGATION OF INFORMATION

The Parties undertake, for the duration of this Contract, to inform one another as soon as possible of any event or information that the Party who has knowledge thereof must reasonably consider as an event or information that might have a detrimental effect on the Contract or on the fulfilment of the obligations specified in the Contract towards the other Party.

ART. I.10 REVIEW**I.10.1 Amendments to the main body of this Contract (General and Specific Conditions) and generally applicable Annexes**

This Contract can only be modified in the course of the process for amendments to the Terms and Conditions to which it relates and following the processes foreseen therefor in the applicable regulations and legislations.

After approval by the CREG of the amendments to the Contract, including the proposed date of entry into force, these amendments shall enter into force, as will be indicated in the implementation plan of the amended Terms and Conditions and as confirmed in the notification via registered mail with acknowledgement of receipt, sent by Elia to the Service Provider in case the amendments would apply to existing contractual relationships for the subject matter which is ruled by this Contract, but however not earlier than 14 days after such notification.

Part I - General Conditions

Without prejudice to the competences of the competent authorities and without prejudice to the applicable legislation and regulations, in case the Service Provider does not agree with the amendments that would be applicable to the Contract currently in force, the Service Provider may terminate the Contract.

I.10.2 Amendments to party-specific Annexes

Without prejudice to obligations imposed by the applicable legislation and regulations, any Annex containing party-specific information can be modified in writing after agreement by both Parties (but only for the party-specific information itself).

Any modification to the contact information taken up under the relevant Annex to this Contract (i.e. contact person, address, e-mail, phone and fax numbers) must be communicated to the other Party no later than 7 (seven) Working Days before the date on which that modification comes into effect. Both Parties shall keep the contact details as provided for under that Annex up to date throughout the validity of the Contract. These exchanges and updates can be done via e-mail and do not require a formal written amendment process of the Contract.

ART. I.11 PREMATURE DISSOLUTION IN CASE OF SERIOUS DEFAULT

The Contract may be suspended or terminated unilaterally by one of the Parties (the 'impacted Party') without judicial intervention if the other Party (the 'defaulting Party') does not rectify a serious breach or fault within 15 (fifteen) Working Days after the defaulting Party has received a registered letter with proof of receipt in which the serious breach or fault is mentioned and in which that Party was notified that the Contract would be suspended or terminated without any further notice if the aforementioned serious breach or fault is not fully rectified within the stated deadline. The deadline of 15 (fifteen) Working Days can be extended by the impacted Party. The Contract will be suspended or terminated subject to the reserve of any legal action available to the Party not in default against the defaulting Party, including a claim for damages.

ART. I.12 MISCELLANEOUS CLAUSES

I.12.1 Waiver

The fact that one of the Parties renounces permanently or temporarily to the application of one or more clauses of the Contract may under no circumstances be considered as a renunciation of the rights of that Party arising from that particular clause or those clauses.

I.12.2 Entire agreement

Without prejudice to the application of the relevant legislation and regulations, the Contract comprises the entire agreement concluded between the Parties and includes all the agreements made by the Parties regarding the subject matter thereof.

I.12.3 Notices

Any notification, as required under the Contract, will be made in writing (including e-mail) except if otherwise provided for in accordance with the provisions of this Contract.

The exchange of information for the performance of the Contract shall be directed to the respective contact persons of the Parties as provided for under the relevant Annex.

I.12.4 Transfer of rights

The rights and obligations specified in the Contract may under no circumstances be transferred, either wholly or in part, without the prior written permission of the other Party (except for transfers to undertakings affiliated to Elia in the sense of article 1:20 of the Belgian Code of Companies and Associations for which no such permission shall be required). That permission shall not be refused or postponed unreasonably.

I.12.5 Severability

On condition that this has no effect on the subject of the Contract itself, the invalidity of one or more clauses in the Contract shall not affect the validity, interpretation and/or implementation of the other clauses of the Contract.

If one or more clauses of the Contract have to be declared invalid or impossible to implement, the review process foreseen under Art. I.10 shall be followed.

ART. I.13 APPLICABLE LAW – RULES REGARDING DISPUTES

The Contract is governed by and interpreted according to Belgian law.

Any dispute relating to the conclusion, validity, interpretation or execution of the Contract or of any subsequent contracts or operations that may arise therefrom, as well as any other dispute concerning or in relation to the Contract shall, at the discretion of the more diligent Party, be presented to:

- the jurisdiction of the Brussels Enterprise Court; or
- the mediation/conciliation and arbitration service organized by the regulator concerned in accordance with the applicable legislation and regulations; or
- an ad hoc arbitration in accordance with the provisions of the Belgian Judicial Code.

In view of the complex relationships, the Parties hereby agree, in order to facilitate the application of the rules regarding coherence or intervention, either – in the case of related disputes – to renounce any arbitration proceedings for the purpose of intervening in another judicial procedure, or – conversely – to renounce a judicial procedure for the purpose of taking part in multi-party arbitration. In the case of dissension, preference will be given to the procedure introduced first.

PART II - SPECIFIC CONDITIONS

TITLE 1: DEFINITIONS

ART. II.1 DEFINITIONS

Unless further specified for the application of the BSP Contract FCR, and without ignoring the provisions of the General Conditions and the stipulations of public order, the concepts defined in the Electricity Act, the electricity decrees and/or ordinances in relation to the organization of the electricity market and/or the various applicable Grid Codes and EU network codes and guidelines, as amended from time to time, are also included for the purposes of the BSP Contract FCR in the sense of these statutory or regulatory definitions.

In addition, the following definitions apply for the purposes of the BSP Contract FCR:

1	Access Contract	As defined in article 2 §1 45° of the Code of Conduct;
2	Access Point(s)	As defined in article 2 §1 46° of the Code of Conduct for an access to the transmission grid of ELIA. For an access to the ELIA Grid other than the transmission grid, or to a Public Distribution Grid, or to a CDS: a point, defined by physical location and voltage level, at which access to the ELIA Grid other than transmission grid, or to a Public Distribution Grid, or to a CDS is granted, with a goal to injecting or taking off power, from an electricity generation unit, a consumption facility, a storage facility, connected to this grid;
3	Active Energy Reservoir Management	As defined in article 2(2) of the Additional Properties: active charging/discharging of the reservoir depending on the state of charge which results from FCR activation to avoid a status of a completely full/empty reservoir;
4	Additional Properties	The common proposal developed by all TSOs of Synchronous Area Continental Europe and approved by the competent national regulatory authorities, and as amended from time to time, regarding the development of the additional properties of Frequency Containment Reserves in accordance with Article 154(2) of the SOGL;
5	Alert State	As defined in article 3(17) of the SOGL;
6	Automatic Frequency Restoration Reserve or "aFRR"	As defined in article 3(99) of the SOGL;
7	Balance Responsible Party or "BRP"	As defined in article 2(7) of the EBGL and listed in the register of Balance Responsible Parties;

Part II - Specific Conditions

8	Balancing Rules	A document, approved by the CREG, describing the market operation rules for the compensation of quarter-hourly imbalances, pursuant to article 212 §1 of the Code of Conduct;
9	Balancing Services	As defined in article 2(3) of the EBGL;
10	Balancing Service Provider or “BSP”	The Balancing Service Provider, as defined in article 2(6) of the EBGL, and identified on the first page of the BSP Contract FCR;
11	Bidding Obligations for FCR Capacity Bids	The obligations to be respected by the BSP when submitting FCR Capacity Bids;
12	BRP Contract	The contract concluded between ELIA and the BRP pursuant to article 119 of the Code of Conduct;
13	BRP _{source}	The Balance Responsible Party of the Access Point of the Grid User;
14	BSP-credit note	Credit note relative to a BSP-invoice in accordance with this BSP Contract FCR. Within the context of self-billing, Elia issues this credit note in name of the BSP, and addresses it towards itself;
15	BSP-invoice	Invoice for the amounts due by Elia to the BSP in accordance with this BSP Contract FCR. Within the context of self-billing, Elia issues this invoice in name of the BSP, and addresses it towards itself;
16	BSP Contract FCR	Balancing service provider contract for the Frequency Containment Reserve;
17	Capacity Contracting Time Unit or “CCTU”	A period of 4 hours for which the FCR Capacity Bids offered by the BSP to ELIA can be activated as FCR Energy Bids. A single capacity auction is performed per CCTU;
18	CDS	As defined in article 2 §1 5° of the Code of Conduct. In those Specific Conditions, “CDS” refers to CDS connected to the ELIA Grid;
19	CDS Operator or “CDSO”	As defined in article 2 §1 11° of the Code of Conduct;
20	Code of Conduct	The code of conduct, approved by CREG by decision (B) 2409 of October 20, 2022, and as

Part II - Specific Conditions

		amended from time to time, establishing conditions for connection and access to the transmission grid and methods for calculating or setting conditions for the provision of ancillary services and access to cross-border infrastructure, including the procedures for capacity allocation and congestion management;
21	Core Share	The part of FCR Obligation that TSO must procure from Technical Units physically inside their LFC Block as defined in Annex VI of SOGL.
22	Counterpart BSP	The party, holding a valid BSP Contract FCR, with whom the BSP concludes a Transfer of Obligation;
23	Daily Schedule	The program of production of a Technical Unit (in MW), given on a quarter-hourly basis ² , provided to ELIA in day-ahead and updated in accordance with the rules of the CIPU Contract;
24	Day	Period of one Day starting at 00:00 CET morning until 24:00 CET;
25	Delivery Point or "DP"	A point on an electricity grid or within the electrical facilities of a Grid User, where a service is delivered – this point is associated with one or several metering(s) and/or measure(s), according to dispositions of the contract related to this service, that enable(s) ELIA to control and assess the delivery of the concerned service;
26	Delivery Point with Limited Energy Reservoir or "DP LER"	A Delivery Point part of a Providing Group as defined in Article 2(2) of the Additional Properties, for which the full activation of FCR for a period of 2 hours in either positive or negative direction might, without consideration of the effect of an Active Energy Reservoir Management, lead to a limitation of its capability to provide the full FCR activation due to the depletion of its energy reservoir(s) taking into account the Effective Energy Reservoir effectively available.
27	Delivery Point DP _{PG} or "DP _{PG} "	Delivery Point for which ELIA does not receive Daily Schedules;
28	Delivery Point DP _{SU} or "DP _{SU} "	Delivery Point for which ELIA receives Daily Schedules (in MW), in accordance with the SA Contract;

Part II - Specific Conditions

29	DP _{AV} Margin	The available margin (in MWh) of a Delivery Point with Energy Limited Reservoir indicates the remaining energy available for provision of the FCR Requested. The BSP only communicates the lowest absolute value between the available margin upwards and downwards. The value is positive (respectively negative) if it concerns an available margin in upward (respectively downward) direction;
30	DP _{ch/dch}	The power used for charging/discharging (in MW) of a Delivery Point with Energy Limited Reservoir. In case a Delivery Point is registered to deliver both FCR and aFRR Service and is defined as a Delivery Point with Limited Energy Reservoir in accordance with article II.1 of the T&C BSP aFRR, it is considered a Delivery Point with Limited Energy Reservoir in this context. This value is positive (respectively negative) for charging (respectively discharging) and sent for each Time Step;
31	DP _{FCR}	Binary value indicating whether a Delivery Point DP _{SU} is participating to the provision of the FCR Requested. The value is set to 1 if the Delivery Point participates to the provision of the FCR Requested and 0 otherwise;
32	DP _{FCR,cb}	The contribution (in MW) of a Delivery Point to the Pool supplying FCR Capacity. This value is positive or zero;
33	DP _{FCR,max}	The maximum FCR Power (in MW) that can be supplied by a Delivery Point;
34	DP _{measured}	The net active power, i.e. the difference between gross Offtake and gross Injection measured at a Delivery Point per Time Step. Net Offtake from the Elia Grid is considered as a positive value, net Injection into the Elia Grid is considered as a negative value;
35	EBGL	The Commission Regulation (EU) 2017/2195 of 23 November 2017 establishing a guideline on electricity balancing;
36	Effective Energy Reservoir	As defined in article 2(2) of the Additional Properties: the energy reservoir of a storage device which can effectively be used for energy feed/absorption;

Part II - Specific Conditions

37	Electrical Zone	As defined in the Rules for Coordination and Congestion Management;
38	ELIA-invoice	Invoice issued by Elia for the amounts due by the BSP to Elia in accordance with this BSP Contract FCR;
39	ELIA Grid	The electricity grid to which ELIA holds the property right or at least the right of using and operating it, and for which ELIA has been appointed as system operator;
40	Energy Management Strategy	The strategy declared by the BSP with which proof is provided on the ability of the Pool to deliver the FCR Obligation, in accordance with Article 156 of the SOGL;
41	ENTSO-E	European Network of Transmission System Operators for Electricity;
42	FCR Awarded	The quantity of the FCR Capacity (in MW) awarded to the BSP in capacity auctions for a certain CCTU;
43	FCR Balancing Energy Gate Closure Time or "FCR Balancing GCT"	The Balancing Energy Gate Closure Time, as defined in article 2(27) of the EBGL, for the FCR Service. The FCR Balancing GCT is 45 minutes before the beginning of the concerned quarter-hour;
44	FCR Capacity	A volume of balancing capacity, as defined in article 2(5) of the EBGL, in the framework of the FCR Service;
45	FCR Capacity Bid	A combination of an offered volume (in MW) and a price (in €/MW), allowing ELIA to procure the FCR Capacity for a defined CCTU;
46	FCR Capacity Gate Closure Time or "FCR Capacity GCT"	The point in time as of which submission (or update) of an FCR Capacity Bid is no longer permitted;
47	FCR Capacity Gate Opening Time or "FCR Capacity GOT"	The point in time as of which submission (or update) of a FCR Capacity Bid can start;
48	FCR Energy Bid	A volume (in MW), submitted by the BSP to ELIA for activation;
49	FCR _{max}	The maximal volume (in MW) of FCR that can be offered by the BSP in capacity auctions;

Part II - Specific Conditions

50	FCR Made Available	The quantity of FCR Capacity (in MW) made available to ELIA by the BSP through submission of FCR Energy Bid(s);
51	FCR Missing MW	The difference (in MW) between FCR Capacity Requested for a capacity availability test and the FCR Supplied by the BSP;
52	FCR Missing Time	The failure time (in seconds) of an energy availability test;
53	FCR Obligation	The sum of FCR Awarded and accepted Transfers of Obligation of the FCR Service;
54	FCR Power	A quantity of FCR Service expressed in MW;
55	FCR Capacity Requested	The quantity (in MW) of FCR Capacity tested by ELIA during an availability test. This value is positive;
56	FCR Requested	The FCR Power (in MW) requested for activation at a certain Time Step in function of the Frequency Deviation. This value is positive when the Frequency is lower than 50 Hz and negative when the Frequency is higher than 50 Hz
57	FCR Service	The Balancing Service that is governed by the BSP Contract FCR, comprising the provision of FCR Capacity and FCR Energy Bids;
58	FCR Supplied	The quantity of FCR Power (in MW) physically supplied by the BSP to ELIA. This value is positive;
59	FSP-DSO Contract	An agreement between the BSP and the DSO allowing the BSP to provide the FCR Service to ELIA with the Delivery Points listed in the corresponding FSP-DSO Contract;
60	Forced Outage	An unplanned removal (full or partial) of a Technical Unit providing the FCR Service for any urgent reason that is not under the operational control of the BSP;
61	Frequency or "F"	The frequency of the transmission grid in Hz;
62	Frequency Containment Reserve or "FCR"	As defined in article 3 (6) of the SOGL;

Part II - Specific Conditions

63	Frequency Deviation	A deviation in the Frequency, compared to 50,000Hz. This value is defined with three decimals and is considered positive in case the Frequency is larger than 50Hz and negative in case the Frequency is smaller than 50Hz.
64	Frequency Variation	A change of Frequency larger or equal to 40 mHz;
65	Grid User	As defined in article 2 §1 16° of the Code of Conduct for a Grid User connected to the ELIA Grid or to Public Distribution Grid; or as defined in article 2 §1 12° of the Code of Conduct for a Grid User connected to a CDS;
66	Grid User Declaration	The official declaration of the Grid User provided to ELIA, containing proof of the agreement between the BSP and the Grid User to provide the FCR Service at one (or more) specific Delivery Point(s);
67	Injection	The injection of active power as measured at the Delivery Point. The term injection is used to designate a certain sense of energy flow (from the Delivery Point towards the electrical grid) and does not exclusively refer to the technical means with which the FCR Service is provided;
68	Load –Frequency Control Block or “LFC Block”	As defined in article 3 (18) of the SOGL;
69	Manual Frequency Restoration Reserve or “mFRR”	Frequency Restoration Reserve (FRR), as defined in article 3 (7) of the SOGL, that can be activated manually;
70	Measurement Device	Either a measurement device as defined in article 2 §1 58° of the Code of Conduct or an equation between measurement device(s) situated at and/or downstream of an Access Point;
71	Month	Period starting at 00:00 CET the 1 st Day of the month until 24:00 CET the last Day of the month;
72	Normal State	As defined in Art. 3(5) of the SOGL;
73	Normal Mode	As defined in article 2(2) of the Additional Properties: activation of FCR depending on the deviation of system frequency;
74	Offtake	Value indicating the offtake of active power at a Delivery Point. The term offtake is used to

Part II - Specific Conditions

		designate a certain sense of energy flow (from the electrical grid towards the Delivery Point) and does not exclusively refer to the technical means with which the FCR Service is provided;
75	Open Qualification Procedure	A qualification procedure in accordance with public procurement rules in which candidates for provision of the FCR Service are screened based on criteria set by ELIA in a publication on ted.europe.eu;
76	Outage Planning Agent Contract or « OPA Contract »	Contract for the Outage Planning Agent, pursuant to article 126 of the Code of Conduct;
77	Participating TSO	Any TSO having signed an agreement for participation in the Regional Procurement Platform;
78	Pool	The set of Delivery Points of a BSP, which comply with the conditions for Delivery Points as set out in the BSP Contract FCR;
79	Private Measurement	The recording of measurements, as defined in article 136 of the Code of Conduct, by means of a Private Measurement Device;
80	Private Measurement Device	Measurement Device not owned by ELIA;
81	Private Measurement Technical Info Checklist	Report demonstrating that the minimum technical requirements established by ELIA for the Private Measurement Devices are fulfilled;
82	Procedure For BSP Acceptance	Procedure to ensure the compliance of the BSP to all conditions required to participate in the FCR Service;
83	Procedure For Delivery Point Acceptance	Procedure to ensure the compliance of the Delivery Point to all conditions required to participate in the FCR Service;
84	Providing Group	Any subset of Delivery Points part of the Pool of the BSP;
85	Public Distribution Grid	As defined in article 2 §1 10° of the Code of Conduct;
86	Public Distribution System Operator or « DSO »	As per article 2 §1 17° of the Code of Conduct; A natural person or legal entity appointed by the designated regional regulator or regional

Part II - Specific Conditions

		authority, who is responsible for the exploitation, the maintenance and, if necessary, the development of the Public Distribution Grid in a certain zone and, where applicable, for its interconnectors with other systems and who is responsible of guaranteeing the long-term ability of the Public Distribution Grid to meet reasonable demands for electricity distribution.
87	Regional Procurement Platform or « Regional Platform »	Procurement platform from which Participating TSOs can procure necessary FCR volumes from balancing service providers coming from the LFC Blocks of Participating TSOs. ELIA participates in this platform through Regelleistung;
88	Reserve Mode	As defined in article 2(2) of the Additional Properties: activation of active power response depending on short-term frequency deviations in relation to the mean frequency deviation;
89	Rules for Coordination and Congestion Management	A document, approved by the CREG, describing the operating rules, followed by ELIA, to ensure security and reliability of the ELIA Grid and to manage congestion, pursuant to article 59 (10) of the Electricity Directive, and article 122 of the Code of Conduct;
90	Scheduling Agent Contract or « SA Contract »	Contract for the Scheduling Agent, pursuant to article 131 of the Code of Conduct;
91	SAFA	The Synchronous Area Framework Agreement (SAFA) develops the Synchronous Area Operation Agreement according to Article 118 of the SOGL;
92	State of Charge	The available energy content in % of the maximal energy content of a Delivery Point with Energy Limited Reservoir.
93	Supplier	As defined in article 2 15°bis of the Electricity Act;
94	System Split	Event in which a synchronous area is separated in two or more grid regions, each characterized with its own Frequency.
95	Technical Unit	Device or aggregation of devices connected directly or indirectly to the electrical grid that produces and/or consumes electricity;
96	Time Step	A period of 2 seconds corresponding to the granularity of data exchange (e.g. DP _{measured});

Part II - Specific Conditions

	or “ts”	
97	Transfer of Obligation	Part or all of the quantity of FCR Awarded, that the BSP (respectively a Counterpart BSP) transfers to a Counterpart BSP (respectively the BSP);
98	Validity Period	As defined in article 2(33) of the EBGL;
99	Virtual Delivery Point	A Delivery Point, that is an aggregation of Technical Units, which has a $DP_{FCR,cb}$ inferior to 1,5 MW;

TITLE 2: CONDITIONS FOR PARTICIPATION TO THE SERVICE**ART. II.2 CONDITIONS FOR BSP**

- II.2.1 The BSP complies with conditions set forth in the Open Qualification Procedure as explained in Annex 1.A
- II.2.2 ELIA is entitled to evaluate, at any time during the validity period of the BSP Contract FCR, whether the BSP complies with the conditions mentioned in Art. II.2.1. For the avoidance of doubt, this does not entail any right for ELIA to physically access BSP assets but without prejudice to any other regulation, i.e. the Federal Grid Code and the Code of Conduct, regarding access to the Grid User connection installations.
- II.2.3 If the BSP no longer complies with conditions in Art. II.2.1, ELIA notifies the BSP by registered letter. If the BSP remains noncompliant to these conditions 15 Working Days after reception of notification, the BSP Contract FCR will be terminated in accordance with Art. I.11 of the General Conditions. As a consequence, after termination of the BSP Contract FCR, the BSP must apply again to the Open Qualification Procedure and comply with requirements of Art. II.2.1 if he wishes to sign a new BSP Contract FCR with ELIA to renew his participation to the FCR Service.
- II.2.4 The Parties shall ensure that the proper performance of the BSP Contract FCR is always based on the existence and proper performance of the requisite contractual agreements with third parties involved.
- II.2.5 In case of observation of a suspicious BSP behavior regarding REMIT regulation, ELIA may request a sound justification to the BSP by e-mail to the contractual responsible listed in Annex 16. From that request, the BSP disposes of 7 Working Days to provide an answer to ELIA. If, after investigation, ELIA suspects that the BSP behavior might breach REMIT regulation, ELIA notifies the CREG.
- II.2.6 Without prejudice to Art. I.11 of the General Conditions, in case of observation of a BSP behavior that might prejudice the functioning of the market, ELIA will request a sound justification to the BSP by e-mail to the contractual responsible listed in Annex 16. From that request, the BSP disposes of 7 Working Days to provide an answer to ELIA. If the provided justification is not satisfying, ELIA notifies the CREG. After discussion with the BSP and following consultation of the CREG, ELIA may decide to exclude the BSP from the FCR Service starting from the moment of notification by ELIA and for a certain period of time agreed between ELIA and the CREG.

ART. II.3 CONDITIONS FOR DELIVERY POINTS

- II.3.1 A Delivery Point may be any Technical Unit or a group of Technical Units identified by a Measurement Device:
- at an Access Point connected to the ELIA Grid or to a CDS;
 - at an Access Point connected to the Public Distribution Grid;
 - within the electrical facilities of a Grid User downstream of an Access Point connected to the ELIA Grid or to a CDS;
 - within the electrical facilities of a Grid User downstream of an Access Point connected to the Public Distribution Grid.
- II.3.2 All Delivery Points must comply with the measurement requirements set forth in Annex 3.
- II.3.3 All Delivery Points must comply with the communication requirements set forth in Annex 11.E.
- II.3.4 All Delivery Points, as mentioned in Art. II.3.1 are related to Access Point(s) included in valid Access Contract(s) and are in the perimeter of a BRP_{source} having a valid BRP Contract.
- II.3.5 Delivery Points DP_{SU} can only be part of the Pool of the BSP at the condition that it is included in a valid OPA Contract and a valid SA Contract³.
- II.3.6 All Delivery Points, connected to the ELIA Grid or to a CDS, must have successfully completed the following elements of the Procedure For Delivery Point Acceptance:
- A Private Measurement commissioning test is completed, as specified in Annex 2.B.
 - In case of Delivery Point DP_{PG} and the BSP is not the Grid User of concerned Delivery Point DP_{PG}: a Grid User Declaration is provided to ELIA, as specified in template of Annex 2.C.
 - In case of Delivery Points DP_{PG} within a CDS: a CDSO declaration is provided, as specified in Annex 2.F.
- II.3.7 Each Delivery Point with Limited Energy Reservoir should be included in the Energy Management Strategy (as described in Annex 2.D) In case a Delivery Point is registered to deliver both FCR and aFRR Service and is defined as a Delivery Point with Limited Energy Reservoir in accordance with article II.1 of the T&C BSP aFRR, it is considered a Delivery Point with Limited Energy Reservoir in this context and must also be included in the Energy Management Strategy.. ELIA validates the energy management strategy or provides a justification for rejecting it. The BSP will, at all times, operate the Delivery Point with Limited Energy Reservoir in line with the energy management strategy validated by ELIA.
- II.3.8 All Delivery Points must comply with the system split countermeasures requirements set forth in Annex 2.E. ELIA validates the system split countermeasures or provides a justification for rejecting it
- II.3.9 The BSP and ELIA agree on the list of Delivery Points in accordance with template provided in Annex 4. The BSP declares that all Delivery Points listed in Annex 4 are compliant with all applicable conditions, as per Art.II.3, and technically capable to provide the FCR Service.

³ During the transition period in which the party that is appointed as BRP_{source} takes the role of Outage Planning Agent and Scheduling Agent for the concerned Delivery Point DPSU in compliance with article 243 of the Code of Conduct, the same party undertakes the roles of the BSP and the BRP_{source}. After the transition period the BSP and BRP_{source} should remain the same party.

Part II - Specific Conditions

- II.3.10 The agreed list of Delivery Points, based on template in Annex 4, should at all times be kept up to date by the BSP.

Part II - Specific Conditions

- II.3.11 The agreed list of Delivery Points may be modified by submitting an updated list, based on template in Annex 4, via e-mail to the contractual responsible as mentioned in 6, under the following conditions:
- At the moment of the notification by the BSP, the Delivery Point(s) to be added must be in respect of all applicable conditions, pursuant to Art. II.3.
 - Following the request by the BSP of an update of Annex 4, ELIA disposes of 5 Working Days to approve the modifications and notify the approval (or reasons for rejection) to the BSP by e-mail to the contractual responsible, as per Annex 16.
 - The addition of a Delivery Point does not modify the FCR_{max} that can be offered by the BSP in capacity auctions. In order to increase the FCR_{max} , the BSP asks a prequalification test in accordance with Art. II.7.
 - The updated list of Delivery Points becomes effective no later than 5 Working Days following the notification of acceptance by ELIA. The exact date of entry into force is agreed between ELIA and the BSP.
 - In case of removal of a Delivery Point participating to FCR Service, ELIA will update the FCR_{max} that can be offered by the BSP in capacity auctions in accordance with dispositions of Annex 7. The FCR_{max} is updated with the entry into force of the updated list of Delivery Points.
 - The BSP is responsible to take, in due time, all actions necessary for technical integration, and ensures that the Delivery Point is operational at the agreed moment.
- II.3.12 For each Delivery Point, including Virtual Delivery Points, , the BSP declares in Annex 4 the $DP_{FCR,cb}$.
- II.3.13 A Delivery Point may be disqualified if the participation of the Delivery Point in the FCR Service jeopardizes the security of the ELIA Grid, the Public Distribution Grid or the CDS. In such a case, a sound justification is provided to the BSP and to the CREG.

ART. II.4 COMBINABILITY CONDITIONS

- II.4.1 A Delivery Point providing FCR Service can be included in a contract for aFRR and/or a contract for mFRR at the condition that the BSP is the same party.
- II.4.2 Any other Delivery Point, upstream or downstream of the Delivery Point supplying FCR Service⁴, cannot be part of any other Balancing Service, including FCR Service itself, independently from the fact that the BSP is the same party. However, if the BSP of both Delivery Points is the same party, ELIA will tolerate the situation, for mFRR, at the condition that the BSP renounces to invoke any influence of the Balancing Service supplied downstream on the Balancing Service supplied upstream.

⁴ In other words, there cannot be a cascade between two Delivery Points to avoid any influence from one on the other. Each Delivery Point must be independent from another one.

TITLE 3: COMMUNICATION TEST AND PREQUALIFICATION TEST**ART. II.5 COMMUNICATION TEST**

- II.5.1 After signature of the BSP Contract FCR and before submission of any FCR Capacity Bid, the BSP must successfully complete the communication test as specified in Annex 5.
- II.5.2 The BSP must respect the requirements of the communication test at all times during the validity of the BSP Contract FCR. If the BSP no longer complies with these requirements, the BSP is temporarily excluded from the FCR Service starting from the moment of notification by ELIA. The BSP has to succeed a new communication test in order to be considered again by ELIA for the provision of the FCR Service by ELIA. If the non-compliance is observed for a period for which the BSP has an FCR Obligation, incentives described in Art. II.16.1, II.16.4 and II.16.6 apply.
- II.5.3 In case of non-respect of Art. II.5.1, the BSP is not allowed to participate in capacity auctions.
- II.5.4 The general liability regime organized by Art. I.6 of the General Conditions is applicable during the communication test.
- II.5.5 Both Parties can request a communication test at any time to check whether the communication channels are operational.
- II.5.6 ELIA will not remunerate costs linked to communication tests.

ART. II.6 RESERVE MODE CONTROL

- II.6.1 A Providing Group including Delivery Points with Limited Energy Reservoir that did not participate in a successful prequalification test before the end of the transitional period referred to in Article 4 of the Additional Properties for FCR approved by the CREG by decision (B)2133 of 21 January 2021 **((21/01/2023))**, must be able to provide the FCR Service in Reserve Mode in accordance with Art. II.11.8. and as defined in Article 3(5) of the Additional Properties.
- II.6.2 The BSP may request a derogation to Art. II.6.1 based on a demonstration of the technical limitations of the Providing Group warranting the derogation. ELIA may refuse to grant the derogation. In such case, it shall duly motivate its decision and communicate it to the BSP and the CREG.
- II.6.3 Prior to participation to a prequalification test of a Providing Group with Reserve Mode implemented, the BSP must demonstrate their ability to provide the FCR Service in Reserve Mode in accordance with Annex 6. ELIA validates the Reserve Mode control or provides a justification for rejecting it.

ART. II.7 PREQUALIFICATION TEST

- II.7.1 Pursuant to article 155 of the SOGL, the BSP must perform a prequalification test as specified in Annex 7, prior to first participation in capacity auctions.
- II.7.2 Signature of the BSP Contract FCR and achievement of the communication test as described in Art. II.5 are required before performance of a prequalification test.
- II.7.3 The outcome of the prequalification test(s), as provided by Annex 7, determines the FCR_{max} that can be offered to ELIA by the BSP in capacity auctions.
- II.7.4 In accordance with Art. 3(2) of the Additional Properties, the BSP may request a derogation to Art. II.11.2 based on a demonstration of the technical limitations warranting the derogation. The derogation must be requested before the concerned Delivery Points participate in a prequalification test. ELIA may refuse to grant the derogation. In such case, it shall duly motivate its decision and communicate it to the BSP and the CREG.
- II.7.5 In accordance with Art. 3(2) of the Additional Properties, the BSP may request a derogation to Art. II.11.4 based on a demonstration of the technical limitations warranting the derogation. The derogation must be requested before the concerned Delivery Points participate in a prequalification test. ELIA may refuse to grant the derogation. In such case, it shall duly motivate its decision and communicate it to the BSP and the CREG.
- II.7.6 Subject to conditions of Art. II.7.2, the BSP can request to perform a prequalification at any moment following provisions of Annex 7.
- II.7.7 The BSP may choose whether he wants to perform the prequalification test on its Pool or on a Providing Group, in accordance with the rules set forth in Annex 7, and taking into account that a Delivery Point can only be included in one prequalification test at the same time.
- II.7.8 Any Delivery Point participating in a prequalification test cannot be included in an FCR Energy Bid, as specified in Art. II.10
- II.7.9 All Delivery Points participating to provision of FCR Capacity must complete the prequalification test at least every 5 years, as foreseen in article 155(6) of the SOGL.
- II.7.10 The prequalification test will not be considered as an activation as described in Art. II.11
- II.7.11 The BSP is not remunerated for the prequalification test.
- II.7.12 The Parties have the right to abort the prequalification test at any moment for security reasons. The Party who takes the decision immediately informs the other party by phone call to the real-time contact, as per Annex 16 and by e-mail to the contractual responsible as per Annex 16. The e-mail should include the justification for suspension of the prequalification test.
- II.7.13 The general liability regime organized by Art. I.6 of the General Conditions is applicable during the prequalification test.

TITLE 4: CAPACITY PROCUREMENT

ART. II.8 PROCUREMENT OF FCR CAPACITY

- II.8.1 During the validity period of the collaboration agreement between Participating TSOs, ELIA will procure the FCR Service per CCTU, including its Core Share on its LFC Block, from a Regional Procurement Platform together with other Participating TSOs.
- II.8.2 The BSP can participate to capacity auctions at the condition that:
- The BSP holds a valid BSP Contract FCR;
 - The BSP disposes of a non-zero FCR_{max} , pursuant to Art. II.7;
- II.8.3 The process, Bidding Obligations for FCR Capacity Bids, consequences of non-respect, rights and rules for capacity auctions, and awarding criteria within ELIA's LFC Block are described in Annex 8.
- II.8.4 The FCR Capacity required for the synchronous area and the total volume of FCR Capacity to be procured by ELIA are determined according to section A-1 of SAFA.
- II.8.5 The Core Share, as well as other limits and requirements for the exchange of FCR within Continental Europe, are specified in Annex VI of the SOGL.
- II.8.6 The FCR Awarded is part of the FCR Obligation and consequently the BSP undertakes all necessary actions to provide the FCR Service for the applicable CCTU (without further action by ELIA).
- II.8.7 The FCR Awarded is remunerated in accordance with Art.II.15.2.

ART. II.9 TRANSFER OF OBLIGATION

- II.9.1 The BSP can transfer in day-ahead or in intraday for a certain quarter-hour part or all of his FCR Obligation to one or several Counterpart BSP(s) holding a valid BSP Contract FCR to the date of the performance of the FCR Obligation.
- II.9.2 Similarly, the BSP may agree to make an additional quantity of FCR Capacity available to ELIA as a result of a Transfer of Obligation from a Counterpart BSP to the BSP.
- II.9.3 The BSP should at any time maintain his FCR Obligation available to ELIA either by providing its FCR Obligation by himself or by transferring part or all of its FCR Obligation in accordance with Art. II.9.1.
- II.9.4 The requestor party (being either the BSP or the Counterpart BSP) initiates the Transfer of Obligation. Once the other party (being either the Counterpart BSP or the BSP) has accepted the Transfer of Obligation, the status of concerned Transfer of Obligation becomes accepted. The procedure to be followed by the BSP and the Counterpart BSP in case of a Transfer of Obligation is described in Annex 9.
- II.9.5 When the Transfer of Obligation presents a status accepted, as per Art. II.9.4, ELIA adapts the FCR Obligation of the BSP and the Counterpart BSP for the applicable quarter-hours by:
- adding the volume transferred to the FCR Obligation of the party taking over the FCR Obligation;
 - reducing by the volume transferred the FCR Obligation of the party ceding the FCR Obligation.

Part II - Specific Conditions

- The BSP and the Counterpart BSP undertake the necessary actions to provide the FCR Service for the applicable quarter-hours (without any action by ELIA).
- II.9.6 Consequently, the availability control, as per Art. II.13, and the activation control as per Art. II.14, the resulting incentives for non-compliance, as per Art. II.16, among other provisions, will be based on the amended FCR Obligation of the BSP and the Counterpart BSP, resulting from the Transfer(s) of Obligation.
- II.9.7 The remuneration for the FCR Awarded remains fixed, as per Art. II.15, irrespective of any Transfers of Obligation that the BSP has agreed with Counterpart BSP(s).
- II.9.8 ELIA will not grant any remuneration under Art. II.15 to the Counterpart BSP with whom the BSP has agreed a Transfer of Obligation.
- II.9.9 Without prejudice to Art.II.9.6, the conditions, financial or otherwise, of the Transfer of Obligation between the BSP and the Counterpart BSP are to be arranged between them. ELIA does not have to be informed nor involved in any decision in this respect beyond the observance of the rules laid down in Annex 9.
- II.9.10 Any dispute arising from a failure on the part of the BSP or the Counterpart BSP to comply with his commitments in the framework of the agreement under which they are bound to one another for the Transfer of Obligation is not to be reported to ELIA nor arbitrated by ELIA.

ART. II.10 SUBMISSION OF FCR ENERGY BIDS

- II.10.1 The FCR Energy Bids for activation on Day D have to be submitted by the BSP to ELIA, taking into account Art. II.10.10, at the latest in day-ahead (Day D-1) at 15:00 CET, according to the rules set out in Annex 10.
- II.10.2 The duration of a FCR Energy Bid is a multiple of quarter-hours, while its minimal duration is a single quarter-hour.
- II.10.3 FCR Energy Bids can be submitted and updated until FCR Balancing GCT in accordance with the rules set forth in Annex 10.
- II.10.4 At FCR Balancing GCT, a FCR Energy Bid is a firm commitment by the BSP to supply the corresponding FCR Power.
- II.10.5 For each quarter-hour, the BSP may choose which Delivery Point(s), listed in Annex 4 or listed in the FSP-DSO Contract are included in the FCR Energy Bid, while complying with conditions set forth in Annex 10.
- II.10.6 A validation procedure for a FCR Energy Bid, as described in Annex 10, is performed each time (an update of) a FCR Energy Bid is submitted to ELIA. In case of non-compliance with the validation procedure, the concerned FCR Energy Bid is automatically rejected by ELIA and the BSP is directly notified of FCR Energy Bid rejection as well as reason for the rejection.
- II.10.7 The BSP is responsible for the correctness and accuracy of his FCR Energy Bids. ELIA cannot be held responsible for any potential mistakes or errors in FCR Energy Bid submission.
- II.10.8 In case a Forced Outage occurs leading to a decrease of the volume offered in a FCR Energy Bid:
- the BSP makes best effort to inform ELIA of the impacted volume and corresponding estimated duration of the unavailability. The communication is performed by e-mail, according to the template of Annex 10.C., to ELIA real-time contact and copy to the contractual responsible, as per Annex 16, as soon as the BSP notices the Forced Outage;
 - the BSP immediately updates the impacted FCR Energy Bid, in accordance with Art. II.10.3.
- II.10.9 All requirements for the submission of FCR Energy Bids are described in Annex 10.A and 10.B.
- II.10.10 For each quarter-hour, the sum of FCR Energy Bids should be equal to the FCR Obligation of the BSP.
- II.10.11 In case the total volume offered in the FCR Energy Bids submitted for a quarter-hour is not equal to the corresponding FCR Obligation for the concerned quarter-hour, following rules will apply:
- If the total volume submitted is lower than the FCR Obligation, FCR Made Available is equal to the volume submitted for the concerned quarter-hour;
 - If the BSP has not submitted any FCR Energy Bid, the FCR Made Available is zero for the concerned quarter-hour;
 - If the total volume submitted is higher than the FCR Obligation, the FCR Energy Bids will not be validated, leading to a situation similar to the case of no submission of FCR Energy Bid for the concerned quarter-hour.

Part II - Specific Conditions

- II.10.12 If, for one quarter-hour, the FCR Made Available is lower than the corresponding FCR Obligation for the concerned quarter-hour, ELIA will apply incentives as foreseen in Art.II.16.1
- II.10.13 In case a FCR Energy Bid is impacted by a Forced Outage, leading to a non-respect of the FCR Obligation, and pursuant to Art. II.10.8, after notification to ELIA of the Forced Outage, the BSP disposes of 4 hours to reconstruct the impacted FCR Obligation. Beyond this delay, ELIA applies incentives in accordance with Art.II.16.1.

TITLE 5: ACTIVATION**ART. II.11 ACTIVATION**

- II.11.1 In case of a Frequency Deviation during a CCTU for which the BSP has a FCR Obligation, the BSP will automatically activate the FCR Requested as defined in Annex 11.
- II.11.2 In accordance with Art. 154(7) of the SOGL and with Art. 3(2)(a) of the Additional Properties, the activation of FCR Power cannot be artificially delayed and must begin as soon as possible but no later than 2 seconds after the start of a Frequency Deviation.
- II.11.3 If the BSP has successfully provided the technical evidence to substantiate the deviation of Art. II.11.2, in accordance with Art. 7.4, the activation of FCR Power after a Frequency Deviation may begin later than 2 seconds.
- II.11.4 In accordance with Art. 154 of the SOGL and Art. 3(2)(b) of the Additional Properties, the FCR Power to be activated in reaction to a Frequency Deviation rises at least linearly to reach 50 % of FCR Requested after 15 seconds and 100 % after 30 seconds, measured from the start of the Frequency Deviation.
- II.11.5 If the BSP successfully requested the derogation to Art. II.11.4 in accordance with Art. 7.5, the FCR Power to be activated in reaction to a Frequency Deviation must not rise linearly to reach 50% of FCR Requested after 15 seconds measured from the start of the Frequency Deviation. In any case, at least 50% of the FCR Requested shall be delivered after 15 seconds.
- II.11.6 During Normal State, if the BSP holds a FCR Obligation for a certain CCTU, the BSP provides continuously the FCR Requested, as long as the Frequency Deviation persists, in accordance with Art. 156(9) of the SOGL.
- II.11.7 If a continuous Frequency Deviation above +/- 50 mHz includes the triggering of Alert State, a minimum activation period of 25 minutes applies until the entry into force of the common minimum activation period⁵, in accordance with Art. 156(10) of the SOGL. For the avoidance of doubt, a minimum activation period of 25 minutes corresponds to the obligation for the BSP to ensure the availability of an energy content of the reservoir equivalent to a full activation of the FCR Obligation during a period of 25 minutes from the moment the Frequency Deviation first exceeds the +/-50 mHz limit.
- II.11.8 During Alert State, without prejudice to Art. II.11.7, if the conditions specified in Annex 11.B are met, the BSP shall provide the FCR Service in Reserve Mode as specified in Annex 11.B.
- II.11.9 In accordance with Art. 156(13)(b) of SOGL, the BSP ensures the recovery of the energy reservoirs as soon as possible and at the latest within 2 hours after the end of the Alert State for any Delivery Point with Limited Energy Reservoir participating to the provision of the FCR Service.

⁵ A minimum time of FCR full activation may, if relevant, be defined in the all CE TSOs' proposal for additional properties of FCR, in accordance with Article 154(2) of the SOGL, and after its approval by the relevant regulatory authorities.

ART. II.12 EXCHANGE OF INFORMATION

- II.12.1 The exchange of information for the performance of the BSP Contract FCR is performed through real-time communication and online communication, as described in Annex 11.E and Annex 12.G.
- II.12.2 The BSP agrees that measurement data from ELIA constitute the basis for the availability control, in accordance with Art. II.13, and for the activation control, in accordance with Art. II.14.
- II.12.3 For Delivery Points for which ELIA does not have its own measurements, delivery of the FCR Service may be monitored based on Private Measurements that respects the measurement requirements as described in Annex 3.
- II.12.4 In case a dispute arises over the measurements taken by ELIA these may be compared with those made by the BSP provided both measurements have comparable time stamps. If the BSP observes a significant error or difference between both series of measurements, he must inform ELIA hereof within the deadline specified in Art. II.17.5. In case of discrepancies between data of ELIA and the BSP, the ELIA data prevail unless the BSP can prove that his data are correct.
- II.12.5 ELIA requires individual power measurements of all Delivery Points with the exception of Virtual Delivery points. For Virtual Delivery Points, the BSP can send to ELIA aggregated measurements. Nevertheless ELIA always has the right to request ex-post the individual Delivery Point data from the BSP to verify the consistency of the aggregation done by the BSP.
- II.12.6 For Delivery Points with Limited Energy Reservoir the BSP communicates to ELIA the available margin (in MWh) via his real-time connection as described in Annex 11.E.

TITLE 6: AVAILABILITY AND ACTIVATION CONTROL**ART. II.13 AVAILABILITY CONTROL**

- II.13.1 The availability of the FCR Capacity will be monitored by ELIA on the basis of two different tests being a capacity availability test and an energy availability test. Both availability tests are described in Annex 12.B.
- II.13.2 Capacity availability tests focus on testing the FCR Capacity Requested. In other words, the goal is not to test the ramping behaviour or the follow-up of the Frequency. Energy availability tests focus on testing energy requirements, in accordance with Art. II.11.7.
- II.13.3 An availability test is performed on one or more FCR Energy Bid(s). Elia is not obliged to test the total volume of the FCR Energy Bid but may decide to test only part of it.
- II.13.4 After the performance of an energy availability test on an FCR Energy Bid which contains a Delivery Point with Limited Energy Reservoir, the BSP has the right to reconstitute its energy reservoir over a maximal duration of 2 hours after the end of the energy availability test. ELIA will not consider this interval of 2 hours for its activation or availability controls of the concerned FCR Energy Bid. In case a Delivery Point is registered to deliver both FCR and aFRR Service and is defined as a Delivery Point with Limited Energy Reservoir in accordance with article II.1 of the T&C BSP aFRR, it is considered a Delivery Point with Limited Energy Reservoir in this context.
- II.13.5 An availability test can be triggered at any moment by ELIA in accordance with the rules set forth in Annex 12.C.
- II.13.6 Availability tests are not remunerated by ELIA.
- II.13.7 ELIA considers an availability test as failed if at least one of the following conditions is satisfied:
- The FCR Supplied, as calculated in Annex 12.D, is inferior to the FCR Capacity Requested for more than 15% of the duration of the test;
 - The BSP has failed to execute the communications foreseen in Annex 12.G (without fault by ELIA);
- II.13.8 ELIA checks every Month M the availability test(s) performed during Month M-2, as described in Annex 12.B and informs the BSP via a report as foreseen in Art. II.17.10.
- II.13.9 In case of non-compliance of an availability test, in accordance with Art.II.13.7, incentives apply as foreseen in Art.II.16.4

ART. II.14 ACTIVATION CONTROL

- II.14.1 ELIA checks every Month M that the FCR Supplied by the BSP, during Month M-2, is compliant in accordance with Art. II.14.3;
- II.14.2 The activation control is performed by calculating the difference between the FCR Requested and the FCR Supplied for a maximum of 6 Frequency Variations for the month, and in the same way a maximum of 2 Frequency Variations per CCTU.
- II.14.3 An activation for a Frequency Variation is considered as non-compliant by ELIA if the FCR Supplied, determined in accordance with Annex 13.A, is inferior to the FCR Requested for the analyzed Frequency Variation, as determined in Annex 13.B.
- II.14.4 ELIA informs the BSP via a report as foreseen in Art. II.17.10. This report includes, for each analyzed Frequency Variation, the technical characteristics⁶ of the Frequency Variation.
- II.14.5 If an activation is deemed as non-compliant, in accordance with Art. II.14.1, incentives apply as foreseen in Art. II.16.6

⁶ i.e. start time of the Frequency Variation, frequency time diagram during the minutes before the Frequency Variation, and frequency time diagram during the minutes after the Frequency Variation.

TITLE 7: REMUNERATION AND INCENTIVES

ART. II.15 REMUNERATION

- II.15.1 The remuneration of the FCR Service consists only of remuneration for the FCR Awarded.
- II.15.2 The remuneration for the FCR Awarded for a given Month is the sum of the individual remuneration of each awarded FCR Capacity Bid. The remuneration of a FCR Capacity Bid is described in Annex 8.F

ART. II.16 INCENTIVES⁷

Availability control incentives

- II.16.1 If ELIA observes, in accordance with Art. II.10.10 and II.10.11, that the FCR Made Available is lower than the FCR Obligation for a quarter-hour, ELIA applies incentives, determined in accordance with Annex 14.A.
- II.16.2 If ELIA observes, in accordance with Art. II.13.7, that an availability test has failed, ELIA applies incentives as foreseen in Art. II.16.4 and II.16.5.
- II.16.3 If ELIA performs more than one capacity availability test within the same Month, ELIA will not apply the financial incentive twice but only consider the highest calculated incentive.
- II.16.4 A financial incentive applies on any FCR Missing MW or FCR Missing Time of the considered Month. ELIA establishes, for each capacity availability test of the Month, the number of FCR Missing MW based on method described in Annex 12.E. For each energy availability test the FCR Missing Time is calculated based on the method described in Annex 12.F. The calculation of the incentive is detailed in Annex 14.B and 13.C.
- II.16.5 In case of two consecutive failed capacity availability test, ELIA adapts the FCR_{max} as defined in Annex 14.D. Elia notifies the modification to the BSP by e-mail to the contractual responsible listed in Annex 16. The date of entry into force (no later than 5 Working Days after the notification by ELIA) for the updated FCR_{max} is communicated altogether with the updated value. A new prequalification test, pursuant to Art. II.7, has to be performed to increase again the FCR_{max}.

Activation control incentives

- II.16.6 In case ELIA establishes that the BSP has failed to deliver the FCR Requested, pursuant to Art II.14.3, a financial incentive is applied as defined in Annex 14.D.
- II.16.7 All Delivery Points common to at least 3 non-compliant activations for Frequency Variations, as per Art. II.14.3, over the last 6 months (i.e. from M-8 to M-2), will be suspended from the FCR Service for 30 calendar Days. The list of Delivery Points concerned will be notified to the BSP by e-mail addressed to the contractual responsible designated in Annex 16. The suspension will enter into force 5 Working Days after notification by ELIA. At the end of the suspension period, the concerned Delivery Points are automatically included again in the FCR Service.

Forced Outage

- II.16.8 In case a Forced Outage of one or more Delivery Points occur, impacting the FCR Made Available, ELIA applies incentives foreseen under Art. II.16.1 as of expiry of a 4 hour reconstitution time.

Cap on financial incentives

- II.16.9 The sum of financial incentives under Art. II.16.1, II.16.4 and II.16.6 will be subject to a monthly cap, without prejudice to any liability on the part of the BSP for non-fulfillment of his obligations in accordance with Art. I.6 of the General Conditions. The incentive cap is determined as per method detailed in Annex 14.F.

⁷ The reference to "penalty" made in Art. I.6 of the General Conditions is to be considered as a reference to "incentive".

TITLE 8: INVOICING**ART. II.17 INVOICING AND PAYMENT**

- II.17.1 The Parties agree that the BSP-invoices and BSP-credit notes will be issued by Elia in the name and on behalf of the BSP in accordance with the applicable rules regarding self-billing⁸.
- II.17.2 The provisions of Art. I.5 also apply in the context of such a self-billing process, except where otherwise provided for in the present Article.
- II.17.3 Annex 15 includes the appropriation structure to be mentioned by the BSP.

Remuneration

- II.17.4 At the latest by the end of each calendar Month M, ELIA presents to the BSP, in a joint validation platform⁹:
- a report related to the awarded capacity to the BSP in month M-1. This report indicates, amongst others, all remunerations for FCR Awarded for Month M-1, calculated as foreseen in Art. II.15.2, showing the method of calculation and all data on which the calculation is based.
- Each time a report is submitted by Elia on the joint validation platform, the BSP is simultaneously notified of it.
- II.17.5 The BSP shall either approve or reject each of the reports stipulated in Art.II.17.4 on the joint validation platform within 25 calendar Days starting from the Day following the submission by ELIA of the respective report on such joint validation platform. Without reaction from the BSP within aforementioned deadline, the report will be considered as approved implicitly by the BSP.
- II.17.6 Disputes from the BSP regarding the reports on remunerations and incentives stipulated in Art. II.17.4 must be reported by rejecting the reports on the joint validation platform as stipulated in Art. II.17.5, including a written motivation justifying why the report is rejected, within 25 calendar Days starting from the Day following the submission by ELIA of the respective report on such joint validation platform. In such a case, the Parties shall enter into negotiations with each other with a view to reach an agreement.

⁸ Article 53, §2 of the VAT Code and the Circular of December 13, 2013 (AAFisc No. 53/2013).

⁹ In case the joint validation platform is temporarily inaccessible, either by Elia or by the BSP, ELIA can provide the reports to the BSP via e-mail, and the BSP can report approve or reject the reports via e-mail.

Part II - Specific Conditions

- II.17.7 If no agreement can be reached between the BSP and ELIA within 60 calendar Days starting from the Day following the rejection of the report by the BSP:
- ELIA, when drawing up the invoices and credit notes as specified in Article II.17.8 shall – in deviation from and without applying Art. I.5.2 – take into account the remunerations and incentives of the corresponding Month calculated by ELIA, as per II.17.6; and
 - ELIA shall notify the CREG of the situation, including contact details of the BSP, a summary of the context (including previous steps and timings) and the disputed amount, and a summary why no agreement could have been reached after this time; and
 - the Parties shall continue their negotiations with a view to reaching an amicable arrangement and, after concluding their agreement, settle this invoice and/or credit note ex-post; and
 - if no amicable arrangement is reached within thirty (30) calendar Days starting from the Day following the receipt of the invoice and/or credit note as mentioned in the first bullet of this paragraph, the dispute settlement procedure set out in Art. I.13 of the General Conditions shall apply.
- II.17.8 Without prejudice to Art. I.5 of the General Conditions, ELIA shall send to the BSP¹⁰, within 10 days starting from the Day following the approval, explicit or implicit, of the corresponding report of Month M-1, or, as the case may be, following the end of the 60 calendar Days period starting from the Day following the rejection of the corresponding report of Month M-1 by the BSP:
- a BSP-invoice for the remuneration for the FCR Awarded for the Month M-1, calculated as described in Art. II.15.2 and reported in accordance with II.17.4.
- II.17.9 In deviation from I.5.2 (first sentence) of the General Conditions, payments shall be made within 15 calendar Days following the Day on which the invoice is received (this is the due date of the invoice). In the context of self-billing, BSP-invoices and BSP-credit notes shall be deemed to be received by ELIA on the Day following the Day on which ELIA issues them. The invoiced Party shall pay the invoicing Party by direct transfer to the stated bank account. Within the scope of this Article, an invoice will be considered received on the third Working Day following the date when the invoice was sent (in case of an electronic invoice the date the invoice was submitted in the electronic system or sent by email will apply).

Incentives

- II.17.10 At the latest by the end of each calendar Month, ELIA presents to the BSP, in a joint validation platform or other channel¹¹:
- a report related to the availability control of the FCR Service provided by the BSP in Month M-2, as foreseen in Art.II.13.8. This report indicates, amongst others, all incentives for Month M-2 as calculated by ELIA in accordance with Art. II.16.1 and II.16.4, showing the method of calculation and all data on which the calculation is based.
 - a report related to the activation control of the FCR Service provided by the BSP in Month M-2, as foreseen in Art. II.14.4. This report indicates, amongst others, all

¹⁰ From 1 January 2026, only structured electronic invoices will be sent and received via the Peppol network. To this end, the Co-Contracting Party will need to have an access point to an exchange platform that meets the Peppol standard. For such structured electronic invoice, the date of uploading on such platform shall be considered as date of sending.

¹¹ In that case, ELIA will send to the BSP's settlement contact, as listed in Annex 17, an e-mail containing at least the minimal set of data enabling the BSP to check ELIA's proposal.

Part II - Specific Conditions

incentives for Month M-2 as calculated by ELIA in accordance with Art. II.16.6, showing the method of calculation and all data on which the calculation is based.

- II.17.11 Disputes from the BSP regarding the report and incentives stipulated in Art. II.17.10 must be reported within 25 calendar Days starting from the Day following ELIA submission of the respective report. In such a case, the Parties shall enter into negotiations with each other with a view to reach an agreement, in accordance with Art. I.13 of the General Conditions.
- II.17.12 If no agreement can be reached:
- the BSP, when drawing up its credit note for Month M as specified in Art. II.17.13, shall take into account of the incentives calculated by ELIA;
 - the Parties shall continue their negotiations with a view to reaching an amicable arrangement and, after concluding their agreement, settle this invoice ex-post;
 - if no amicable arrangement is reached, the dispute settlement procedure set out in Art. I.13 of the General Conditions shall apply.
- II.17.13 Without prejudice to Art. I.5 of the General Conditions, the BSP shall send to ELIA¹⁰, at the latest by the 25th of each calendar Month M :
- As the case may be, a credit note related to the availability control incentives for the Month M-3, as calculated by ELIA under Art. II.16.1 and II.16.4 and reported in accordance with Art. II.17.10;
 - As the case may be, a credit note related to the activation control incentives for the Month M-3, as calculated by ELIA under Art. II.16.6 and reported in accordance with Art. II.17.10;
- II.17.14 ELIA shall either approve or reject the credit notes within 5 Working Days after reception.

TITLE 9: OTHER DISPOSITIONS

ART. II.18 CONTACT PERSONS

- II.18.1 In accordance with Art. I.9 of the General Conditions, both parties keep their contact details, as included in Annex 16, up to date throughout the validity of the BSP Contract FCR via the ELIA's digital customer portal or via e-mail to the contractual responsible as mentioned in Annex 16.

ART. II.19 DURATION

- II.19.1 This BSP Contract FCR is concluded for a fixed duration and will terminate on 31/12/2026.

Part II - Specific Conditions

Drawn up in Brussels in two originals, of which each Party concerned acknowledges having received one. The official version has been drawn up in Dutch and French, without one version taking precedence over the other; the English version is solely for information purposes.

ELIA TRANSMISSION BELGIUM N.V./S.A., represented by:

[•]

[•]

[•]

[•]

Date:

Date:

[ServiceProvider], represented by:

[•]

[•]

[•]

[•]

Date:

Date:

PART III - ANNEXES

ANNEX 1. PROCEDURE FOR BSP ACCEPTANCE

This annex describes all the conditions to be fulfilled by the BSP in order to participate to the FCR Service.

1.A OPEN QUALIFICATION PROCEDURE

Prior to signature of the BSP Contract FCR, a candidate should apply to become a qualified balancing service provider. The conditions to become a qualified balancing service provider are listed hereunder:

- Provision of a declaration (referred to as “sworn statement”) in which the candidate declares the fulfilment of the obligations related to payment of social security contributions in accordance with the legal provisions, fulfilment of the obligations related to payment of taxes in accordance with the legal provisions, and situation of non-bankruptcy.
- Proof of a sound financial and economic situation of the candidate.

A candidate can apply by submitting a completed application form and the required documents, for the applicable service to ELIA. The application form and the template for the sworn statement can be downloaded on ELIA website or requested by e-mail to the contractual responsible as mentioned in Annex 15.

The application has to be submitted to ELIA at least one month before the date of signature of the BSP Contract FCR.

Following the reception of the application, ELIA disposes of 8 weeks to approve (or reject) it and notify the approval (or reasons for rejection) to the BSP by e-mail to the contractual responsible, as per Annex 16. In case ELIA rejects the application, a sound justification of the rejection as well as a request for additional information are provided by ELIA to the BSP. From ELIA’s request, the BSP disposes of 4 weeks to come back to ELIA with the requested additional information. Beyond this delay, the application is considered by ELIA as withdrawn.

Any approval of an application, any refusal of an application without a request for additional information from the BSP, and any refusal due to a deemed withdrawal of the application, will be communicated by ELIA to the CREG, including the full justification provided to the BSP.

ANNEX 2. PROCEDURE FOR DELIVERY POINT ACCEPTANCE

This annex describes all the conditions to be fulfilled by a Delivery Point in order to participate to the FCR Service.

2.A PRIVATE MEASUREMENT TECHNICAL INFO CHECKLIST

All Delivery Points using Private Measurement must be able to provide a valid Private Measurement Technical Info Checklist.

The aim of this Private Measurement Technical Info Checklist is to prove that the Private Measurement Device meets the measurement requirements imposed by ELIA in Annex 3, and give necessary information to ELIA to perform its verifications on measurement requirements.

The Private Measurement Technical Info Checklist can be found on ELIA website or can be requested via email to the contractual responsible as mentioned in Annex 16.

Provided information must comprise at least of:

- Single-line diagram on which the Private Measurement Device is located
- Technical information of the Private Measurement Device(s) (accuracy class, etc.)
- If applicable, the equation used to determine the correct measurement based on several measurement devices situated at or downstream of the Access Point.

Per new Private Measurement Device, ELIA must receive a proof of its compliance at least 10 Working Days before the Private Measurement Device commissioning test as foreseen in Annex 2.B.

2.B PRIVATE MEASUREMENT COMMISSIONING TEST

The BSP and Elia will verify the functionality of the Private Measurement by comparing the DP_{measured} for one Day of measurement data received by the Elia via the real time communication in accordance to Annex 11.E with the measurement data of the BSP. In case of deviations between both data sets the test is considered as failed and the Private Measurement is not accepted.

ELIA and the BSP will agree on a date for the Private Measurement commissioning test to be performed.

The general liability regime organized by Art. I.6 of the General Conditions is applicable during the test.

In case the correct measurement is determined using an equation based on several measurement devices situated at or downstream of the Access Point:

- the BSP informs ELIA immediately in case of a change in topology behind the Access Point that impacts the equation;
- ELIA has the right to request ex-post the data of the individual measurement devices from the BSP to verify the consistency of the calculation done by the BSP.

2.C TEMPLATE FOR GRID USER DECLARATION FOR DP_{PG}

In accordance with Art II.3.6, ELIA must receive the proof that the Grid User has signed without reserve the Grid User Declaration. A single Grid User Declaration can include one or a list of Delivery Points related to the concerned Grid User. The Grid User Declaration has to contain at least the following clauses:

- The present Grid User Declaration only applies for the Delivery Points listed in Table 1.
- The Grid User hereby acknowledges that all given information in this Grid User Declaration is true and accurate.
- The Grid User hereby acknowledges that he will participate to the FCR Service only with one party (being the BSP) at the same time and that the list of Delivery Point(s) in Table 1 is submitted for only one party (being the BSP) at the same time.
- The Grid User confirms to Elia that his commitment to provide FCR Service as stipulated in the BSP Contract FCR does not breach existing contracts with third parties (with whom the Grid User has a contractual or regulated relationship, such as, but not limited to, the Supplier of the Grid User).
- The Grid User hereby gives permission to the BSP to offer the FCR Service to ELIA as described in the BSP Contract FCR, from DD/MM/YYYY to DD/MM/YYYY.
- The Grid User acknowledges that the present document is valid for each Delivery Point listed in table 1 until either respective expiry date of the Grid User Declaration or the submission by another party of a new Grid User declaration, for one (or more) of the Delivery Point(s) listed in table 1, signed and validated by the Grid User. The present Grid User Declaration remains valid until its expiry date for all Delivery Points listed in Table 1 not concerned by the aforementioned new Grid User Declaration.
- The Grid User hereby gives explicit permission to send to ELIA all data relevant to the provision of the FCR Service of the concerned Delivery Points. The Grid User confirms that he has designated a market party responsible for the data exchange.
- Details of the concerned Delivery Point(s):

Delivery Point name	Delivery Point identification (EAN)	DP _{FCR,max} [MW]

Table 1 - List of Delivery Point(s) concerned

2.D ENERGY MANAGEMENT STRATEGY

A BSP needs to present a documented Energy Management Strategy with which he aims to prove the ability of each Delivery Point with Limited Energy Reservoir to comply with requirements for provision of the FCR Service as these are stipulated in Art. II.11. In case a Delivery Point is registered to deliver both FCR and aFRR Service and is defined as a Delivery Point with Limited Energy Reservoir in accordance with article II.1 of the T&C BSP aFRR, it is considered a Delivery Point with Limited Energy Reservoir in this context and must be included in the Energy Management Strategy.

To this purpose, the BSP needs to demonstrate that his proposed Energy Management Strategy has no impact on a third party (e.g. on the BRP) and does not use the imbalance market as its only charging strategy.

The BSP must provide Elia with a description of the Energy Management Strategy and a demonstration of the effectiveness of the EMS for delivering the volumes of FCR Capacity the BSP intends to offer and deliver using the Delivery Point with Limited Energy Reservoir. The description of the EMS for one or more Delivery Point with Limited Energy Reservoir contains at least the following information:

- The identification and characteristics of the Delivery Point with Limited Energy Reservoir for which the EMS is submitted.
- An indication of whether or not the submitted EMS is intended to replace an earlier validated EMS.
- An overview of the FCR Capacity the BSP intends to deliver using the Delivery Point with Limited Energy Reservoir and, if applicable, the aFRR Capacity and/or mFRR Capacity, the BSP intends to deliver over the same period using the Delivery Point with Limited Energy Reservoir.
- If applicable, an overview of the intended use of the Delivery Point with Limited Energy Reservoir for providing other services in moments for which the BSP has an FCR Awarded different from zero for which it intends to use the Delivery Point with Limited Energy Reservoir.
- An exhaustive description of the energy management strategy.

To this end, the BSP must use the “EMS description” template published on the Elia website, which contains more information related to the specific information to be provided.

To enable a simulation of the Energy Management Strategy based on historical data, Elia makes available a dataset containing data that should be considered by the BSP and a template with the data of the simulation to be provided by the BSP. The simulation must be carried out with the most recent data made available by Elia on its website and the template should be used to provide the requested data.

The Energy Management Strategy may be rejected by Elia when:

- There is missing information and/or data in the description and/or demonstration of the effectiveness of the Energy Management Strategy.
- The application of the proposed Energy Management Strategy violates one of the requirements of this T&C BSP FCR and/or would lead to the violation of any of the terms and conditions developed in accordance with Article 5 of the EBGL.
- The demonstration of the effectiveness provides evidence that the requirements for provision of the FCR Service, as stipulated in Art. II.11, or other contracted services are not assured.

In addition, an Energy Management Strategy that has been validated by Elia can be rejected in case potential issues related to the application of the Energy Management Strategy would be observed. Potential issues could be, among others, that the Delivery Point with Limited Energy Reservoir is not operated in line with the validated Energy Management Strategy and/or that the Energy Management Strategy does not enable assuring that the requirements for provision of the FCR Service, as stipulated in Art. II.11, and/or other contracted services. In case Elia observes such issues, Elia will request a sound justification to the

Annex 2 Procedure for Delivery Point Acceptance

BSP. In case Elia would not receive a sound justification within one month following its request and the BSP would not have submitted a new Energy Management Strategy that addresses Elia's concerns, Elia may reject the EMS for the concerned Delivery Point with Limited Energy Reservoir. The CREG will be informed by ELIA of any acceptance or final rejection of an Energy Management Strategy.

A detailed description of the required information for the Energy Management Strategy can be found in the document "Energy Management Strategy Requirements" which is published on the ELIA website and is available on demand by e-mail to the contractual responsible as mentioned in Annex 16.

2.E SYSTEM SPLIT COUNTERMEASURES REQUIREMENTS

A BSP needs to present documented System Split countermeasures with which he aims to prove the ability of each Delivery Point to comply with requirements for provision of the FCR Service as these are stipulated in Art. II.11 in case of System Split.

To this purpose, the BSP needs to demonstrate that his proposed System Split countermeasures are effective. The BSP must provide Elia with a description of their FCR Controller. This description must include:

- The type of control used by the BSP: centralized or decentralized.
- In case of centralized control.
 - The observation function.
 - A description of the countermeasures taken by the BSP in case of system split or errors in the centralized control.

The System Split Countermeasures will be rejected by Elia when it shows evidence that the implemented observation function does not detect errors in the central control and/or the BSP does not take appropriate countermeasures to assure the provision of the FCR service as stipulated in Art. II.11 in case of system split.

A detailed description of the required information for the system split countermeasures can be found in the document "FCR System Split Countermeasures Requirements" which is published on the ELIA website and is available on demand by e-mail to the contractual responsible as mentioned in Annex 16.

2.F CDSO DECLARATION

The BSP sends this declaration, completed and signed by the CDSO, by e-mail to the contractual responsible as mentioned in Annex 17, with a copy to the CDSO. Any Delivery Point part of a CDS can only be integrated into the FCR Service upon signature of this declaration.

Declaration by a CDSO

With this declaration, [company name], a company incorporated under [nationality] law, enterprise number [number], with registered office at [address], validly represented by Mr/Ms [name] and Mr/Ms [name], respectively in their quality of [function] and [function], identified for the purposes hereof as "the CDSO", hereby grants permission for the Delivery Point(s) identified below, which is(are) part of its CDS with power measured by CDSO meters, to participate, for the period DD/MM/YYYY to DD/MM/YYYY, in the FCR Service organized by ELIA, as defined in the BSP Contract FCR,

In the knowledge that the power measured at this Delivery Point under specific circumstances and under specific conditions can be reduced and/or interrupted in order to supply FCR Service,

In the knowledge that this Delivery Point corresponds fully or partly with the CDS Access Point of [company name], a company incorporated under [nationality] law, enterprise number [number], with registered office at [address], recognized as a User of the CDS that is managed by the CDSO,

Annex 2 Procedure for Delivery Point Acceptance

And

Undertakes to conclude a cooperation agreement with ELIA in accordance with the model which can be found on ELIA website or can be obtained upon request to ELIA and which describes the conditions for exchanging metering data between ELIA and the CDSO, and to do so prior to the commissioning of the Delivery Point as under the BSP Contract FCR.

And

Informs ELIA whether there is a risk of full or partial load transfer from the Delivery Point that is part of the CDS, as detailed below:

Details of the Delivery Point(s):

CDS User	CDS Access Point	Delivery Point Identification (EAN)

Table 1: Details of the Delivery Point(s) in a CDSO declaration

Risk of full or partial load transfer (to be described by the CDSO):

.....

And

Confirms that it has obtained express permission from the CDS User to send to ELIA the confidential information, including metering data (quarter-hourly values of active power) for the above-identified Delivery Point and the corresponding CDS Access Point, since such communication is necessary for the correct invoicing of the FCR Service with respect to the BSP, which to that end makes use of the CDS User Delivery Point.

Done in [location], on DD/MM/YYYY

Signature of the CDSO:

Name:

Function:

Annex 2 Procedure for Delivery Point Acceptance

ANNEX 3. MEASUREMENT REQUIREMENTS

All Delivery Points must have one Measurement Device installed that meets the following minimum requirements.

3.A GENERAL MEASUREMENT REQUIREMENTS FOR ALL DELIVERY POINTS

A Measurement Device that can provide 2 seconds measurement data to measure Injection or Offtake of the Delivery Point concerned.

The Measurement Device needs to have a precision of 1% or better for the whole measurement chain (current transformers, power measurement)¹².

In case the Measurement Device for a Delivery Point does not correspond to the requested precision, ELIA will determine an E_{max} factor for the Delivery Point as defined in Annex 7.

A minimal measurement availability of 95% is required.

3.B SPECIFIC MEASUREMENT REQUIREMENTS FOR DELIVERY POINTS ON THE PUBLIC DISTRIBUTION GRID

For Delivery Points connected to the Public Distribution Grid, the BSP should refer to the modalities as described in the Grid Code applicable for the concerned DSO.

3.C FREQUENCY MEASUREMENTS

The frequency measurements must be local, meaning that a frequency meter must be installed at the site of each Delivery Point. This rule is not applicable in case of Virtual Delivery Points and Technical Units used as part of the Energy Management Strategy which are not performing the FCR Service.

In case of a Virtual Delivery Point, one frequency meter for all Technical Units part of the Virtual Delivery point suffices. The BSP may decide on where to install the frequency meter of the Virtual Delivery Point. If a BSP provides the FCR Service with several Virtual Delivery Points, a different frequency meter must be installed for each Virtual Delivery Point for redundancy reasons.
The accuracy of the frequency meter must be at least 10 mHz.

3.D REQUEST FOR POWER MEASUREMENT

The BSP may also request to receive from ELIA power measurements through its real-time connection (in case these are measured by ELIA) for Delivery Points validly contained in Annex 4. The BSP and ELIA will sign an addendum concerning this communication.

¹² or a maximum precision margin of 100kW

Annex 4 List of Delivery Points

4.C LIST OF DELIVERY POINTS DPPG

Refer to sheet 3 of the excel file.

4.C List of delivery points DP _{PG}						
Delivery Point name	Delivery point EAN	Access Point EAN (if different)	DP_FCR _{max}	DP_FCR _{cb}	Precision Class (expressed in % precision)	Last prequalification test (dd/mm/yyyy)

ANNEX 5. COMMUNICATION TEST

- In accordance with dispositions of Art. II.5, ELIA will check the communication channels of the BSP.
- The BSP should comply with the real-time communication requirements as described in Annex 11.E.
- The BSP must be able to receive and interpret the signals, as defined in Annex 12.G, for the activation of the availability test of the FCR Service.
- At the latest 10 Working Days after receipt of the exact start time of the communication test, ELIA will provide the results of the communication test by e-mail to the contractual responsible of the BSP, as per Annex 16.
- In case that the requirements are not fulfilled, ELIA and the BSP will make their best effort to identify the source of the failure and the BSP is expected to solve the source of the failure.

ANNEX 6. RESERVE MODE CONTROL

A BSP that aims to prequalify a Providing Group with Reserve Mode implemented, must demonstrate their ability to provide the FCR Service in Reserve Mode to comply with the requirements for provision of the FCR Service as these are stipulated in Art. II.11.

To this purpose, the BSP needs to present a simulation of their FCR delivery in a frequency scenario in covering both Normal Mode and Reserve Mode FCR Delivery and the transition period between the two operating modes. This Simulation must be carried out using the template. The simulation must be as close as possible to the actual behavior during operations.

The template provides the following data to the BSP:

- Time stamp
- Measured frequency deviation in Hz
- Initial SoC (State of Charge) value

The BSP must provide Elia with the following data:

- Zero-mean frequency deviation
- Decisive frequency deviation
- FCR activation with measured frequency deviation
- FCR activation at zero-mean frequency deviation
- FCR activation with decisive frequency deviation
- Alert State
- Critical SOC state
- Transition function
- SoC

The simulation will be rejected by Elia if the simulated FCR delivery does not comply with the requirements for provision of the FCR Service as these are stipulated in Art. II.11.

The required template with detailed information is made available in the file "FCR Reserve Mode Simulation Template" which is published on the ELIA website and is available on demand by e-mail to the contractual responsible as mentioned in Annex 16.

ANNEX 7. PREQUALIFICATION TEST

The outcome of the prequalification test, in accordance with Art. II.7, determines the FCR_{max} that can be offered by the BSP in capacity auctions.

The prequalification test is mandatory:

- before first participation of the BSP to capacity auctions;
- to update the FCR_{max} ;

The FCR_{max} is determined by summing the results of all prequalification tests.

7.A ORGANIZATION

The prequalification test is scheduled with ELIA upon request of the BSP. The BSP sends the request by e-mail to the contractual responsible, as provided in Annex 16. The request is performed by the BSP based on the request form for prequalification test published on the ELIA website or available on demand by e-mail to the contractual responsible as mentioned in Annex 16.

The BSP and ELIA agree on a time window of 24 hours during which the prequalification test can be organized. ELIA will proceed to the prequalification test no later than 10 Working Days after the reception of the BSP request. The BSP and ELIA also agree on an approximative start time to launch the prequalification test. Within 2 Working Days after performance of the prequalification test, the BSP communicates to ELIA, by e-mail to the contractual responsible as mentioned in Annex 16, the exact start time of the prequalification test.

A prequalification test can only be requested by the BSP when the Delivery Point(s) concerned has(have) been duly added to the Pool of the BSP, pursuant to Art. II.3 and the communication test, as per Art. II.5, and if applicable the Reserve Mode Control as per Art. II.6, succeeded.

At the latest 10 Working Days after receipt of the exact start time of the prequalification test, ELIA will provide the results of the prequalification test by e-mail to the contractual responsible of the BSP, as per Annex 16.

In order to update the FCR_{max} for the next auction, the result of prequalification test should be known and Annex 4 should be updated accordingly, as per Art. II.3, at least 5 Working Days before the first capacity auction for which the new value applies.

Annex 7 Prequalification test

7.B SPECIFICATIONS OF A PREQUALIFICATION TEST

The Providing Group for prequalification test is determined by the BSP in accordance with Art. II.7.7.

The prequalification test comprises two phases separated by a period of up to 2 hours, as shown in Figure 1:

- a follow-up of a synthetic frequency profile, which simulates 4 consecutive Frequency Deviations of 50 mHz, first in the upward direction and then in the downward direction.
- a 4-hour real-time follow-up of the Frequency.

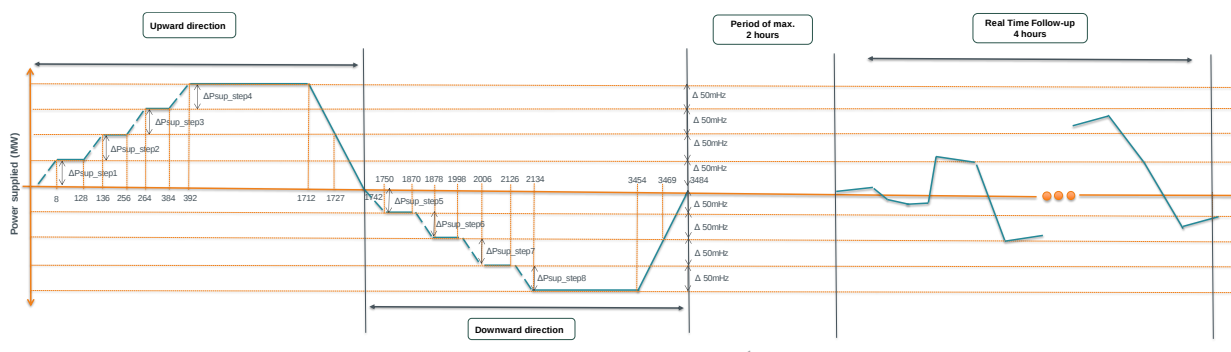


Figure 1: Power profile of the prequalification test

The specifications of these 2 phases are detailed hereunder:

Phase 1: the synthetic frequency profile in the upward (respectively downward) direction is composed of 4 steps of a 50mHz Frequency Deviation upward (respectively downward)):

- For each frequency step of 50mHz, the corresponding FCR Power to be delivered must be reach in 12,5 seconds (7,5 seconds of required activation time as per Art. II.11.4 and 5 seconds of tolerance). This FCR Power should then be maintained for 2 minutes.
- After the fourth frequency step, the FCR Power must be maintained for 22 minutes.
- Right after this period of 22 minutes, the BSP disposes of 30 seconds to ramp down until the FCR Power delivered equals zero.

Phase 2: real-time follow-up of the Frequency for 4 consecutive hours:

- The follow-up of the Frequency starts right after phase 1.
- The FCR Power that must be supplied is equal to the FCR Requested, as described in Annex 11.A.

7.C DETERMINATION OF THE FCR_{MAX} OF A PREQUALIFICATION TEST

Result of synthetic frequency profile

For the purposes of the test, ELIA will sum the $DP_{measured}(ts)$ of all Delivery Points in the Providing Group:

$$P_{meas}(ts) = \sum_{All\ DP \in\ Providing\ Group} DP_{measured}(ts)$$

The baseline for the prequalification test is defined by taking the average $P_{meas}(ts)$ over the 20 seconds preceding the beginning of the test (TS_0-19 to TS_0):

$$baseline = \frac{1}{20} * \sum_{ts=TS_0-19}^{ts=TS_0} P_{meas}(ts)$$

For each frequency step of 50 mHz, ELIA calculates the FCR Power supplied (ts), based on a 10 second average value, as follows:

In the upward direction,

$$FCR\ Power\ supplied\ (10s\ window) = \max \left\{ baseline - AV_{P_{meas}}(10s\ window); 0 \right\}$$

In the downward direction,

$$FCR\ Power\ supplied\ (10s\ window) = \max \left\{ AV_{P_{meas}}(10s\ window) - baseline; 0 \right\}$$

$$AV_{P_{meas}}(10s\ window) = \frac{1}{10} * \sum_{ts-9}^{ts} P_{meas}(ts)$$

taking into account that:

- the 5 first Time Steps of each frequency step are not considered to calculate FCR_{max};
- the first $AV_{P_{meas}}$ of each frequency step is calculated as follows:

$$First\ AV_{P_{meas}} = \frac{1}{15} * \sum_{5th\ Time\ Step}^{20th\ Time\ Step} P_{meas}(ts)$$

- “ts-9” to “ts” are the 10 Time Steps included in the 10 second window over which the average is computed.

For each frequency step, ELIA calculates $\Delta FCR\ Power\ supplied$ as follows

$$\begin{aligned} \Delta FCR\ Power\ supplied &= \min_{concerned\ frequency\ step} [FCR\ Power\ supplied\ (10s\ window)] \\ &- \min_{previous\ frequency\ step} [FCR\ Power\ supplied\ (10s\ window)] \end{aligned}$$

Annex 7 Prequalification test

taking into account that

- for the first frequency step in the upward and downward direction:

$$\Delta FCR \text{ Power supplied} = \min_{\text{concerned frequency step}} [FCR \text{ Power supplied (10s window)}]$$

ELIA determines *MIN Δ FCR Power supplied*, which is the minimal *Δ FCR Power supplied* over all frequency steps.

$$MIN \Delta FCR \text{ Power supplied} = \max \left\{ \min (all \Delta FCR \text{ Power supplied}); 0 \right\}$$

Finally, ELIA determines the maximal FCR Power supplied in each direction, upwards and downwards. To this purpose, ELIA considers the 4th frequency step (respectively the 8th frequency step) for the upward direction (respectively downward):

- in the upward direction,

$$Max FCR \text{ Power supplied Up} = \min_{\text{frequency step 4}} \{FCR \text{ Power supplied (10s window)}\}$$

- in the downward direction,

$$Max FCR \text{ Power supplied Down} = \min_{\text{frequency step 8}} \{FCR \text{ Power supplied (10s window)}\}$$

If

$$4 * MIN \Delta FCR \text{ Power supplied} \geq 0,9 * \min \left\{ \begin{array}{l} Max FCR \text{ Power supplied Up;} \\ Max FCR \text{ Power supplied Down} \end{array} \right\}$$

Then

$$FCR_{max, synthetic \text{ profile}} = \min \left\{ \begin{array}{l} Max FCR \text{ Power supplied Up;} \\ Max FCR \text{ Power supplied Down} \end{array} \right\}$$

Otherwise

$$FCR_{max, synthetic \text{ profile}} = 4 * MIN \Delta FCR \text{ Power supplied}$$

Result of real time follow-up

If during the real-time follow-up of the Frequency one or several Frequency Variations occur, ELIA will check the largest one and calculate the $\Delta FCR_{max, follow-up}$ as follows:

$$\Delta FCR_{max, follow-up} = \min \left\{ \frac{FCR \text{ Supplied}}{FCR \text{ Requested}_{Frequency \text{ Variation}}}; 1 \right\}$$

Where:

- FCR Supplied is computed in accordance with Annex 13.A;
- $FCR \text{ Requested}_{Frequency \text{ Variation}}$ is computed in accordance with Annex 13.B;

Annex 7 Prequalification test

Calculation of FCR_{max}

The FCR_{max} value is calculated as follows:

$$FCR_{max} = \min \left\{ \sum_{\substack{DP \in \\ \text{Providing Group}}} DP_{FCR,cb} ; FCR_{max,synthetic\ profile} * \Delta FCR_{max, follow-up} \right\} * E_{max}$$

Where:

- E_{max} : value calculated based on Private Measurement precision, as declared by the BSP in Annex 4, for each Delivery Point non-compliant with measurement requirements in Annex 3. E_{max} is calculated as the difference between the worst accuracy over all Delivery Points included in the prequalification test and the accuracy criteria set by Elia in Annex 3 (1%) as follows

$$E_{max} = 100\% - (\text{worst accuracy} - 1\%)$$

7.D MODALITIES IN CASE OF A POOL MODIFICATION

Addition of new Delivery Point(s)

In order to add new Delivery Point(s) to an existing Pool, a prequalification test has to be performed to increase the FCR_{max} . No test is required if Delivery Point(s) is (are) added without impact on FCR_{max} .

The BSP may choose one of the two following solutions:

- a new prequalification test, as provided by Annex 7.B, on a Providing Group consisting only of the new Delivery Points that have not yet been prequalified.
- a prequalification test, as provided by Annex 7.B, on the complete Pool of the BSP

If the first solution is chosen, then the resulting FCR_{max} of the prequalification test is added to the previous FCR_{max} .

Removal of Delivery Point(s)

A prequalification test is not mandatory to remove a Delivery Point from the Pool participating to the FCR Service. The FCR_{max} of the BSP will be adapted as follows:

- New $FCR_{max} = FCR_{max} - DP_{FCR,cb}$;

However, the BSP has the possibility to perform a new prequalification test on the Pool, as provided by Annex 7.B, if preferred.

ANNEX 8. CAPACITY AUCTIONS

8.A PRINCIPLES

As described in Art. II.8.1 ELIA participates in an international cooperation (the “FCR Cooperation”) with other Participating TSOs in order to procure its required FCR Capacity through a Regional Procurement Platform.

Rules and processes governing the Regional Procurement Platform (RPP) are described in the “Proposal of the establishment of common and harmonised rules and processes for the exchange and procurement of Balancing Capacity for Frequency Containment Reserves (FCR)” dated 18 October 2018 and its amendment dated 06 October 2021 as amended from time to time (hereinafter referred to as “RPP rules and processes for FCR”) and published on the ELIA website.

Elia and balancing service providers from its LFC Block participate in the Regional Procurement Platform through the bidding platform www.regelleistung.net.

Balancing service providers whose Delivery Points are located within ELIA’s LFC Block need to have concluded a valid BSP Contract FCR with ELIA to be allowed to participate in the Regional Procurement Platform. Once the BSP contract FCR is concluded with ELIA, ELIA will provide the required access rights to the Regional Procurement Platform to the BSP. The BSP has to sign the BSP Contract FCR at least 5 Working Days before participation to his first auction.

Through the Regional Procurement Platform the BSP will be able to offer volumes of FCR Capacity to all TSO’s who have signed an agreement at the moment of the auction. FCR Capacity Bids are selected so as to respect the Core Share obligation and minimize the total cost of procurement of the participating TSOs and considering constraints set in local legislation.

Once a FCR Capacity Bid is awarded in the Regional Procurement Platform the FCR Awarded becomes part of the BSP’s FCR Obligation as mentioned in Art. II.8.6.

8.B CAPACITY AUCTION PROCESS

Organization

The auction calendar is described in Article 4 – Auction frequency and auction timing’ of the RPP rules and processes for FCR.

Overall, the procurement timeline¹³ will be the following:



Auction procedure

¹³ The figure on the procurement timeline is for illustrative purpose only. The auction timing may be amended from time to time and is defined in Article 4 of the RPP rules and processes for FCR.

Annex 8 Capacity auctions

The auction procedure is detailed in Article 4 – Auction frequency and auction timing’ of the RPP rules and processes for FCR.

Market decoupling

For technical and/or regulatory reasons, it might be necessary to decouple the common market. It will then be split up into sub-markets. Relevant common sub-markets will be identified on www.regelleistung.net.

If the markets are decoupled, the two relevant auctions are clearly identified on the bidding platform.

8.C BIDDING OBLIGATIONS FOR FCR CAPACITY BIDS

The bidding obligations applicable to FCR Capacity Bids are described in Article 6 – Bid design possibilities’ of the RPP rules and processes for FCR.

The maximal volume offered by the BSP must always be equal to or lower than its FCR_{max} . The BSP takes this into account when submitting multiple offers, which are always combinable as well as all specific conditions related to his Pool (congestions, availability,...).

The FCR Capacity Bid price on Regional Procurement Platform is expressed in €/MW/CCTU.

8.D AWARDING PROCEDURE AND CRITERIA

Selection and award are described in Article 7 – Auction Allocation Algorithm of the RPP rules and processes.

8.E PUBLICATIONS & TRANSPARENCY

Auction results will be published at latest 24 hours after a FCR Capacity GCT on www.regelleistung.net. For reasons of transparency, anonymized awarded FCR Capacity Bids will also be published in the same delay on the Regelleistung website.

8.F SETTLEMENT & INVOICING

Settlement of the FCR Capacity Bids awarded in the Regional Procurement Platform is described in Article 8 – TSO-BSP settlement’ of the RPP rules and processes for FCR.

Further to that, as mentioned in section 8.A of the present Annex, FCR Capacity Bids awarded in the Regional Procurement Platform become part of the BSP’s FCR Obligation. In this sense, the rules as described in Art. II.17 apply.

ANNEX 9. TRANSFER OF OBLIGATION

In accordance with Art. II.9, ELIA allows the BSP to transfer part or all of his FCR Obligation to one or several Counterpart BSP(s). Similarly, the BSP may agree to make an additional FCR Capacity available to ELIA as a result of a Transfer of Obligation from a Counterpart BSP to the BSP.

This annex lays down the conditions under which the Transfer of Obligation may apply and defines the rules and procedure that ELIA, the BSP and the Counterpart BSP must respect in order to notify and validate said transfers.

9.A RULES FOR THE TRANSFER OF OBLIGATION

- The BSP and the Counterpart BSP hold a valid BSP Contract FCR to the date of the performance of the concerned FCR Obligation;
- FCR Obligation can be taken over by a Counterpart BSP even if his quantity of FCR Awarded is 0 (zero) for the concerned CCTU;
- Transfer of Obligation is applicable in day-ahead or in intraday;
- The BSP can have multiple exchanges with different Counterparts BSP, and vice-versa;
- The BSP and the Counterpart BSP arrange between themselves how, when and at what price the FCR Obligation is taken over.

9.B PROCEDURE FOR TRANSFER OF OBLIGATION

- Transfer of Obligation requests are automatically checked by ELIA. ELIA only considers as valid the Transfers of Obligation with status “Accepted”;
- The Transfer of Obligation can take place as of the award of capacity from the capacity auction until one hour before beginning of the first quarter-hour for which the Transfer of Obligation applies;
- The BSP (respectively the Counterpart BSP) initiates the request for Transfer of Obligation. The Counterpart BSP (respectively the BSP) must accept the Transfer of Obligation until 1 hour before the first quarter-hour for which the Transfer of Obligation applies. If the Counterpart BSP (respectively the BSP) has not accepted by this time, the Transfer of Obligation is not taken into account by ELIA;
- The updated FCR Obligation (i.e. after Transfer of Obligation) must be in respect of FCR_{max} ;
- The Counterpart BSP and the BSP exchanging FCR Obligation should update their submission of FCR Energy Bid(s), at the latest at FCR Balancing GCT for the first quarter-hour for which the Transfer of Obligation applies, in order to reflect the agreed Transfer of Obligation.

The detailed procedures to be followed for the Transfer of Obligation and the manual for the tools are published on ELIA website and available on demand by e-mail to the contractual responsible as mentioned in Annex 16.

ANNEX 10. FCR ENERGY BID

As provided by Art. II.10, the BSP submits FCR Energy Bids through a dedicated web-based platform put at disposal by ELIA. The user manual for this platform is available on ELIA website or can be requested by e-mail to the contractual responsible as mentioned in Annex 16.

10.A SPECIFICATIONS FOR FCR ENERGY BID

A FCR Energy Bid related to Delivery Points DP_{SU} and DP_{PG} comprises the following information:

- The Delivery Point DP_{SU} and DP_{PG} corresponding to the FCR Energy Bid.
- For Delivery Points DP_{SU} , the FCR Power the DP_{SU} will provide in upward and downward reaction.
- The start time and the end time of the concerned FCR Energy Bid.
- The offered volume, expressed in MW, for each quarter-hour taking into account that:
 - Minimum offered volume is 1 MW;
 - Volume granularity is 0,1 MW;

10.B CHECKS PERFORMED ON A FCR ENERGY BID

ELIA performs the following checks at any submission or update of a FCR Energy Bid:

- The BSP holds a valid BSP Contract FCR with ELIA;
- Delivery Points mentioned in the FCR Energy Bid must be valid (i.e. included in Annex 4 or in the FSP-DSO Contract);
- For each quarter-hour, the sum of the offered volume of each FCR Energy Bid is inferior or equal to the corresponding FCR Obligation;
- The total offered volume of a FCR Energy Bid must be inferior or equal to the sum of the $DP_{FCR,cb}$ of each Delivery Point mentioned in the FCR Energy Bid.

A FCR Energy Bid is automatically rejected if one of the above mentioned checks is not satisfied. The BSP is notified of rejection and reason for rejection.

10.C TEMPLATE FOR FORCED OUTAGE COMMUNICATION

The BSP notifies a Forced Outage as follows:

From	BSP	
To	ELIA: Real-time contact and contractual responsible (as listed in Annex 16)	
Subject	FCR Service – Forced Outage Notification	
Body	BSP would like to notify ELIA of the following Forced Outage:	
	FCR Energy Bid Reference	
	Updated Volume after FO [MW]	
	Justification of FO	
	Estimated duration of FO	

ANNEX 11. ACTIVATION

In accordance with Art II.11.1, in case of a Frequency Deviation, the BSP must activate automatically (without intervention) the FCR Requested as defined in this Annex.

ELIA authorizes a deadband of 10mHz around 50Hz in which a BSP may not react as stated in Annex V of SOGL. The FCR Requested is calculated per Energy Bid. Energy Bids including Providing Groups with Reserve Mode implemented must respect Annex 11.B for the determination of FCR Requested, and therefore must apply Reserve Mode as specified in Annex 11.B..

11.A DETERMINATION OF THE FCR REQUESTED FOR ALL ENERGY BIDS NOT INCLUDING PROVIDING GROUPS WITH RESERVE MODE IMPLEMENTED

The FCR Requested per Energy Bid is based on the power/frequency ratio λ_0 and on the Frequency Deviation as follows:


$$\text{FCR Requested} = -\lambda_0 * \text{FCR}_{\text{energy bid}} * \Delta f$$

With:

- λ_0 : the power/frequency ratio, as defined by ENTSO-E Regional Group Continental Europe, equal to $\frac{15000 [MW/Hz]}{3000 [MW]} = 5 \text{ Hz}^{-1}$;
- $\text{FCR}_{\text{energy bid}}$: is the total volume offered by the BSP in the concerned FCR Energy Bid for the concerned quarter-hour;
- $\Delta f = F - 50\text{Hz}$ is the frequency deviation, determined with 3 decimals.

In addition, the FCR Requested is bounded by the FCR Energy Bid value, meaning that for frequency deviations larger than 200 mHz, the FCR Requested is equal to the FCR Energy Bid.

Graphically, FCR Requested can be represented as follows:

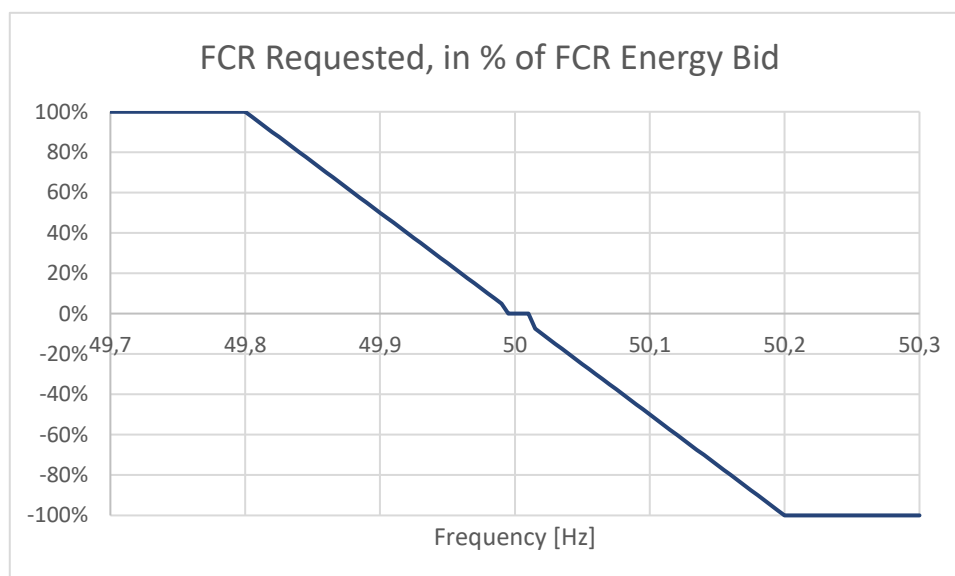

11.B DETERMINATION OF FCR REQUESTED FOR ENERGY BIDS INCLUDING PROVIDING GROUPS WITH RESERVE MODE IMPLEMENTED

The FCR Requested per Energy Bid is based on the power/frequency ratio λ_0 and on the Frequency Deviation as follows:

$$\text{FCR Requested} = -\lambda_0 * \text{FCR}_{\text{energy bid}} * f_{\text{reaction}}$$

Where:

- λ_0 is the power/frequency ratio, as defined by ENTSO-E Regional Group Continental Europe, equal to $\frac{15000 [MW/Hz]}{3000 [MW]} = 5 \text{ Hz}^{-1}$;
- $\text{FCR}_{\text{energy bid}}$ is the total volume offered by the BSP in the concerned FCR Energy Bid for the concerned quarter-hour;
- f_{reaction} is the reaction function that provides the frequency deviation to which a BSP must react.

In addition, the FCR Requested is bounded by the FCR Energy Bid value, meaning that for values of the reaction function larger than 200 mHz, the FCR Requested is equal to the FCR Energy Bid.

For Delivery Points with LER that complete the prequalification test after the end of the transitional period referred to in Article 4 of the Additional Properties for FCR approved by the CREG by decision (B)2133 of 21 January 2021 ((21/01/2023)), the Additional Properties foresee an additional operating mode in Alert State and emergency state: the Reserve Mode. The rationale behind the Reserve Mode is to avoid the depletion of the energy reservoirs of the Delivery Points with LER during extended periods of frequency deviations and the consequent loss of the FCR activation from those Delivery Points. The Reserve Mode ensures that Delivery Points with LER provide in such conditions a limited FCR activation, based on short-term frequency deviation instead of no FCR activation due to depleted energy reservoirs.

The state of charge (or SoC) of Delivery Points with LER that complete the prequalification test after the entry into force of these T&C BSP FCR shall always be sufficient to continuously react to frequency deviations, by applying an Active Energy Reservoir Management.

Without prejudice to Article II.10.7, when the Synchronous Area Continental Europe enters into Alert State (or Emergency State), and the Delivery Points with LER that complete the prequalification test after the entry into force of these T&C BSP FCR reach or exceed the upper (SoC_{max}) or lower (SoC_{min}) limit of their energy reservoir, these Delivery Points with LER shall switch to the Reserve Mode. These thresholds are defined by the amount of energy required to provide continuously FCR for a time interval equal to the local full activation time (FAT) of aFRR:

$$SoC_{\text{min}} = \frac{P * t_{\text{FAT}}}{C}$$

$$SoC_{\text{max}} = 1 - SoC_{\text{min}}$$

Where:

- C is the energy capacity of the Delivery Point with LER in MWh;
- P is the provided FCR Power corresponding to a frequency deviation of ± 200 mHz, in MW;
- t_{FAT} is the full activation time of aFRR in h.

The transition from Normal Mode to Reserve Mode is therefore initiated at instant $t_{\text{start}} = t(SoC \leq SoC_{\text{min}} | SoC \geq SoC_{\text{max}})$, in Alert State and without prejudice to Article II.10.7 and lasts t_{FAT} .

Annex 11 Activation

When the system is back to Normal State, the transition from Reserve Mode to Normal Mode is initiated when the state of charge is restored, i.e. at instant $t_{\text{restore}} = t(\text{SoC}_{\text{min}} < \text{SoC} < \text{SoC}_{\text{max}})$.

In Reserve Mode, the Delivery Points with LER shall react to the zero-mean frequency Δf_{zm} which represents the short-term frequency deviation and is calculated by subtracting from the frequency deviation Δf the average frequency deviation over a period of t_{FAT} :

$$\Delta f_{\text{zm}}(t) = \Delta f(t) - \frac{1}{t_{\text{FAT}}} \sum_{k=0}^{N_{\text{FAT}}-1} \Delta f(t - k * ts)$$

Where:

- ts is the Time Step duration, i.e. 2 seconds;
- $N_{\text{FAT}} = \frac{t_{\text{FAT}}}{ts}$ is the number of Time Steps in the time period of the Full Activation Time of aFRR.

As the transitions from one state to the other are linear, the reaction function is given by:

$$f_{\text{reaction}}(t) = \Delta f_{\text{zm}}(t) * T + (1 - T) * \Delta f(t)$$

Where:

- f_{reaction} is the reaction function that provides the frequency deviation to which a BSP must react;
- Δf_{zm} is the zero-mean frequency which represents the short-term frequency deviation, determined with 3 decimals;
- $\Delta f = F - 50\text{Hz}$ is the frequency deviation, determined with 3 decimals;
- T is the weighting function that defines the operating mode.

- In Normal Mode, $T = 0$;
- In Reserve Mode, $T = 1$;
- During transition from Normal Mode to Reserve Mode:

$$T = \begin{cases} 0 & t < t_{\text{start}} \\ \frac{t - t_{\text{start}}}{t_{\text{FAT}}} & t_{\text{start}} < t < t_{\text{start}} + t_{\text{FAT}} \\ 1 & t > t_{\text{start}} + t_{\text{FAT}} \end{cases}$$

- During transition from Reserve mode to Normal Mode:

$$T = \begin{cases} 1 & t < t_{\text{restore}} \\ 1 - \frac{t - t_{\text{restore}}}{t_{\text{FAT}}} & t_{\text{restore}} < t < t_{\text{restore}} + t_{\text{FAT}} \\ 0 & t > t_{\text{restore}} + t_{\text{FAT}} \end{cases}$$

11.C DETERMINATION OF THE FCR REQUESTED IN CASE OF SYSTEM SPLIT

In case of System Split, the Delivery Points DP_{PG} in an Energy Bid must each react to the local frequency deviation, in accordance with the requirements described in Annex 2.E.

Annex 11 Activation

11.D FORCED OUTAGE

In case a Forced Outage occurs during an activation of the FCR Service, the BSP makes best effort to communicate the information by e-mail to ELIA real-time contact and to the contractual responsible, as listed in Annex 16, in accordance with the template hereunder.

From	BSP				
To	ELIA: Real-time contact and contractual responsible (as listed in Annex 16)				
Subject	FCR Service – Forced Outage Notification				
Body	BSP would like to notify ELIA of the following Forced Outage: <table border="1"> <tr> <td>List of FCR Energy Bid(s)</td> </tr> <tr> <td>[Bid reference]</td> </tr> <tr> <td>[Bid reference]</td> </tr> <tr> <td>[Bid reference]</td> </tr> </table>	List of FCR Energy Bid(s)	[Bid reference]	[Bid reference]	[Bid reference]
List of FCR Energy Bid(s)					
[Bid reference]					
[Bid reference]					
[Bid reference]					

11.E REAL-TIME COMMUNICATION

The following data is communicated, per Time Step "ts", from the BSP to ELIA:

- $DP_{measured}(ts)$, in MW, is transmitted at Time Step "ts" for Time Step "ts". In other words, $DP_{measured}(ts)$ is sent in real-time.
- $DP_{CH-DCH}(ts)$, in MW, is transmitted at Time Step "ts" for Time Step "ts". In other words, DP_{CH-DCH} is sent in real-time, in accordance with Art. II.12.6;
- $DP_{AV\ Margin}(ts)$, in MWh, is transmitted at Time Step "ts" for Time Step "ts". In other words, $DP_{AV\ Margin}(ts)$ is sent in real-time, in accordance with Art. II.12.6;
- $DP_{FCR}(ts)$, being either 0 or 1, is transmitted at Time Step "ts" for Time Step "ts". In other words, $DP_{FCR}(ts)$ is sent in real-time;

The specifications for the real-time communication is specified in the document "FCR real-time data exchange" published on the ELIA website and available on demand by e-mail to the contractual responsible as mentioned in Annex 16.

In case the BSP would like to appeal to one or several third parties with respect to the delivery of measurement data to ELIA, the BSP must sign and send the following declaration to the contractual responsible as mentioned in Annex 16:

BSP Declaration with respect to the delivery by one or several third parties of measurement data to ELIA

The BSP [*full NAME/TITLE to be filled in*] (hereinafter the BSP),...[*address/business number to be filled in*], hereby acting as BSP under the concluded BSP Contract FCR, declares that it is appealing to [*Name of third party*], ... [*insert address/company number*][*if relevant: which in turn appeals to* [*Name of second third party*], ... [*insert address/company number*]], [*which/both of whom*] will act in the name and on behalf of the BSP with respect to the delivery of the following category or categories of measurement data: [*copy paste the relevant categories of data provided for under annex 11.E*] regarding the following Delivery Points: [*add description of the concerned Delivery Points, eg: Low Voltage Delivery Points connected to Access Points connected to the Public Distribution Network*] under the BSP Contract FCR.

To this end, the BSP shall transmit the relevant contractual obligations and communication requirements (hereinafter BSP Obligations) to and make the necessary arrangements with [*Name of third Party*] in order to have these BSP Obligations passed on to [*Name of third Party*], which in turn shall, where appropriate, pass on these obligations to [*where relevant: Name of second third party and*] other third parties or any other affiliated company or subsidiary of [*Name of third Party*] being involved in the execution of the BSP Contract FCR. It concerns, in particular, the following requirements stipulated in the BSP Contract FCR: Article II.3.3 as well as Annex 11.E and the referenced document "FCR real-time data exchange".

In addition, the BSP declares that:

- The BSP remains solely responsible towards ELIA for the performance of the BSP Obligations under the BSP Contract FCR, even if performed by any third party on behalf of the BSP, and
- The BSP will be liable to pay any penalties and incentives, damages or liability compensation, and
- The BSP will indemnify ELIA for any third party claims in the event of non-compliance with the BSP Obligation of the BSP or the above mentioned third party/ies involved in the execution of the BSP Contract FCR, including, inter alia, the communication requirements mentioned above.

ELIA shall inform the BSP about any third party request for indemnification in accordance with the stipulations in the BSP Contract FCR.

The BSP will be the contractual point of contact for operational matters in this capacity.

The BSP shall also indemnify ELIA in case of any claim brought against ELIA by [*name of third party*], [*where relevant: name of second third party*] or any other affiliated company or subsidiary of [*name of third party*] or any other third party being involved in the execution of the BSP Contract FCR on behalf of the BSP, for damage in excess of the limitations defined in Article I.6 of the BSP Contract FCR.

When processing personal data under or in connection with this BSP declaration, the BSP shall comply with its obligations under applicable data protection legislation, including the General Data Protection Regulation 2016/679 (GDPR), and any corresponding or equivalent national laws or regulations in Belgium. The BSP hereby undertakes to duly inform the relevant Grid Users that the category or categories of measurement data detailed above relating to the Delivery Points detailed above shall be shared with ELIA. The BSP represents and warrants that it has a valid legal basis for sharing the mentioned data with ELIA.

For the BSP

Signature

Annex 11 Activation

Name

Function

Date

Annex 11 Activation

ANNEX 12. AVAILABILITY TEST

In accordance with Art. II.13, ELIA controls the availability of the FCR Capacity by performing two kind of tests: the capacity availability test and the energy availability test.

12.A ORGANIZATION OF AVAILABILITY TESTS

In accordance with Art.II.13.2, ELIA can request an availability test on a FCR Energy Bid submitted by the BSP, at any moment, while respecting the rules described in this Annex.

12.B SPECIFICATIONS OF THE AVAILABILITY TESTS

Capacity Availability test

A capacity availability test is triggered by sending an availability test signal to the BSP, in accordance with Annex 12.G, when the Frequency passes by 50Hz.


The capacity availability test consists of several steps, as shown on the illustration hereunder:

- A ramping phase of 60 seconds to reach the FCR Capacity Requested in the upward direction;
- A provision of the FCR Capacity Requested in the upward direction for 120 seconds;
- A phase of 60 seconds to come back to the baseline;
- A ramping phase of 60 seconds to reach the FCR Capacity Requested in the downward direction;
- A provision of the FCR Capacity Requested in the downward direction for 120 seconds.

The baseline for the capacity availability test is computed over the 20 seconds preceding the moment at which the availability test signal is sent by ELIA., in accordance with annex 12.D.

The charging/discharging of Delivery Points with Energy Limited Reservoir should be stopped as of the start time of the capacity availability test and during the whole capacity availability test.

The start time of the capacity availability test is indicated in the request sent by ELIA, in accordance with Annex 12.G. The start time is at least 2 minutes later than the moment at which the availability test signal is sent by ELIA.

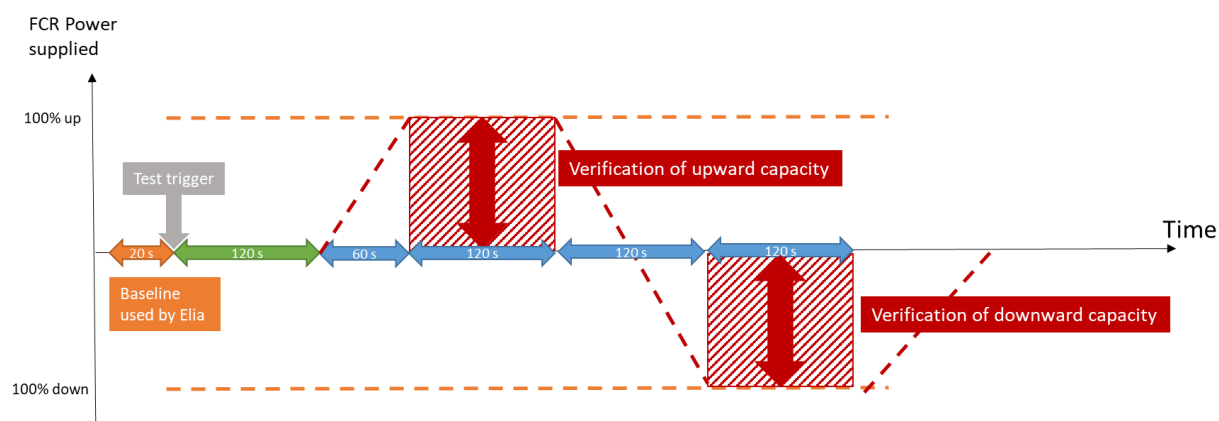

Annex 12 Availability test

Energy availability test

An energy availability test is triggered by sending an availability test signal to the BSP, in accordance with Annex 12.F, when the Frequency passes by 50Hz.



The energy availability test consists of several steps, as shown on the illustrations hereunder:

- A ramping phase of 60 seconds to reach the FCR Capacity Requested in the requested direction;
- A provision of the FCR Capacity Requested in the requested direction for 25 minutes (1500 seconds);

The baseline for the energy availability test is computed over the 20 seconds preceding the moment at which the availability test signal is sent by ELIA, in accordance with annex 12.D.

The charging/discharging of Delivery Points with Energy Limited Reservoir should be stopped as of the start time of the energy availability test and during the whole energy availability test.

The start time of the energy availability test is indicated in the request sent by ELIA, in accordance with Annex 12.G. The start time is at least 2 minutes later than the moment at which the availability test signal is sent by ELIA.

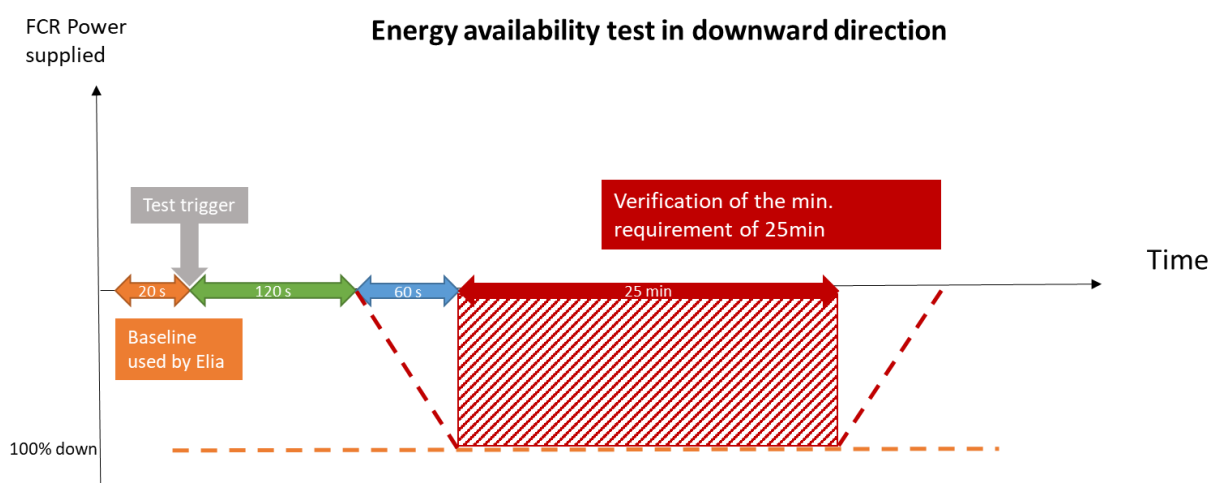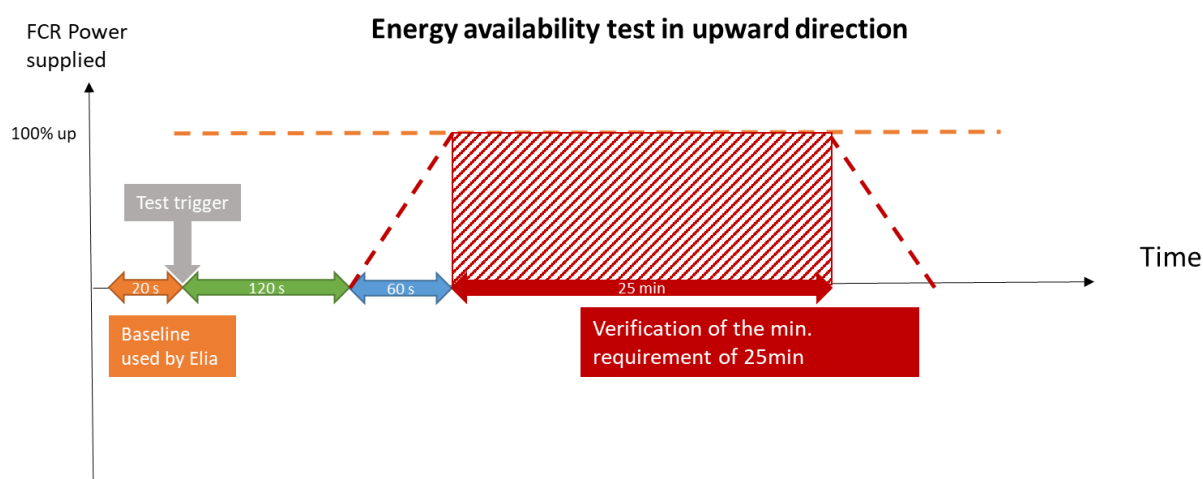

12.C RULES ON PERFORMANCE OF AVAILABILITY TESTS

ELIA respects the following rules to trigger the availability tests:

- ELIA performs at minimum one capacity and one energy availability test per year;
- ELIA has the right to test all the FCR Awarded at least once a year;
- ELIA has the right to perform at least one availability test per month;
- ELIA has the right to test all Delivery Points included in the Pool of the BSP once a year.

Limitation on the number of availability tests

ELIA triggers availability tests while respecting a limitation on the number of availability tests, which applies on a rolling window of 12 months, always starting at Month M (current Month).

ELIA has the right to perform at maximum 12 capacity availability tests on the rolling window:

- In case of two successive successful capacity availability tests, in accordance with Art. II.13.7, ELIA reduces this limitation to 6 capacity availability tests on the rolling window.
- Any failed capacity availability test, in accordance with Art.II.13.7, automatically sets the limitation on number of capacity availability tests back to 12 for the rolling window.

ELIA has the right to perform at maximum 3 energy availability test on the rolling window. However, if the result of all energy availability tests is negative, ELIA has the right to request an additional one.

Once the results of an availability test are provided by ELIA to the BSP, in accordance with Art.II.13.8, any update on the cap enters into force as of the first calendar day of next Month.

In case of dispute, the limitation is updated according to the results provided by ELIA in its report, as foreseen in Art. II.13.8, until sufficient proof is provided by the BSP to review the results and consequently agreement between ELIA and the BSP on results of the concerned availability test(s) is reached.

12.D COMPLIANCY CRITERIA

The FCR Power supplied during an availability test is determined per Time Step, taking into account all Delivery Points included in the tested FCR Energy Bid(s), as follows:

In the upward direction,

$$FCR\ Power\ supplied_{test}(ts) = \max \{ baseline - P_{meas}(ts) ; 0 \}$$

In the downward direction,

$$FCR\ Power\ supplied_{test}(ts) = \max \{ P_{meas}(ts) - baseline ; 0 \}$$

$$P_{meas}(ts) = \sum_{\substack{All\ DP \in \\ tested\ FCR\ Energy\ Bid(s)}} DP_{measured}(ts)$$

Annex 12 Availability test

The baseline is equal to the average power measured during the 20 seconds preceding the moment at which the test signal is sent by ELIA (period TS_0-19 to TS_0):

$$baseline = \frac{1}{20} * \sum_{ts=TS_0-19}^{TS_0} [P_{meas}(ts) - CH/DCH \text{ Correction}(ts) + FCR \text{ Requested}(ts)]$$

Where:

- CH/DCH Correction is determined by

$$CH/DCH \text{ Correction}(ts) = \sum_{\substack{\text{All DP with Limited Energy Reservoirs} \\ \in \text{tested FCR Energy Bid(s)}}} DP_{CH-DCH}(ts)$$

In case Delivery Points with Limited Energy Reservoir are included in the tested FCR Energy Bid(s), the baseline integrates a correction value for the charging/discharging of the concerned Delivery Point, based on the DP_{CH-DCH} communicated in real-time by the BSP in accordance with Annex 11.E.

FCR Requested (ts) for the tested FCR Energy Bid(s), computed in accordance with Annex 11.

A capacity availability test is compliant if the following conditions are simultaneously satisfied:

- ✓ less than 3 values of the 10 second average FCR Power supplied, $AV_{FCR \text{ Power supplied, test}}(10s \text{ window})$, are inferior to the FCR Capacity Requested for the phase of provision of the FCR Capacity Requested upward (i.e phase ii);
- ✓ less than 3 values of the 10 second average FCR Power supplied, $AV_{FCR \text{ Power supplied, test}}(10s \text{ window})$, are inferior to the FCR Capacity Requested for the phase of provision of the FCR Capacity Requested downward (i.e phase v);

An energy availability test is compliant if less than 26 values of the 10 second average FCR Power supplied, $AV_{FCR \text{ Power supplied, test}}(10s \text{ window})$, are inferior to the FCR Capacity Requested for the phase of provision of the FCR Capacity Requested (i.e phase ii).

$$AV_{FCR \text{ Power supplied}}(10s \text{ window}) = \frac{1}{10} * \sum_{ts=TS}^{TS+9} FCR \text{ Power supplied}_{test}(ts)$$

Annex 12 Availability test

12.E DETERMINATION OF FCR MISSING MW

If a capacity availability test is not compliant, ELIA will calculate the FCR Missing MW.

To this purpose, ELIA only considers the two phases of provision of the FCR Capacity Requested (i.e. phases ii and v). The FCR Missing MW corresponds to the greatest difference, over all Times Steps of concerned phases, between:

- the FCR Capacity Requested;
- the 10 seconds average FCR Power supplied.

$$\text{FCR Missing MW} = \max \left\{ \min_{\text{all } 10s \text{ windows}} \left[\text{FCR Capacity Requested} - AV_{\text{FCR Power supplied (10s window)}} \right]; 0 \right\}$$

12.F DETERMINATION OF FCR MISSING TIME AND THE FAILED ENERGY FACTOR

If an energy availability test is not compliant, ELIA will calculate the FCR Missing Time and Failed Energy Factor.


To determine both parameters, ELIA only considers the phase of provision of the FCR Capacity Requested, i.e. the 1 500 seconds of phase ii.

FCR Missing Time

The FCR Missing Time corresponds to the period (in seconds) between:

- the start time of the 10 seconds interval, in which the first 10 second average FCR Power supplied, $AV_{\text{FCR Power supplied (10s window)}}$, was inferior to the FCR Capacity Requested for the energy availability test;
- the end time of the energy availability test.

A graphical example is shown below:

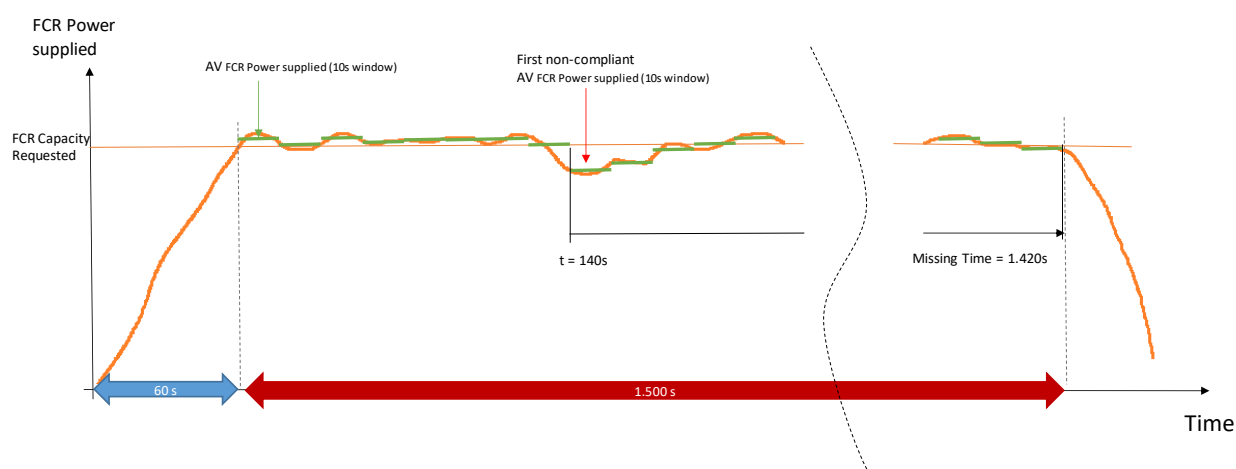

Annex 12 Availability test

In the example hereabove, the ramping phase starts at $t = 0$ second. The interval during which the first $AV_{FCR \text{ Power supplied}}(10s \text{ window})$ is inferior to the FCR Capacity Requested starts at $t = 140$ seconds. Taking into account that the energy availability test ends at $t = 1\,560$ seconds, the FCR Missing Time for the example amounts 1 420 seconds.

Failed Energy Factor

The Failed Energy Factor is the ratio between FCR Missing Energy and the energy corresponding to the FCR Capacity Requested for the energy availability test. The FCR Missing Energy and the Failed Energy Factor are determined as follows:

$$FCR \text{ Missing Energy} = \sum_{\substack{\text{all } 10s \text{ windows} \\ 10s}} \left(\text{Max}[FCR \text{ Capacity Requested} - AV_{FCR \text{ Power supplied}}(10s \text{ window}); 0] \right) * \frac{10s}{3600s}$$

$$\text{Failed Energy} = \frac{FCR \text{ Missing Energy}}{\frac{1500s}{3600s/h} * FCR \text{ Capacity Requested}}$$

12.G COMMUNICATION REQUIREMENTS

In order to trigger an availability test, ELIA notifies the BSP by an electronic message. The detailed technical specifications of the communication protocols are described in the document “FCR real-time data exchange”. This document can be consulted on the ELIA website or can be requested by e-mail to the contractual responsible as mentioned in Annex 16. ELIA can modify unilaterally the content of these messages. In such a case, ELIA informs the BSP taking into account reasonable delay, not less than 20 Working Days, for implementation before changes become effective.

ANNEX 13. ACTIVATION CONTROL

In accordance with Art. II.14, ELIA will check on a monthly basis that the FCR Supplied by the BSP meets the contractual requirements. For this purpose, ELIA checks at the same time all offered FCR Energy Bids activated for the analyzed Frequency Variation.

13.A DETERMINATION OF FCR SUPPLIED BY THE BSP

The FCR Supplied, for the analyzed Frequency Variation, is computed as follows:

in the upward direction,

$$FCR\ Supplied = \max \{ P_{meas_{before}} - P_{meas_{after}} ; 0 \}$$

in the downward direction,

$$FCR\ Supplied = \max \{ P_{meas_{after}} - P_{meas_{before}} ; 0 \}$$

Where:

- The FCR Supplied is determined based on the contribution of all Delivery Points. To this purpose, ELIA computes the P_{meas} for each Time Step. In case Delivery Points with Limited Energy Reservoir are included in the FCR Energy Bid, a correction value for the charging/discharging of the concerned Delivery Point, based on the DP_{CH-DCH} communicated in real-time by the BSP in accordance with Annex 11.E, is taken into account

$$P_{meas}(ts) = \sum_{\substack{All\ DP \in \\ FCR\ Energy\ Bid(s)}} [DP_{measured}(ts) - DP_{CH-DCH}(ts)]$$

- The $P_{meas_{before}}$ is computed over the period of 20 seconds exactly preceding the Frequency Variation (period comprised between $TS_{before}-19$ and TS_{before}), as follows:

$$P_{meas_{before}} = \frac{1}{20} * \sum_{ts=TS_{before}-19}^{TS_{before}} P_{meas}(ts)$$

- The $P_{meas_{after}}$ is computed over the period of 30 seconds starting at the time the Frequency Variation reaches its maximum value (period comprised between TS_{after} and $TS_{after}+29$), as follows:

In the upward direction,

$$P_{meas_{after}} = \min_{ts \in [TS_{after}; TS_{after}+29]} [P_{meas}(ts)]$$

In the downward direction,

$$P_{meas_after} = \max_{ts \in [TS_{after}; TS_{after}+29]} [P_{meas}(ts)]$$

When determining the FCR Supplied, the measurements may be corrupted by rapid power changes that cannot be ascribed to the provision of the FCR Service, making the FCR Supplied non-representative. In such an exceptional case, the BSP may:

- deliver the list of Delivery Points that undergo a proven rapid change during the examined period such that these are excluded from the calculation of the FCR Supplied.
- request a new Frequency Variation sample by motivating his proposal.

ELIA can impose one of the solutions to the BSP.

13.B DETERMINATION OF THE FCR REQUESTED FOR A FREQUENCY VARIATION

The FCR Requested for a certain Frequency Variation is determined as follows:

$$FCR_Requested_{Frequency\ Variation} = |FCR_Requested_{before} - FCR_Requested_{after}|$$

Where:

- FCR Requested_{before} is the FCR Requested, as described in Annex 11, corresponding to the Frequency F_{before}, which is the average value of the Frequency (in Hz) during the period of 20 seconds preceding the start of Frequency Variation (as communicated by ELIA for the selected Frequency Variation);

$$F_{before} = \frac{1}{20} * \sum_{ts=TS_{before}-19}^{TS_{before}} F(ts)$$

- FCR Requested_{after} is the FCR Requested, as described in Annex 11, corresponding to the Frequency F_{after}, which is the average value of the Frequency (in Hz) during a period of 20 seconds starting at the time the Frequency Variation reaches its maximum value;

$$F_{after} = \frac{1}{20} * \sum_{ts=TS_{after}}^{TS_{after}+19} F(ts)$$

If a Frequency Variation occurs spanning two different CCTUs and in case the BSP is offering the FCR Service with the same Delivery Points in the two CCTUs, the maximum value from both CCTUs will be retained as the FCR Requested_{Frequency Variation}.

ANNEX 14. INCENTIVES

14.A INCENTIVES RELATED TO FCR MADE AVAILABLE

In accordance with Art. II.16.1, the incentive for non-compliance with FCR Made Available is calculated for Month M as follows:

$$P_{FCR \text{ Made Available}}(\text{Month } M) = \sum_{\text{All CCTU of Month } M} P_{FCR \text{ Made Available}}(\text{CCTU})$$

$$P_{FCR \text{ Made Available}}(\text{CCTU}) = \#CCTU_{\text{non-compliant}} * MW_{\text{not made available}} * CP_{WA}$$

Where:

- All CCTU of Month M

All CCTU of Month M for which the BSP has a positive FCR Obligation;

- #CCTU_{non-compliant}

The number of CCTU for which a incentive related to the FCR Made Available applies for the period comprised between Day D-29 until Day D (i.e. 30 Days), where Day D is the date of the concerned non-compliance with FCR Made Available;

- MW_{not made available}

This value is determined as follows:

- For each quarter-hour of the concerned CCTU, the difference between the FCR Obligation and the corresponding FCR Made Available is determined;
- The differences established in point (i) for each quarter-hour are summed;
- The sum established in point (ii) is divided by 4 to obtain the MW not made available.

Example:

Non-compliant quarter-hours of CCTU 4 (16:00-20:00)	16:30-16:45	16:45-17:00	19:00-19:15	19:15-19:30
FCR Obligation (1)	70	70	70	70
FCR Made Available (2)	50	60	40	30
(1)-(2)	20	10	30	40
MW _{not made available}	= (20+10+30+40)/4 = 100/4 = 25			

Annex 14 Incentives

- CP_{WA}

The weighted average of capacity prices (in €/MW/h) corresponding to all FCR Capacity Bids awarded to the BSP for the period comprised between Day D-29 until Day D (i.e. 30 Days), where Day D is the date of the concerned non-compliance with FCR Made Available. The weight is the FCR Awarded for the concerned FCR Capacity Bid.

In case no FCR Capacity Bid has been awarded to the BSP for the period comprised between Day D-29 until Day D (i.e. 30 Days), where Day D is the date of the concerned non-compliance with FCR Made Available, CP_{WA} is equal to the average price of the capacity auction corresponding to the CCTU for which the non-compliance is observed;

14.B INCENTIVES FOR FCR MISSING MW

In accordance with Art. II.16.4, the incentive resulting from FCR Missing MW is calculated on a monthly basis as follows:

$$P_{FCR\ Missing\ MW} = \sum_{month\ M} \alpha * FCR\ Missing\ MW * CP_{WA} * \#CCTU * hours_{CCTU}$$

Where:

- α : incentive factor equals to 0,75 by default; In case the incentive concerns a second consecutive failed availability test, α is equal to 1,5.
- CP_{WA} : the weighted average of capacity prices (in €/MW/h) corresponding to all FCR Capacity Bids awarded to the BSP for the period comprised between Day D-29 until Day D (i.e. 30 Days), where Day D is the date of performance of the concerned availability test. The weight is the FCR Awarded for the concerned FCR Capacity Bid;
- $\#CCTU$: the number of CCTU for which at least one FCR Capacity Bid has been awarded to the BSP for the period comprised between Day D-29 until Day D (i.e. 30 Days), where Day D is the date of performance of the concerned availability test;
- $hours_{CCTU}$: number of hours of a CCTU.

Annex 14 Incentives

14.C INCENTIVES FOR FCR MISSING TIME

In accordance with Art. II.16.4, the incentive resulting from FCR Missing Time is calculated on a monthly basis as follows:

$$P_{FCR \text{ Missing Time}} = \sum_{\text{month } M} \alpha * \frac{FCR \text{ Missing Time}}{1500} * CP_{WA} * CV_A * \#CCTU * hours_{CCTU}$$

Where:

- α : incentive factor proportional to the percentage of the Failed Energy Factor, as calculated in Annex 12.F. The value of α is defined according to the table below:

Failed Energy Factor	Value of α
• $\leq 10\%$	• 0,50
• $> 10\%$ et $\leq 30\%$	• 0,75
• $> 30\%$	• 1

- In case the incentive concerns a second consecutive failed energy availability test, α is equal to 1,5.
- CP_{WA} : the weighted average of capacity prices (in €/MW/h) corresponding to all FCR Capacity Bids awarded to the BSP for the period comprised between Day D-29 until Day D (i.e. 30 Days), where Day D is the date of performance of the concerned availability test. The weight is the FCR Awarded for the concerned FCR Capacity Bid;
- CV_A : the average volume corresponding to all FCR Capacity Bids awarded to the BSP for the period comprised between Day D-29 until Day D (i.e. 30 Days), where Day D is the date of performance of the concerned availability test.
- $\#CCTU$: the number of CCTU for which at least one FCR Capacity Bid has been awarded to the BSP for the period comprised between Day D-29 until Day D (i.e. 30 Days), where Day D is the date of performance of the concerned availability test;
- $hours_{CCTU}$: number of hours of a CCTU.

14.D ADAPTATION OF FCR_{MAX}

In accordance with Art. II.13.7 and II.16.5, ELIA adapts the FCR_{max} in case of two failed consecutive capacity availability tests, as follows:

$$new \ FCR_{max} = FCR_{max} - \min \{ FCR \text{ Missing } MW_{test \ 1}; FCR \text{ Missing } MW_{test \ 2} \}$$

Annex 14 Incentives

14.E INCENTIVES FOR ACTIVATION CONTROL

In accordance with Art. II.16.6, the financial incentive for Month M is determined as follows:

$$P_{non-compliant\ activations} = \sum_{\substack{\text{all analyzed Frequency Variations} \\ \text{of Month M}}} [0,2 * failure\ factor * Remuneration\ (Month\ M)]$$

$$failure\ factor = \max \left\{ \frac{FCR\ Requested_{Frequency\ Variation} - FCR\ Supplied}{FCR\ Requested_{Frequency\ Variation}}; 0 \right\}$$

Where:

- *Remuneration (Month M)* is the total remuneration for the FCR Awarded, determined in accordance with Art. II.15.1, for Month M.

14.F CAP FOR FINANCIAL INCENTIVES

In accordance with Art. II.16.9, the monthly cap is defined as follows:

$$Monthly\ cap\ [Month\ M] = Remuneration\ for\ FCR\ Awarded\ [Month\ M]$$

ANNEX 15. APPROPRIATION STRUCTURE

Imputation code	Description
	Remuneration for FCR Awarded
	FCR Made Available control incentives
	Capacity Availability control incentives
	Energy Availability control incentives
	Activation control incentives

ANNEX 16. CONTACT DETAILS

Version: DD/MM/YYYY

For ELIA:

1	Contractual responsible(s)
2	Delivery Control
3	Invoice monitoring
3.1	Settlement
3.2	Invoicing & Payment
4	Real time operations and operational monitoring

Annex 16 Contact details

For the BSP:

1	Contractual relations
2	Urgent Message
3	Market Surveillance
4	IT Implementation
5	Operations: Capacity bidding
6	Operations: Transfer of Obligations
7	Operations: Energy bidding
8	Operations: Activations
9	Settlement
10	Invoicing
11	Exploitation 24/7

Table 2: Contact details for the BSP

The above-mentioned list of contacts requested throughout the validity of the BSP Contract FCR may be subject to changes. Those changes will be communicated to the BSP via the ELIA's digital customer portal, after discussion in the Working Group Balancing Design & Solutions and after approval by the CREG.