

REPORT FOR PUBLIC CONSULTATION

Incentive on Prequalification, Control, and Penalties for the aFRR and mFRR Services

September 22nd, 2023



TABLE OF CONTENTS

1. Introduction	5
1.1 Scope of the incentive	5
1.2 Incentive roadmap	5
1.3 Structure of the report	6
2. Onboarding and Prequalification	7
2.1 AS IS Design	7
2.2 Market Feedback	10
2.3 Elia’s Reaction and New Design Proposal (if applicable)	11
2.3.1 Elia’s Position	11
2.3.2 New Design Proposal	12
2.3.2 Reduction of the PQ test time-window	12
2.3.3 Asymmetric PQ tests	13
2.3.4 BSP switch facilitation	14
3. Penalties	15
3.1 Foreword	15
3.2 Penalty for MW Made Available	16
3.2.1 AS IS design	16
3.2.2 Main design issues and market feedback	18
3.2.3 New design proposal	20
3.3 Activation Control aFRR	21
3.3.1 AS IS design	21
3.3.2 Main design issues and market feedback	22
3.3.3 New design proposal	25
4. Penalties Calibration	31
4.1 Rationale to Calibrate the Penalty Factors	31
4.2 Proposition of Values for the Penalty Factors	32
4.2.1 aFRR activation control penalty factors	32
4.2.2 Penalty for aFRR MW Made Available factors	33
5. aFRR Availability Control	34
5.1 AS IS Design	34
5.2 Main Design Issues and Market Feedback	35
5.3 New Design Proposal	36
6. Conclusion	37

TABLE OF FIGURES

Figure 1 – Incentive roadmap.....	6
Figure 2 - High-level onboarding process.....	8
Figure 3 - High-level PQ test timeline - * WD = Working Day.....	8
Figure 4 – Prequalification test related to aFRR Up	9
Figure 5 – Prequalification test related to mFRR Standard	9
Figure 6 – Illustration of the PQ test time-window reduction.....	13
Figure 7 – AS IS vs TO BE asymmetric PQ tests	14
Figure 8 – aFRR Made Available of the BSP for CCTU3, Day D-5	18
Figure 9 – Illustration of the AS IS activation control aFRR design	22
Figure 10 - Penalty as function of share of failed activation in week 4	24
Figure 11 – Illustration of the aFRR Capacity Requested.....	27
Figure 12 – The 8 unique situations that can happen when delivering aFRR.....	27
Figure 13 – Example where aFRR Supplied and aFRR Requested have opposite signs.....	28
Figure 14 - aFRR Capacity Underdelivery illustration.....	29
Figure 15 – Illustration of the granularity of the aFRR capacity control	32
Figure 16 - aFRR availability test	34
Figure 17 - ID deal occurring during aFRR availability test: constant baseline.....	35
Figure 18 - ID deal occurring during aFRR availability test: baseline modification	36

Acronyms used in this document

aFRR	Automatic Frequency Restoration Reserve
CCTU	Capacity Contracted Time Unit
CP	Capacity Price
CREG	Commission for Electricity and Gas Regulation
DP	Delivery Point
DP _{PG}	Delivery Point Providing Group
DP _{SU}	Delivery Point Single Unit
GCT	Gate Closure Time
GU	Grid User
ID	Intra-Day
LER	Limited Energy Reservoir
LFC	Load Frequency Control
mFRR	Manual Frequency Restoration Reserve
MOL	Merit Order List
MP	Market Party
PC	Public Consultation
PQ	Prequalification
QH	Quarter-hour
RES	Renewable Energy Sources
SOGL	System Operation Guideline
T&C	Terms and Conditions
ToE	Transfer of Energy
Ts	Timestep
WD	Working Day
WS	Workshop

1. Introduction

The objective of this report for Public Consultation is to evaluate the control and penalty system as well as the prequalification conditions and the prequalification process for the aFRR and mFRR services, and to propose revisions if necessary.

The participation of the Belgian Market Parties has been significant so far, from bilateral exchanges taking place at the start of 2023 to the organization of 2 workshops before the summer period, with the opportunity for Market Parties to give informal feedback between each event. Elia has also considered the older feedbacks from Market Parties from the latest Public Consultations on T&C BSP aFRR and T&C BSP mFRR.

1.1 Scope of the incentive

The incentive consists of, for aFRR and mFRR balancing services:

- For prequalification
 - Description of existing prequalification requirements/criteria, prequalification processes (including timing and preparatory steps at the BSP (Balancing Service Provider));
 - Identification, in consultation with Market Parties, of potential barriers to participation and qualitative assessment of the impact of prequalification requirements on market development.
- For control and penalties
 - Identification of the parameters and criteria used in the existing checks and penalties associated with participation in the aFRR or mFRR service and relating to compliance with the obligations resulting from the offer of balancing capacity (“Missing MW” and “MW not made available”) and to activation control (the aspects related to the activation control of mFRR which are introduced in the new design, and which therefore require feedback after connection to MARI are **not** part of the incentive);
 - Identification and assessment of the impact of each of the elements identified above on the participation of market players in operational and/or financial terms, in consultation with market players.
- For the 2 parts, on the basis of the list of obstacles to the participation and their impact
 - Identification, in consultation with Market Parties and with the CREG, of the priorities that will be addressed within the framework of the incentive;
 - For those topics identified as priorities, identification, and analysis of alternative approaches to facilitate market participation and proposal to modify the approach, including any preconditions to be met before implementation.

The possible adaptation of the T&C BSP aFRR or mFRR and the implementation of the resulting modifications are **not** part of the incentive.

1.2 Incentive roadmap

In Figure 1 is illustrated the incentive roadmap. Prior to the Public Consultation, there have been:

- **A first proposal for priorities** that was presented at the 02/02 WG BAL, of which feedback was received, confirming the scope of the incentive.

- Bilateral exchanges between interested Market Parties and Elia, to give MPs the opportunity to update their position on the prequalification process, controls, and penalties for aFRR and mFRR since the latest Public Consultations on the T&C BSP aFRR (Q1 2022) and T&C BSP mFRR (Q4 2019), and/or to express new feedback/concerns.
- 2 workshops organized between early May and late June, in which Elia fixed the scope of the incentive and agreed with Market Parties on the several design issues related to the prequalification process as well as those related to the penalty schemes. Between the two workshops, Elia has given Market Parties the opportunity to give feedback on the first high-level new design proposals presented during the **1st workshop**, in such a way that Elia has considered, when relevant, such feedback to prepare the **2nd workshop** in which a more in-depth proposal for the new penalty schemes was presented.

Following the Public Consultation, are foreseen:

- A 3rd workshop with Market Parties, to discuss the integration of the various reactions of Market Parties or the motivation not to retain certain reactions if necessary; the workshop will take place on 24th November.
- A final report to be submitted to CREG at the latest on 23/12, including recommendations, the consultation report, an implementation plan if applicable, and the report of the aforementioned workshop.

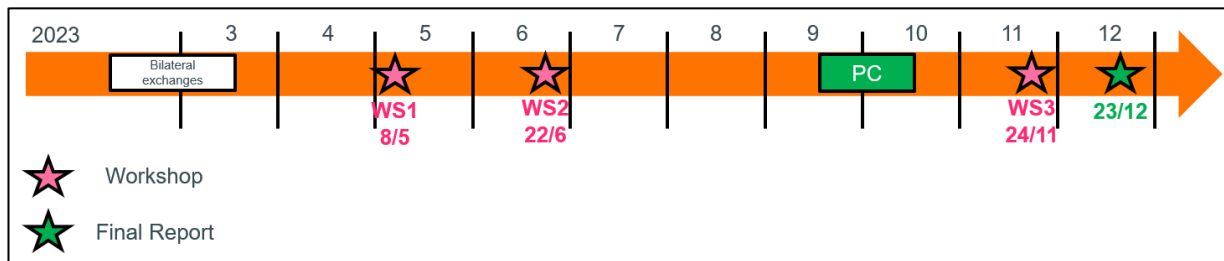


Figure 1 – Incentive roadmap

1.3 Structure of the report

The report is structured in the following chapters:

Chapter 2 goes over the Onboarding and Prequalification process, where firstly, the current (“AS IS”) design is recalled, then the market feedback is discussed, and finally the new prequalification design is presented.

Chapter 3 is related to the Control and Penalties. There are two penalties discussed in the framework of this incentive: the penalty for MW Made Available, and the penalty for activation control aFRR. For each of the penalties, the AS IS design is first recalled, then the market feedback and potential design issues are discussed, and finally the new penalty scheme is presented.

In **Chapter 4** is explained the penalties calibration. The rationale behind the calibration is first presented, then the actual values of the constant factors in the different penalties are given.

Chapter 5 relates to the aFRR availability test and the problem that may arise when the BSP is requested to freeze its baseline during the test.

2. Onboarding and Prequalification

2.1 AS IS Design

For a Balancing Service Provider (BSP) to be allowed to participate to either the automatic Frequency Restoration Reserve (aFRR) or manual Frequency Restoration Reserve (mFRR) services, certain conditions need to be met regarding the BSP and the Delivery Points it manages. These conditions can be found in the respective T&C BSP FRR.

Before participating to energy and/or capacity auctions of an FRR product, the BSP must do what is informally known as the “Onboarding Process”, of which the main steps are summarized in Figure 2.

A BSP must first sign the BSP contract, then perform a communication test. It then needs to register its Delivery Points (DPs). To do so, the BSP must have a Grid User (GU) declaration containing proof of the agreement between the BSP and the Grid User to provide the FRR Service at one (or more) specific Delivery Point(s). Each of the DPs must have a proper measurement equipment as well as an Energy Management Strategy (applicable for the Limited Energy Reservoir (LER) assets). In addition, the BSP must provide Elia with a Proof of Transfer or Energy (ToE) regime for each of the DPs of its Pool¹.

Once the BSP has successfully done so, it can start participating in the FRR Energy Market. **However, if the BSP intends to participate to capacity auctions, then it must go through one or two additional steps**, depending on the product:

- For aFRR, a baseline test is first required on each Delivery Point or on a Providing Group consisting of several Delivery Points. Afterwards, a prequalification test must be performed to determine the increase of the maximum volume the BSP may offer in aFRR capacity auctions.
- For mFRR, only a prequalification test must be performed to determine the increase of the maximum volume the BSP may offer in mFRR capacity auctions.

Figure 3 describes the typical timeline of a PQ test, both for aFRR and mFRR.

The goal of the PQ test is to determine the increase of the maximum volume the BSP may offer in capacity auctions. For Elia, the goal is to verify that the BSP is capable to steer the DP(s) used during the PQ test in accordance with the product requirements, and that the BSP can deliver *at least once* the maximum volume it wishes to prequalify.

For aFRR as well as mFRR the following common features regarding the PQ test can be listed:

- The PQ test is **not** remunerated.
- An energy bid for prequalification is submitted for the **24 hours of the day of the test**, which means that the PQ test can be triggered at any time during that day.

¹ No feedback was received from Market Parties on the Onboarding Process as a whole, which is why the current design is not explained in depth in this document.

- DP_{SU}'s are tested in accordance with operating mode². In case of multiple operating modes, Elia will consider the maximum result of the different PQ tests to determine the maximum volume that can be offered in the relevant capacity market(s).
- For DP_{PG}'s, the PQ test may be performed per DP (individually) or by Providing Group (the Providing Group may comprise already-PQ DPs or be constituted of new DPs only) as long as the maximum prequalified power is lower than 50 MW.
- A DP can only participate in one PQ test (Up, Down, or combined).
- The activation profile to follow depends on the type of product (aFRR Up, Down, combined, mFRR Standard,...).

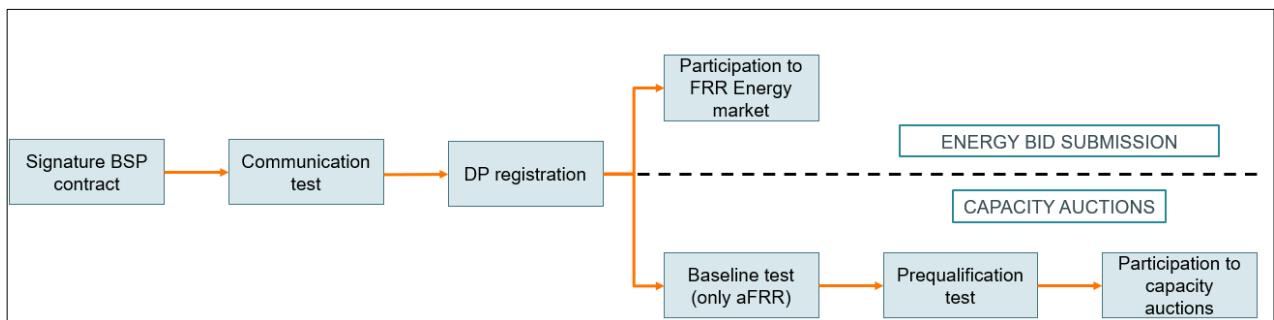


Figure 2 - High-level onboarding process

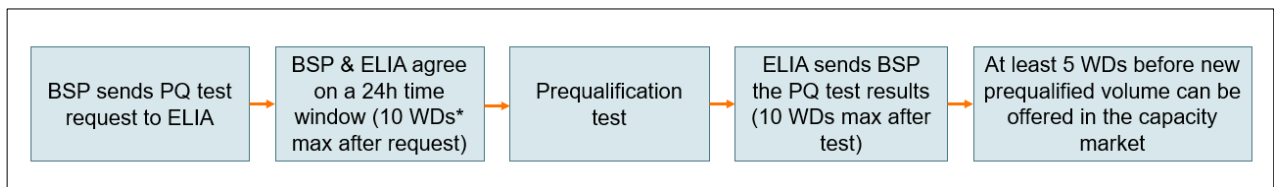


Figure 3 - High-level PQ test timeline - * WD = Working Day

² For instance, in case a CCGT may participate as a CCGT or as an OCGT, two prequalification tests should be foreseen: one for the OCGT operating mode and one for the CCGT operating mode.

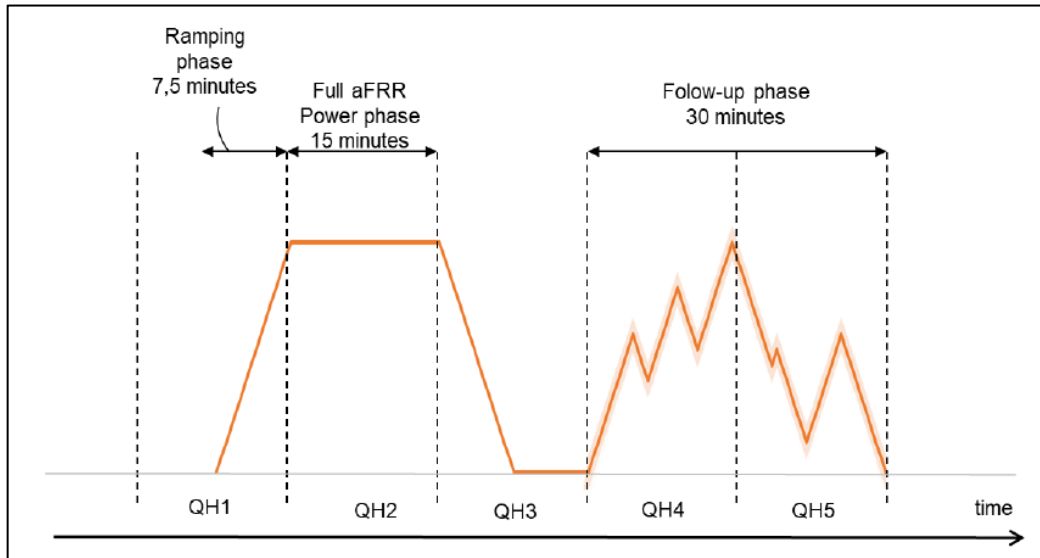


Figure 4 – Prequalification test related to aFRR Up

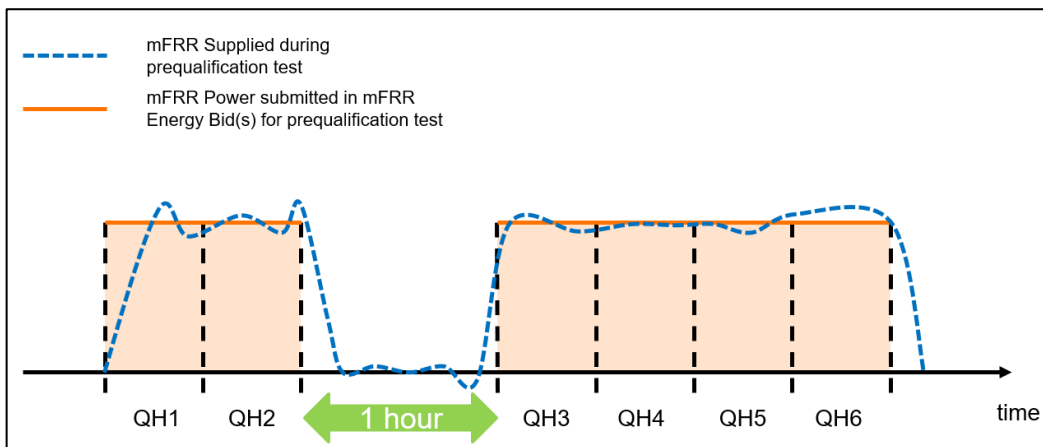


Figure 5 – Prequalification test related to mFRR Standard

Figure 4 and Figure 5 illustrate the PQ test profiles to follow for aFRR Up and mFRR Standard, respectively. Criteria to assess the success of the PQ test and the determination of the maximum volume related to the DP(s) depend on the product and may be found in the relevant T&C BSP FRR. **They are not subject to modifications in the framework of this incentive.**

Modalities in case of a Pool Modification

Whenever a BSP is willing to modify its Pool of DPs, the maximum value it can bid in capacity auctions may vary based on the rules hereunder:

1. **Addition of new DP(s):** a PQ test must be performed to increase the maximum volume to offer in capacity auctions.
 - a. For DP_{PG}, the BSP may:
 - i. Perform a new PQ test on the overall Pool (old DPs and new ones)
 - ii. Perform a PQ test on one new DP at a time, or consisting only of the new DP_{PG}
 - b. For DP_{SU}, a PQ test per operating mode must be performed
2. **Removal of DP(s):** a PQ test is not mandatory to remove a DP from a Pool (however BSP can do a new PQ test on the complete Pool, if preferred). The maximum volume that can be offered in capacity auctions is adapted accordingly.
3. **DP switch from one BSP to another:** a PQ test consisting in the same rules as Point 1. above must be performed by the new BSP. Before the organization of the said PQ test, DP registration must be completed by the new BSP. Note that metering information, EMS,... can already be sent prior to the transfer.

2.2 Market Feedback

The main stakeholder feedbacks out of the latest Public Consultations on T&C BSP FRR and bilateral meetings between the Market Parties and Elia, which took place early 2023, are listed below. In the section thereafter, Elia's position on these feedbacks is given. It must be noted that **no explicit concerns were received on the onboarding process itself.**

1. **Increase competition by facilitating BSP switch**
 - a. Some Market Parties are concerned with the general lead time of the BSP switch;
 - b. Some MPs consider a new PQ test as unnecessary.
2. **Facilitate PQ process for industrial processes and intermittent RES that struggle at being available for 24h**
 - a. There are industrials able to offer their flexibility but only 8h/day 5 days/week, e.g.
 - b. For wind farms, e.g., maximum volume that can be offered as aFRR may vary a lot in 24h.
 - c. A battery willing to prequalify the complete volume between maximum injection and maximum offtake cannot do so as it would lead to a depletion of the energy reservoir (to maintain the base-line at the required level for a long period, waiting for the start of the test).
3. **Allow prequalification of an asymmetric volume**
 - a. Today, a BSP cannot prequalify an asymmetric volume on the same DP, as a DP can only be part of one PQ test, which must be either for upward, downward, or symmetrical capacity.
4. **Some Market Parties would like an ex-post prequalification instead of an ex-ante PQ test, or even the removal of the prequalification process as a whole**

2.3 Elia’s Reaction and New Design Proposal (if applicable)

2.3.1. Elia’s position

1. Increase competition by facilitating BSP switch

Elia wants to foster competition between BSPs in order to lower the overall costs related to ancillary services and to give the Grid Users the opportunity to choose the BSP that best meets their expectations and needs, preventing any lock-in effect. In this regard, Elia is willing to facilitate the BSP switch process for DPs for which the individual contribution following the first PQ test can be assessed.

2. Facilitate PQ process for industrial processes and intermittent RES that struggle at being available for 24h

Elia is certainly willing to find additional flexibility in the future and is convinced both RES and the industry will play a key role in doing so. To unlock additional flexibility and give Market Parties the opportunity to valorize “intermittent” flexibility, Elia is willing to shorten the time window requirements of the PQ test.

3. A DP can only be part of one PQ test

Again, to help Market Parties valorize as best as possible the flexibility within their portfolio, Elia is ready to allow asymmetric prequalification, that is, for aFRR, the possibility to associate a DP with maximum upward and maximum downward volumes that are not necessarily equal.

4. Some Market Parties would like an ex-post prequalification instead of an ex-ante PQ test, or even the removal of the prequalification process as a whole

First, Elia would like to remind Art. 159 of SOGL on the “FRR prequalification process”, and more specifically Art. 159 §2:

*“A potential FRR provider shall demonstrate to the reserve connecting TSO [...] that it complies with the FRR minimum technical requirements in Article 158(1), the FRR availability requirements in Article 158(2), the ramping rate requirements in Article 158(1) and the connection requirements in Article 158(3) by **completing successfully the prequalification process of potential FRR providing units or FRR providing groups**, described in paragraphs 3 to 6 of this Article.”*

This article discards de facto the willingness of Market Parties to remove the prequalification process.

Elia relies on balancing capacity to secure system needs and therefore considers important that the actual contribution of a DP is demonstrated at least once before it participates to the capacity auction. This is not a guarantee but gives some (minimum) comfort to Elia as a TSO to rely on the DP. This comfort will be renewed later, if necessary, via availability tests.

In the framework of the discussions regarding the Framework Guideline on Demand Response (FGDR), Elia will look in the future at a potential harmonization of the PQ process in the EU, and a facilitation of such process for small units (c.f. CCMD).

In the framework of this incentive, Elia has investigated 2 possibilities:

- The first one, which answers most market concerns while keeping the PQ test: reduction of the PQ test time-window to 4h and the allowance of asymmetric tests.

- The second one where the prequalification to participate to the FRR capacity auctions would be done ex-post, that is, via correct activation of energy bids.

The second option was discussed with several Market Parties and their feedback was mostly negative as there is a structural difference between the test environment and the operational environment they are using. Additionally, the PQ test is not remunerated, but it is not penalized either in case of failure. Thus, it allows the BSP to split its portfolio between the DPs in which the BSP is confident to supply the service, and those that haven't been tested yet. Should the prequalification be done via correct activation of energy bids, a failed prequalification would entail the energy remuneration linked to the already prequalified DPs. Moreover, the design criteria linked to an ex-post PQ would need to be very strict to cover all eventualities, and as such the ex-post PQ would not often happen and probably for only a small part of the volume the BSP wishes to prequalify.

Elia also studied the extreme case (such as that used in the Netherlands by TenneT NL) where the BSP is given total freedom on the period it performs the PQ test and must warn the TSO ex-post that it ran a PQ test successfully. One of the issues encountered is that Elia needs a blocking window to prevent imbalance in BRP_{source} portfolio. If it is the BSP that organizes the test on its own, Elia cannot warn the BRP_{source} of the activation within its portfolio, leading to a possible significant imbalance in its portfolio. Additionally, Elia would like to keep a minimum "surprise" effect by setting the time-window to 4h so that there is still unpredictability on the exact moment of the start of the PQ test.

In conclusion, Elia is not comfortable, at this stage, with removing completely the PQ test as it remains a guarantee that the BSP is capable to steer the DP(s) used during the test in accordance with the product requirements. For the reasons mentioned above, Elia is not in favor for an ex-post prequalification.

2.3.2. New Design Proposal

In this section is presented Elia's new design proposal on prequalification for participating to aFRR and mFRR capacity auctions. It can be split up into three points:

1. the reduction of the PQ test time-window
2. the allowance of asymmetric PQ tests
3. and the BSP switch facilitation.

The reasoning behind these changes is twofold:

1. The ownership of the prequalified volume will shift from the BSP to the Grid User (when possible)
2. Amend the prequalification process to lower barriers to the participation of new and existing technologies to capacity auctions

2.3.3. Reduction of the PQ Test time-window

Elia understood the market concern on the 24h availability that is required to perform a PQ test, jeopardizing Market Parties to valorize their flexibility and putting it at Elia's disposal in the FRR capacity auctions.

To resolve this, **Elia proposes to lower the time-window during which the PQ test can be triggered, from 24h to 4h** (not necessarily a given CCTU). This change will ease the prequalification for all actors, reducing associated costs. Besides, the 4-hour window is deemed sufficient for the test to remain unpredictable (i.e., the BSP cannot precisely plan the delivery and still has to timely react to the signal of the TSO).

The newly prequalified volumes will be valid for all CCTUs (just like the AS IS design). As it is the case today, **BSPs are expected to consider the actual availability of the volume in their capacity and energy bidding strategies: if they do not, they expose themselves to penalties resulting from availability tests and/or activation controls.**

Figure 6 illustrates an example of such time-window reduction. The example is done with a theoretical wind power generation but holds for any generation/consumption technology. In the AS IS design, the BSP is only guaranteed to prequalify 15 MW if it complies with all requirements of the test. If the BSP was willing to prequalify more, it would be more likely to fail the test. In the new design proposal, the BSP may choose a 4h time-window such that it is given the opportunity to maximize the expected capacity to be prequalified.

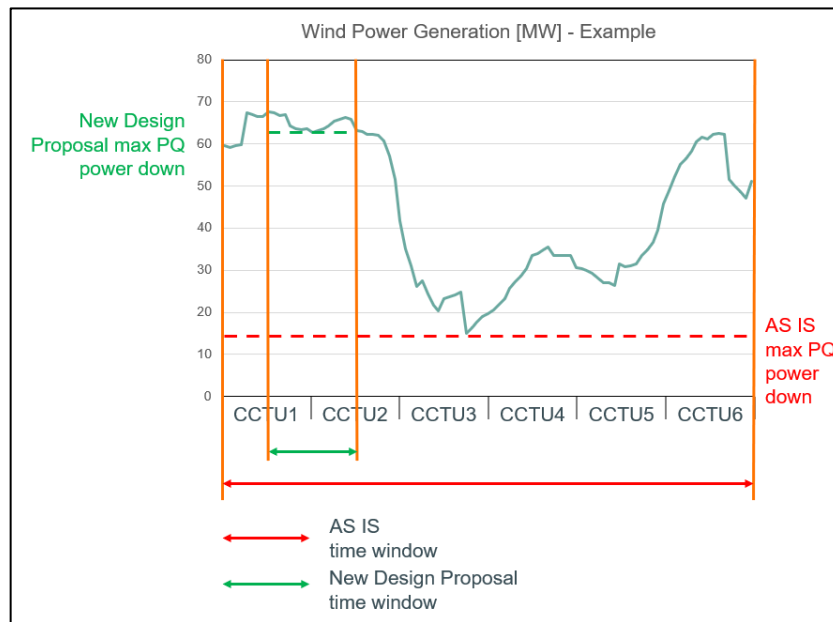


Figure 6 – Illustration of the PQ test time-window reduction

2.3.4. Asymmetric PQ Tests

In the AS IS design, it is not allowed to prequalify asymmetric upward and downward capacities. In order to allow the possibility to associate a DP with different upward and downward prequalified powers, Elia proposes to run 2 independent PQ tests in a row, not necessarily in a predefined order.

Figure 7 compares the AS IS vs TO BE designs for a 25 MW / 100 MWh battery is that willing to prequalify 50 MW Up and 25 MW aFRR Down.

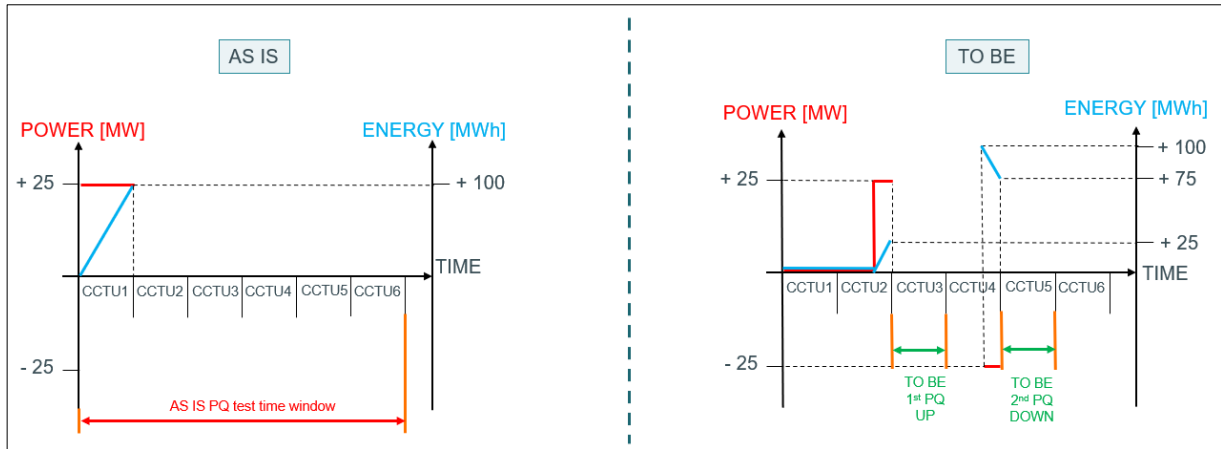


Figure 7 – AS IS vs TO BE asymmetric PQ tests

2.3.5. BSP Switch Facilitation

One of the strongest concerns of the market regards the difficulty for a Grid User to change BSP. With the AS IS design, when a DP goes from one BSP portfolio to another, a new PQ test must be performed to allow the new BSP to increase the maximum volume it can bid in capacity auctions. This may lead to some lock-in effects as the organization of a PQ test can be costly. Moreover, if both BSPs are able to steer the asset in the same way, the 2nd PQ test does not bring much additional information or assurance for Elia.

Therefore, Elia considers the transfer of prequalified volume from the previous BSP to the new one (“BSP switch facilitation”). **However, such BSP switch facilitation would not be always straight-forward and this is why Elia restricts this possibility to the DPs individually prequalified and to the DPs prequalified in a group of which Elia can clearly associate a specific contribution to the transferred DP.**

With that in mind, Elia proposes to ease the BSP switch for prequalified DPs for which the individual contribution during the PQ test can be deduced. In all other cases, a new PQ test must be performed before increasing the maximum volume that can be offered in FRR capacity auctions after a BSP switch.

When the individual contribution of the DP can be assessed, the new BSP is allowed to immediately increase the maximum volume it can offer in FRR capacity auctions accordingly. The prequalified volume ownership will therefore shift from the BSP to the GU, except when the PQ test has been done via a synthetic profile, i.e., when the individual contribution of each DP taking part in the PQ test cannot be determined.

It is of Elia’s knowledge that the majority of DPs that were used in PQ tests belong to the former case, therefore answering market concerns.

3. Penalties

3.1 Foreword

To ensure a good quality of the FRR services, Elia applies several controls and associated penalties within different timeframes. The controls and penalties in the scope of this incentive³, with the products on which each penalty applies and the goal of the control, are given in Table 1.


In order to give Market Parties the right incentives to deliver the service with a sufficient quality level, a hierarchy between the different penalties is needed. For instance, the penalty for MW Made Available should be lower than the penalty linked to a failed availability test or the activation control, in order to incentivize the BSP to adequately report its unavailabilities. This way, Elia has the best view on the available capacity before requesting it in real time. However, following the bilateral meetings that Elia had with the interested Market Parties, it was reported that in certain situations, there is a possibility of arbitrage between the different controls and their associated penalties. For example, for the penalty for MW Made Available, when the number of non-compliant CCTUs in the rolling-window is too large, the BSP is no longer incentivized to report the unavailability, but rather to take the risk to be penalized via the availability test or the activation control.

It is not the goal of the penalty schemes to incentivize such arbitrage between the different controls and their associated penalties. Nevertheless, Elia acknowledges that the current design of the Penalty for MW Made Available and that linked to activation control aFRR may lead to such arbitrages and, in certain cases (detailed later in this report) do not adequately penalize the BSP.

In the following sections of this chapter, for each penalty considered the AS IS design is first reminded. Then, market feedback and main design issues are listed along with Elia's position on the matter. Finally, the new design proposal for each considered penalty is presented.

³ There were no concerns or feedbacks expressed on the Penalty for aFRR/mFRR Missing MW (due to a failed availability test) following the 1st workshop, so the current design is not recalled in this report. For an in-depth explanation, please refer to the relevant T&C BSP FRR. However, this penalty is important in the context of the penalties calibration discussed in Chapter 4, which is why it is mentioned in Table 1.

Table 1 – Goal of the different penalties

	Context/ Control	Penalty	Products on which the penalty applies	Goal
 Closer to RT	Submission of aFRR/mFRR Contracted En- ergy Bids	Penalty for aFRR/mFRR Made Availa- ble	aFRR or mFRR contracted bids	✓ The goal of this penalty is to ensure that the ca- pacity awarded in the capacity auction is availa- ble via contracted energy bids. ✓ The penalty scheme should give the BSP the in- centive to adequately report its unavailabilities.
	Availability control	Penalty for aFRR/mFRR Missing MW	aFRR or mFRR contracted bids	✓ The goal of this penalty is to ensure that the balancing capacity bids are reliable, i.e., that the capacity obligation is fulfilled. It makes par- ticularly sense for contracted bids seldomly ac- tivated (end of mFRR MOL, e.g.). ✓ This penalty should give a strong incentive to pro- vide awarded capacity to Elia, and should be rather high as it is a punctual test (max 12 times/year)
	Activation con- trol for aFRR	Penalty for aFRR Energy Discrepancy	All aFRR energy bids	✓ The goal of this penalty is to ensure that the balancing energy bids are reliable.

3.2. Penalty for MW Made Available

3.2.1. AS IS Design

The penalty principle for MW Made Available is the same for both aFRR and mFRR. To avoid any confusion and redundancy, only the AS IS design for aFRR is explained below.

After the capacity auction Gate Closure Time (GCT), all aFRR Awarded leads to an obligation to submit contracted energy bids in the energy auction of the corresponding CCTU, for a volume equal to the aFRR Awarded (in both directions). If Elia observes that the aFRR Made Available per aFRR Capacity Product is lower than the aFRR Obligation for a quarter-hour, Elia applies penalties per aFRR Capacity Product as described below.

The penalty is calculated in the following way:

$$P_{aFRR \text{ Made Available}}(\text{Month } M) = \sum_{\text{All CCTU of Month } M} P_{aFRR \text{ Made Available}}(\text{CCTU})$$

$$P_{aFRR \text{ Made Available}}(\text{CCTU}) = \#CCTU_{\text{non-compliant}} * MW_{\text{not made available}} * CP_{WA}$$

Where:

- **All CCTU of Month M**
 - All CCTU of Month M for which the BSP has a positive aFRR Obligation for the concerned aFRR Capacity Product;
- **#CCTU_{non-compliant}**
 - The number of CCTU for which a penalty related to the aFRR Made Available for the concerned aFRR Capacity Product applies for the period comprised between Day D-29 until Day D (i.e., 30 Days), where Day D is the date of the concerned non-compliance with aFRR Made Available;
- **MW_{not made available}**
 - This value, in MWh, is determined as follows:
 - i. For each quarter-hour of the concerned CCTU, the difference between the aFRR Obligation for the concerned aFRR Capacity Product and the corresponding aFRR Made Available is determined;
 - ii. The differences established in point (i) for each quarter-hour are summed;
 - iii. The sum established in point (ii) is divided by 4 to obtain the MW_{not made available}.
- **CP_{WA}**
 - The weighted average of capacity prices corresponding to all aFRR Capacity Bids of the concerned aFRR Capacity Product awarded to the BSP for the period comprised between Day D-29 until Day D (i.e., 30 Days), where Day D is the date of the concerned non-compliance with aFRR Made Available. The weight is the aFRR Awarded for the concerned aFRR Capacity Bid.
 - In case no aFRR Capacity Bid has been awarded to the BSP for the period comprised between Day D-29 until Day D (i.e., 30 Days), where Day D is the date of the concerned non-compliance with aFRR Made Available, CP_{WA} is equal to the average price of the capacity auction corresponding to the CCTU for which the non-compliance is observed.

Example:

- In Month M, a BSP is awarded 10 MW in aFRR capacity auctions, in the upwards direction, for every CCTU of the month, and CP_{WA} = 20 €/MW/h;
- For CCTU3 of Day D-5, BSP is remunerated 10 MW * 4h * 20 €/MW/h = 800 € and submits the aFRR Made Available as illustrated in Figure 8, and listed in Table 2;
- BSP has already 2 non-compliant CCTUs earlier in the month.

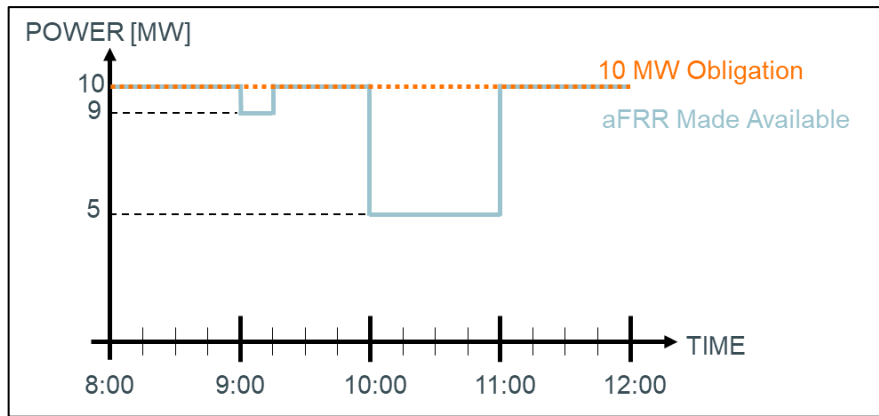


Figure 8 – aFRR Made Available of the BSP for CCTU3, Day D-5

Table 2 – aFRR Made Available of the BSP for CCTU3, Day D-5, and $MW_{not\ made\ available}$ calculation

Non-compliant QHs of CCTU2	9:00-9:15	10:00-10:15	10:15-10:30	10:30-10:45	10:45-11:00
aFRR Obligation [MW] (1)	10	10	10	10	10
aFRR Made Available [MW] (2)	9	5	5	5	5
(1) – (2)	1	5	5	5	5
$MW_{not\ made\ available}$ [MWh]	$= \frac{1}{4} * (1+5+5+5+5) = 5.25$				

The penalty for the non-compliance of the Obligation linked to that CCTU is therefore equal to:

$$\begin{aligned}
 P_{aFRR\ Made\ Available}(CCTU3, Day\ D - 5) &= \# CCTU_{non-compliant} * MW_{not\ made\ available} * CP_{WA} \\
 &= 3 * 5.25 * 20 \\
 &= 315 \text{ €}
 \end{aligned}$$

For the sake of clarity, the penalty settlement occurs monthly, while the rolling-window to calculate the $\#CCTU_{non-compliant}$ and CP_{WA} extends from one month to another (so it does not start again at the start of the next month).

3.2.2. Main Design Issues and Market Feedback

The main feedbacks and concerns that Elia received on the penalty for MW Made Available following the latest Public Consultations on the T&C BSP aFRR and mFRR, and the bilateral exchanges between the stakeholders and Elia are summarized below:

1. The penalty evolves quadratically after each non-compliant CCTU in the rolling window, due to the $\#CCTU_{non-compliant}$ factor. This means that several non-compliant CCTUs lead to a large penalty, which may create situations where the BSP can arbitrate between penalties, i.e., it may prefer to not report the unavailabilities and rather take the risk to be tested (via an availability test) or be activated (via activation control).
2. The penalty linked to a given non-compliant CCTU is function of previous non-compliant CCTUs in the rolling window. For instance, the penalty is greater for 10 times 1 MW not made available than 1 time 10

MW not made available. Also, an asset outage may impact the remuneration of other assets in the pool of the BSP.

3. Other feedbacks received:
 - a. Some BSPs suggest introducing a flat rate;
 - b. The rolling window is too large, some BSPs preferring a rolling window as small as possible, as it results in overly conservative trading behavior, even after the BSP resolves an unavailability issue, leading to reduced liquidity and ultimately higher costs for the system;
 - c. The penalty formula is too complex and raises difficulties in explaining it to BSP's customers.

Elia's position

1. Quadratic evolution of the penalty & incentive not to declare unavailabilities

Elia agrees with the observation that the quadratic evolution of the penalty evolves leads to significant penalties after a few non-compliant CCTUs. The fact that some BSPs would not declare all unavailabilities because they would rather take the risk to be tested or activated is very troublesome for Elia as it is not the goal of the penalty schemes to incentivize such arbitrage between the different controls and their associated penalties. On the other hand, a too low penalty for MW Made Available would not give the BSP the incentive to respect its Obligations, jeopardizing the relevance of the FRR capacity auctions. The point is that the BSP should have sufficient confidence in the availability of its assets (or sufficient incentives to find back-up solutions).

So in order to respond to these points, Elia proposes to:

- i. Keep a progressive penalty scheme in order to make a distinction between exceptional and frequent unavailabilities
- ii. Avoid penalty levels that provide wrong incentives, while ensuring responsible behavior of the BSPs in the capacity auctions

2. Penalize missing volume the same way whatever the number of CCTUs it is spread over

Elia agrees that a given missing volume over the month should be penalized to the same amount, whatever the number of CCTUs that missing volume is spread over. This is currently not the case, due to the $\#CCTU_{non-compliant}$ factor in the penalty formula. With the current penalty scheme, there is a significant difference between, e.g., 2 FOs and a few "small" unavailabilities. **Elia pursues its role of market facilitator and seeks for a level playing field on its balancing markets.** To this end, Elia proposes to re-design the penalty for MW Made Available to associate a given missing volume to the same penalty level (within a given timeframe), based on an average compliance level over a rolling-window.

3. Other feedbacks

- Elia proposes to keep the progressivity in the penalty to make the distinction between a BSP having one unavailability from time to time (due to a Forced Outage, e.g.), and a BSP structurally failing in respecting its Obligations.
- If the rolling window is too short, Elia expects the BSP to not have the incentive to respect its Obligations, as a given unavailability would not significantly impact the BSP remuneration, or at least for long enough. This would lead to an overly risky behavior from the BSP in the beginning of the rolling window, which would oblige Elia to apply more severe penalties than today for the same amount of missing volume, which is undesired. On the other hand, Elia does not want a too

long time-window either as it would lead to an overly conservative behavior from the BSP, leading to lower liquidity in the market.

- Elia is conscious of the complexity of the penalty schemes and considers such complexity in the new penalty scheme proposals. Elia strives to design a *simple* penalty formula while considering the intrinsic complexity of the balancing markets, preventing gaming or arbitrage opportunities from BSP and at the same time giving the BSP the right incentives to deliver the service properly.

3.2.3. New Design Proposal

The new design proposal for the penalty for MW Made Available, applicable for both aFRR and mFRR, is the following. Note that the formulas are presented for aFRR but are the exact same for mFRR.

$$Penalty_{aFRR \text{ Made Available}}(Month M) = \sum_{All \text{ CCTU of Month } M} Penalty_{aFRR \text{ Made Available}}(CCTU)$$

Where $Penalty_{aFRR \text{ Made Available}}(CCTU)$ magnitude depends on the *average compliance* level the BSP is in during the day of the given CCTU. Based on the average compliance level, the penalty formulas are the following:

$$Level 1: Penalty_{aFRR \text{ Made Available}}(CCTU) = factor_1 * MW_{not \text{ made available}} * CP_{CCTU}$$

$$Level 2: Penalty_{aFRR \text{ Made Available}}(CCTU) = factor_2 * MW_{not \text{ made available}} * CP_{CCTU}$$

Where:

- $factor_1, factor_2$ are constants whose calibration is discussed in Chapter 4
- $MW_{not \text{ made available}}$ is the difference between the Obligation and MW Made Available of the given CCTU, in MWh
- CP_{CCTU} is the weighted average capacity price of the volumes awarded to the BSP for the concerned CCTU

The average compliance of the BSP, for Day D, in each direction, is calculated in the following way:

$$average \ compliance_{up}(D) = \frac{\sum_{Qhs \text{ in last } 15D}^{Qhs \text{ in future } 15D} \min(Nominated \ volume_{Qh_{up}}, Obligation_{Qh_{up}})}{\sum_{Qhs \text{ in last } 15D}^{Qhs \text{ in future } 15D} Obligation_{Qh_{up}}}$$

Where:

- Qhs in last 15D are all the Qhs of all the CCTUs for which BSP has had an Obligation, in the given direction, in the last 15 Days before Day D
- Qhs in future 15D are all the Qhs of all the CCTUs for which BSP will have an Obligation, in the given direction, in the future 15 Days after Day D
- $Nominated \ volume_{Qh_{up}}$ is the last volume the BSP has made available in the given Qh, in the given direction
- $Obligation_{Qh_{up}}$ is the Obligation of the BSP for the CCTU comprising the given Qh, in the given direction

For the sake of clarity, the average compliance of Day D, in each direction, also comprises the Qhs of day D, if applicable.

Elia considers the new design proposal to address market concerns because:

1. The way the penalty evolves in case of significant non-compliances is not anymore quadratic, and while the penalty level a BSP is in depends on multiple CCTUs (and thus “non-compliant” CCTUs), Elia expects the penalty amount related to a no respect of a given Obligation to not reach level of penalties which provide an incentive to not report unavailabilities, as it is only function of the number of MW not made available linked to that CCTU and the weighted average capacity price of the CCTU, thus suppressing the #CCTU_{non-compliant} factor.
2. For a given missing volume, the penalty is not function of the number of CCTUs the missing volume is spread over.
3. The *average compliance* assigns more weight to large Obligations / nominated volume, ensuring smaller relative unavailabilities do not carry equal weights. Also, summing over Qhs clarifies the calculation within a CCTU.
4. The penalty level of a given CCTU is still in function of previous CCTUs, but also future ones. This shift in the 30-day rolling window limits the BSP to arbitrate the risk it takes when submitting capacity bids. Also, the rolling window is large enough to prevent the BSP to adopt over risky behavior in the beginning of the rolling window.

3.3. Activation Control aFRR

Elia continuously controls the quality of aFRR delivery via the activation control aFRR, for contracted and non-contracted energy bids. The goal of the activation control is to check the quality of the aFRR Supplied to meet Elia’s needs to balance the Belgian LFC block.

3.3.1. AS IS Design

The penalty resulting from aFRR Energy Discrepancy is calculated on a monthly basis as follows:

$$aFRR \text{ Energy Discrepancy penalty}(M) = 1.3 * \frac{aFRR \text{ Energy Discrepancy}(M)}{aFRR \text{ Energy Requested}(M)} * remuneration(M)$$

For a detailed explanation of all the factors in the formula and how they are calculated, please refer to the T&C BSP aFRR. Only the remuneration factor is explained below as it is significantly impacted in the new design proposal.

Figure 9 illustrates what the aFRR Energy Discrepancy consists of.

Determination of remuneration(M)

The monthly remuneration is the sum of the monthly capacity remuneration and the monthly absolute value of the energy remuneration, i.e.:

$$remuneration(M) = remuneration \text{ aFRR Awarded} + |remuneration \text{ aFRR Requested}|$$

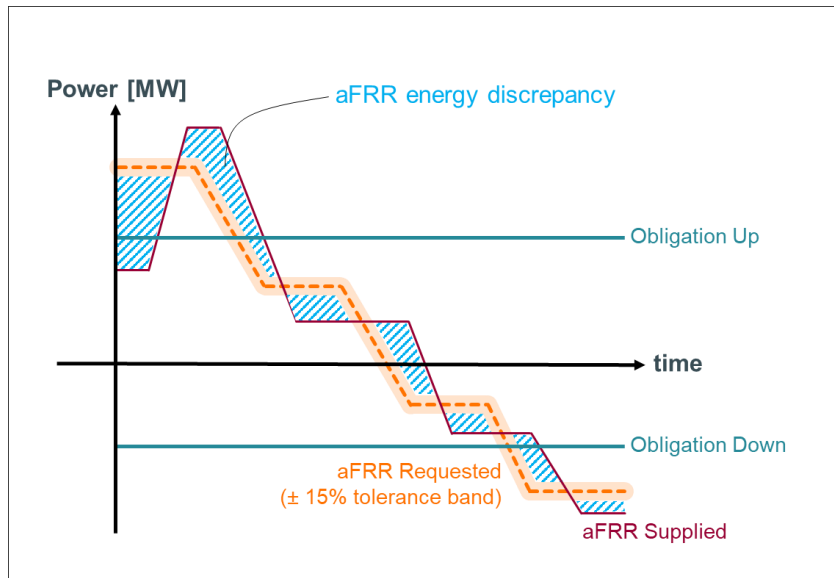


Figure 9 – Illustration of the AS IS activation control aFRR design

3.3.2. Main Design Issues and Market Feedback

Below may be found the main feedbacks or concerns that Elia received on the penalty for activation control aFRR following the latest Public Consultations on the T&C BSP aFRR and mFRR, and the bilateral exchanges between the stakeholders and Elia in the framework of this incentive. A more in-depth explanation for each feedback point is given afterwards.

1. The monthly granularity does not capture the value of the service at the time of the discrepancy and may lead to situations of arbitrage when large price spreads occur during a given month.
2. The capacity remuneration is affected even in case of overdelivery.

In addition to those feedbacks, Elia identified one additional issue regarding the AS IS design of the activation control aFRR:

3. A discrepancy linked to non-contracted bids impacts capacity remuneration.

1. Monthly granularity issue

To illustrate the monthly granularity issue, one may consider the following theoretical example:

A BSP has 10 MW of aFRR Up on all CCTUs of the 1st and 4th weeks of Month M with:

- High capacity and energy prices at the start of the month
- Low capacity and energy prices at the end of the month
- 100% activation of all the energy bids

The remuneration of the BSP is calculated in Table 3.

Because the penalty for activation control aFRR is function of the remuneration of the whole month, the BSP may be incentivized to bid less capacity or energy at the end of the month to avoid that a discrepancy at the end of the month influences the high remuneration of the beginning of the month.

Consider 0% failed activation for week 1, and y% for week 4. The resulting penalty linked to activation control aFRR is explained in Table 4.

If one plots the penalty as function of the share in failed activation in week 4 (Figure 10), it can be seen that the BSP loses all remuneration of week 4 due to a failed activation of 32% during week 4. If the failed activation is greater, it loses remuneration of week 1.

Elia is of the opinion that a penalty resulting from a failed activation, during a given time period (CCTU or QH, e.g.), should be as much as possible function of the energy requested, the energy discrepancy, and the remuneration of the given time period.

Table 3 - Remuneration of BSP

Period	# of CCTUs	Volume awarded per CCTU [MW]	Capacity Price [€/MW/h]	Capacity Remuneration [k€]	Energy Price [€/MWh]	Energy Remuneration [k€]
WEEK 1	42	10	200	$200 \times 10 \times 4 \times 42 = 336$	350	$350 \times 10 \times 4 \times 42 = 588$
WEEK 4	42	10	50	$50 \times 10 \times 4 \times 42 = 84$	150	$150 \times 10 \times 4 \times 42 = 252$

Table 4 - Penalty for activation control aFRR after week 1 and after week 4

Period	Remuneration (M) [k€]	aFRR Energy Requested (M) [MW]	aFRR Energy Discrepancy(M) [MW]	Penalty activation control [k€]
WEEK 1	$336 + 588 = 924$	$10 \times 4 \times 42 = 1680$	0	/
WEEK 1 + WEEK 4	$924 + 84 + 252 = 1260$	$1680 + 10 \times 4 \times 42 = 3360$	$0 + y\% \times 1680$	$1.3 \times (0 + y\% \times 1680) / 3360 \times 1260$

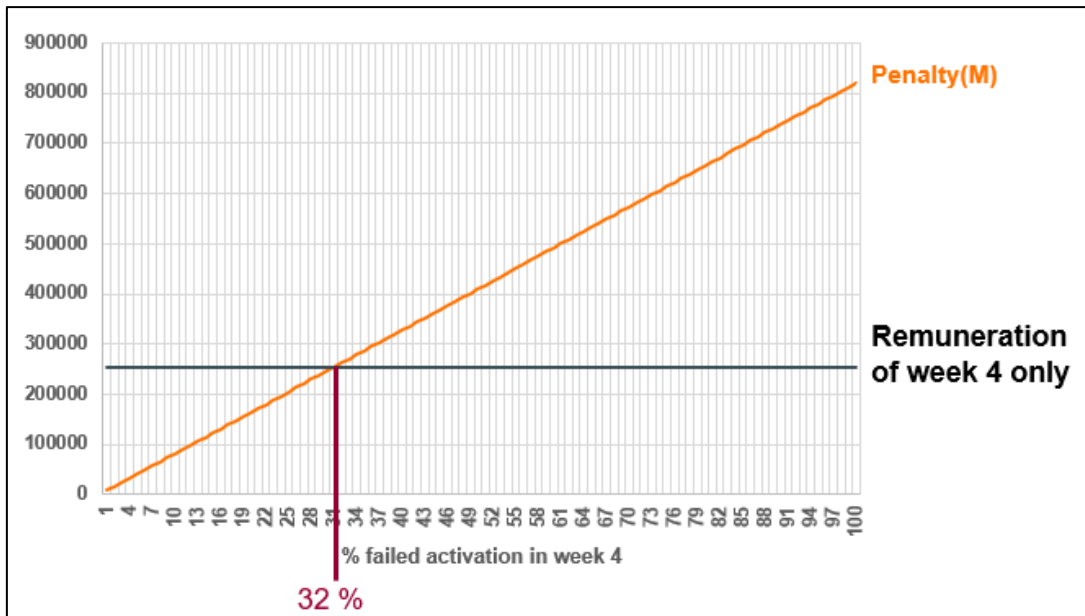


Figure 10 - Penalty as function of share of failed activation in week 4

2. Overdelivery penalizes capacity remuneration

Consider a BSP having a 10 MW Obligation for a CCTU of a given day. During the CCTU, in a given Time Step, Elia requests the BSP to activate 5 MW, but the aFRR Supplied is 7 MW instead. In the current aFRR energy discrepancy calculation, the BSP is penalized proportionally to capacity remuneration and energy remuneration. However, the BSP, for this Time Step, has met its Capacity Obligation since it delivered (at least) the volume requested by Elia during that Time Step.

In this regard, in case of overdelivery, it would make most sense to only penalize the BSP for the energy component and to remove the capacity component from the penalty. This point is included in the new design proposal of the activation control aFRR, which is described further in the report.

3. Non-contracted bids discrepancy impacts capacity remuneration

Consider a BSP, in Month M, having some remuneration linked to aFRR Awarded, i.e., following capacity auctions. Later in the Month, for a given CCTU, the BSP has no Capacity Obligation and submits non-contracted energy bids. In the AS IS design, if the BSP has an Energy Discrepancy during that CCTU, the calculation of the penalty related to that Energy Discrepancy will be impacted by the capacity remuneration from the beginning of the month, **even though the BSP had no Capacity Obligation during the given CCTU. While Elia believes it's important to set the framework for the development of more non-contracted Energy Bids in aFRR, the current penalty linked to activation control aFRR doesn't provide the right incentives to BSPs to submit additional non-contracted Energy Bids.**

3.3.3. New Design Proposal

The new design for the penalty for activation control aFRR that Elia proposes in the framework of this incentive may be summarized in two points:

1. Decoupling of the capacity and energy controls and penalties.
2. Change the granularity of the penalty related to energy to QH and the granularity related to capacity to 1 week.

With these two major changes, Elia is confident that the new design addresses the main issues and/or concerns expressed by Market Parties or identified by Elia.

The principles of the new design proposal as well as the rationale behind the proposal is explained in this section. The calibration of the penalties in order to give BSPs the right incentives is explained in Chapter 4.

Energy penalty

The proposal for the energy penalty is similar to the current design, with two changes:

1. Change from monthly granularity to quarter-hour granularity for the penalty calculation (the control is still continuous).
2. In terms of remuneration, the new energy penalty formula is only function of the absolute value of the energy remuneration of the corresponding quarter-hour (|remuneration aFRR Requested|).

The aFRR Energy Discrepancy penalty, for a given QH, is therefore as follows:

$$\begin{aligned} & aFRR \text{ Energy Discrepancy penalty}(QH) \\ &= factor_{energy} * \frac{aFRR \text{ Energy Discrepancy}(QH)}{aFRR \text{ energy requested}(QH)} * |remuneration aFRR Requested(QH)| \end{aligned}$$

Where $factor_{energy}$ is a constant whose calibration is discussed in Chapter 4.

This penalty design already solves the monthly granularity issue, and the fact that non-contracted energy bids currently impact capacity remuneration. Firstly, the QH granularity is such that a failed activation during a given QH only impacts the energy remuneration of that QH, limiting potential situations of arbitrage in case of large price spreads in a given month. Secondly, the energy penalty being proportional to energy remuneration only, a failed activation of non-contracted bids would no longer affect capacity remuneration.

Capacity penalty

With the decoupling between capacity and energy controls, there is a need to introduce a new penalty linked to capacity only, with the introduction of two new concepts: the aFRR Capacity Requested and the aFRR Capacity Underdelivery.

The aFRR Capacity Discrepancy penalty, for a given week W, is as follows:

$$\begin{aligned} & aFRR \text{ Capacity Discrepancy penalty}(W) \\ &= factor_{capacity} * \frac{aFRR \text{ Capacity Underdelivery}(W)}{aFRR \text{ Capacity Requested}(W)} * remuneration aFRR awarded(W) \end{aligned}$$

Where $\text{factor}_{\text{capacity}}$ is a constant whose calibration is discussed in Chapter 4. The motivation for the weekly granularity for capacity penalty is also given in Chapter 4.

aFRR Capacity Requested

Similarly to the aFRR energy requested(QH) in the denominator of the energy penalty formula, there is a need to define capacity-wise what Elia requests to the BSP. Figure 11 illustrates what the aFRR Capacity Requested consists of.

The selection of a capacity bid following a capacity auction leads to a Capacity Obligation from the BSP to submit at least the same volume for all the QHs of the corresponding CCTU. The BSP is allowed to submit non-contracted Energy Bids in addition to the contracted Energy Bids (which must correspond to its Capacity Obligation). This means that it is possible that the BSP is requested to activate more power than its Obligation (in each direction), as illustrated in the far-left and far-right sides of Figure 11. However, to penalize capacity adequately, only the volume corresponding to the remunerated capacity should be considered, which is why the aFRR Capacity Requested is capped to the Capacity Obligation in both directions (defined as “Obligation Up” and “Obligation Down” for positive and negative directions respectively), if it applies.

For a given CCTU, in a given direction, for the Time Steps where aFRR Supplied is greater than the BSP’s Capacity Obligation, the BSP should not be exposed to a penalty linked to its capacity remuneration since it has respected its Obligation in the corresponding direction.

The aFRR Capacity Requested, for a given week, in MWh, is therefore as follows:

$$aFRR \text{ Capacity Requested}(W) = \sum_{\text{All } Ts \text{ over week } W} \frac{aFRR \text{ Capacity Requested}(Ts)}{900}$$

$$\text{Where } aFRR \text{ Capacity Requested}(Ts) = \begin{cases} \min(aFRR \text{ Requested}(Ts - 2); \text{Obligation Up}) & \text{if } aFRR \text{ Requested}(Ts - 2) > 0 \\ \min(aFRR \text{ Requested}(Ts - 2); -\text{Obligation Down}) & \text{if } aFRR \text{ Requested}(Ts - 2) < 0 \\ 0 & \text{if } aFRR \text{ Requested}(Ts - 2) = 0 \end{cases}$$

aFRR Capacity Requested(Ts) is in MW.

Where Obligation Up and Obligation Down are the capacity obligations in the upward and downward directions of the BSP in the CCTU comprising the given Time Step, Ts, respectively. They are always positive values.

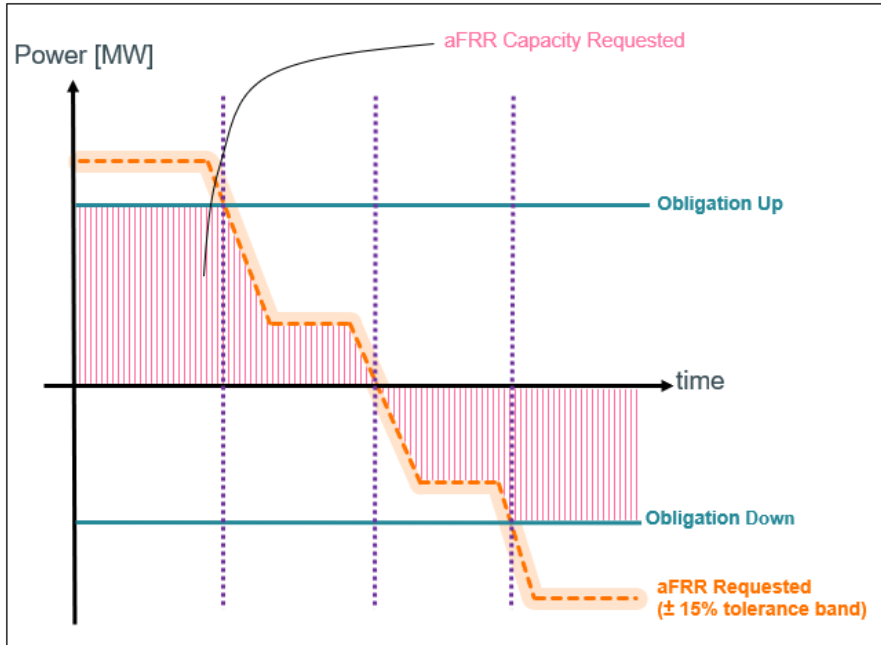


Figure 11 – Illustration of the aFRR Capacity Requested

aFRR Capacity Underdelivery.

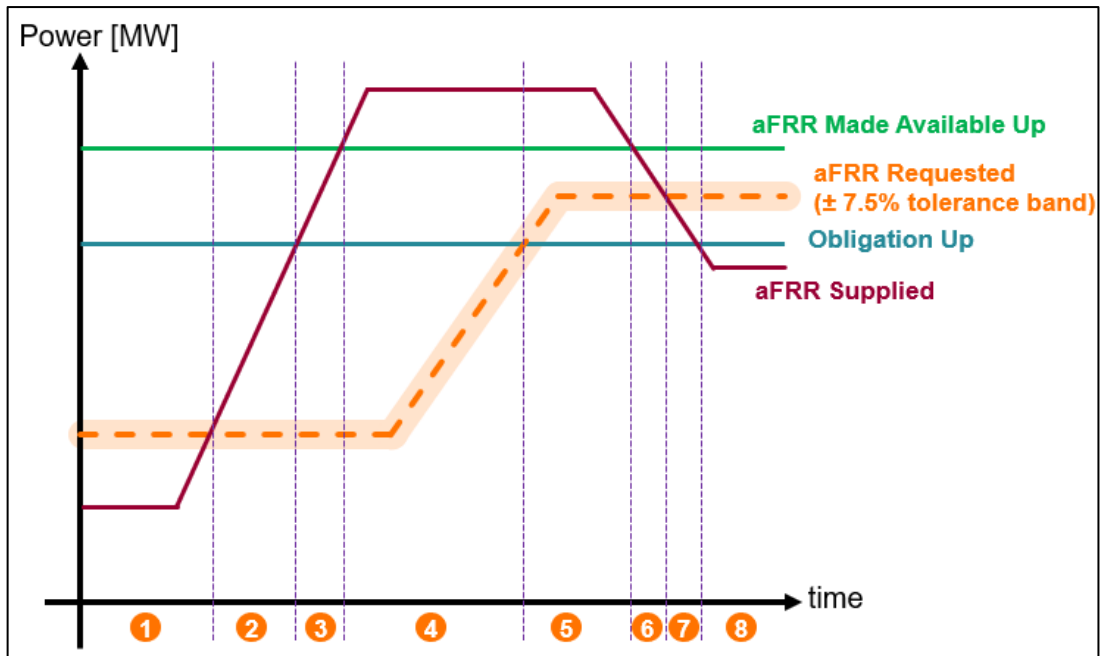


Figure 12 – The 8 unique situations that can happen when delivering aFRR

To come up with a definition for aFRR Capacity Underdelivery, Elia has investigated all possible relationships between the 4 relevant variables (in the upward direction but the rationale is the same in the downward one): aFRR

Made Available Up, Obligation Up, aFRR Requested, and aFRR Supplied. These are illustrated in Figure 12. Due to some constraints (for instance, the aFRR Requested can never be greater than the aFRR Made Available Up), there are in total 8 unique situations.

Elia then looked into each of these situations and assessed whether it makes sense to penalize BSP capacity-wise. **There are actually only 2 situations for which it makes sense: the 1st and the 8th one, i.e., when 2 conditions are met:**

- 1) the aFRR Supplied is lower than the aFRR Requested, and**
- 2) the aFRR Supplied is lower than the Obligation Up.**

In the 1st case, the BSP doesn't deliver the full volume of aFRR Requested, which is lower than the Obligation Up, justifying a penalty linked to the capacity remuneration. In the 8th case, it is the same rationale except that the aFRR Requested is greater than the Obligation Up, meaning BSP submitted non-contracted bids in addition to its Obligation.

Note that in the 7th case, for instance, while the aFRR Supplied is lower than the aFRR Requested, BSP would not be penalized capacity-wise since the aFRR Supplied is greater than the Obligation Up, therefore respecting its Obligation in the upward direction (BSP would still be penalized energy-wise, though).

Zoom-in on situations when aFRR Supplied and aFRR Requested have opposite signs

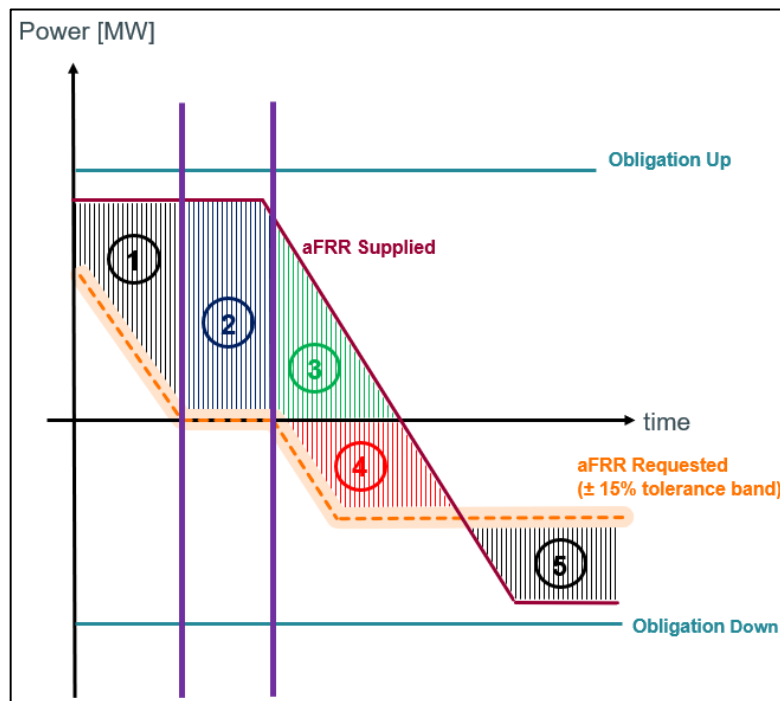


Figure 13 – Example where aFRR Supplied and aFRR Requested have opposite signs

Before defining the aFRR Capacity Underdelivery mathematically, one must consider situations where aFRR Supplied and aFRR Requested have opposite signs. This is illustrated in Figure 13.

- For the 1st and 5th areas, as discussed before, BSP should not be penalized capacity-wise since it has delivered more than what was requested, so there are no reasons for Elia to believe that the capacity is unavailable.

- For the 2nd area, BSP should not be penalized capacity-wise either since the aFRR Requested is equal to zero.

For the 3rd and 4th areas, BSP underdelivers. However, only the 4th area should be considered in the penalty calculation. Indeed, an activation in the opposite direction as that requested should not lead to additional capacity penalty, as this could lead to penalize more volumes than offered by the BSP in a given direction.

Resulting definition of aFRR Capacity Underdelivery

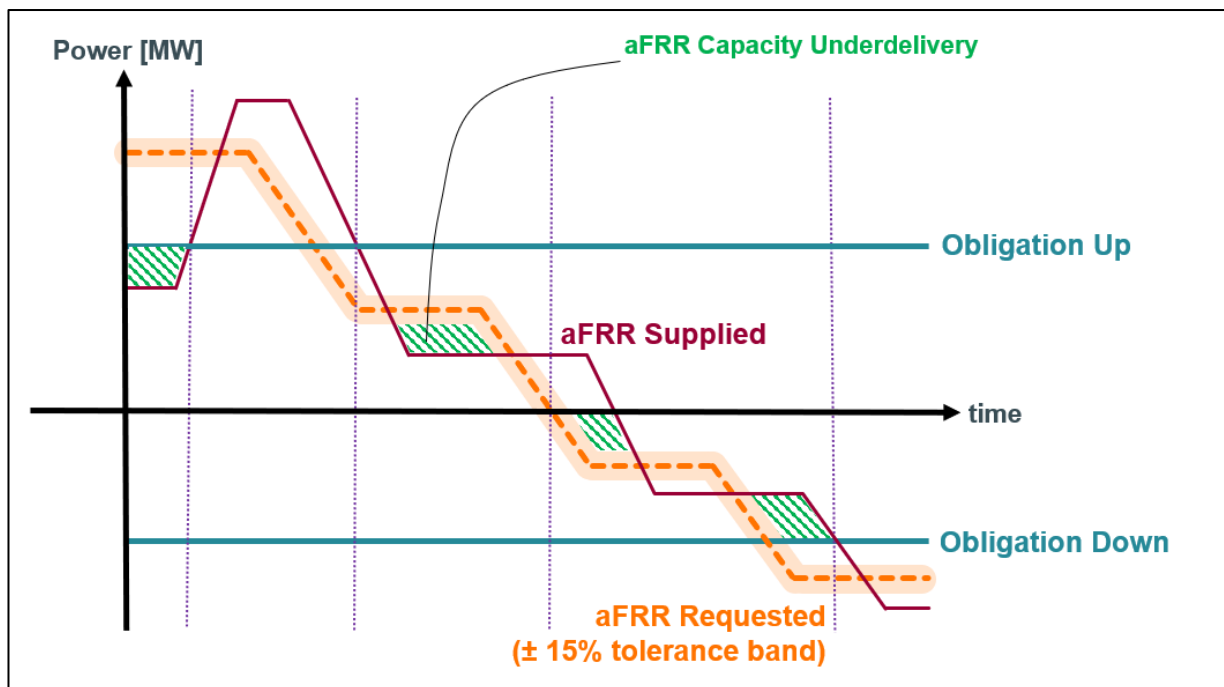


Figure 14 - aFRR Capacity Underdelivery illustration

Figure 14 illustrates the areas that are to be penalized capacity-wise based on the explanations given above. As explained, the first and last aFRR Capacity Underdelivery areas on Figure 14 are capped to Obligation Up and Obligation Down respectively since there are no capacity remunerations linked to the rest of the capacity requested during those Time Steps. As for the two other areas, the aFRR Capacity Underdelivery is capped to the aFRR Requested to adequately represent the underdelivery of the BSP: if, for instance, BSP has 10 MW Obligation Up, and Elia requests 5 MW but BSP only delivers 4 MW, it will be penalized only up to the aFRR Requested, that is, 5 MW, and not up to the Obligation Up. Indeed, considering the volume up to the capacity obligation could lead to discrepancies higher than 100% due to the capacity requested factor in the penalty formula. Also, it could give an incentive to the BSP to overdeliver, as a slight underdelivery would lead to a significant penalty when aFRR Requested is low (and hence during all ramping phases), which is undesired as well.

With the above rationale and Figure 14 in mind, **the aFRR Capacity Underdelivery, for a given week W, can be defined as follows:**

$$aFRR \text{ Capacity Underdelivery}(W) = \sum_{Ts \text{ over week } W} \frac{aFRR \text{ Capacity Underdelivery}(Ts)}{900}$$

Where:

- If aFRR Requested(Ts - 2) > 0:

$$\begin{aligned} aFRR \text{ Capacity Underdelivery}(Ts) &= \max\{ [\min(aFRR \text{ Requested}(Ts - 2); \text{Obligation Up}) \\ &\quad - \max(aFRR \text{ Supplied}(Ts); 0) - \delta_{perm}(Ts)] ; 0\} \end{aligned}$$

- If aFRR Requested(Ts - 2) < 0:

$$\begin{aligned} aFRR \text{ Capacity Underdelivery}(Ts) &= |\min\{ [\max(aFRR \text{ Requested}(Ts - 2); -\text{Obligation Down}) \\ &\quad - \min[aFRR \text{ Supplied}(Ts); 0] + \delta_{perm}(Ts)] ; 0\}| \end{aligned}$$

- If aFRR Requested(Ts - 2) = 0:

$$aFRR \text{ Capacity Underdelivery}(Ts) = 0$$

- $\delta_{perm}(Ts)$ is defined the same way as in the AS IS design

4. Penalties Calibration

In this section is first explained the rationale behind the way the factors in the penalty for MW Made Available and in the activation control aFRR are set. The motivation for choosing a weekly granularity to assess the aFRR capacity penalty in the new design of the aFRR activation control is also given. Then, a first proposition for the value of factor₁ and factor₂, and factor_{energy} and factor_{capacity} within the penalty for MW Made Available and the penalty for activation control aFRR, respectively, are presented.

4.1. Rationale to Calibrate the Penalty Factors

The rationale to calibrate the penalty factors holds in two principles:

1. Ensure the penalty for MW Made Available is *a/ways* lower than that linked to a failed availability test and/or activation controls aFRR and mFRR, so that the BSP is incentivized to notify its unavailabilities to Elia rather than taking the risk to be tested (via the availability test) or activated (thus being penalized via the according activation control penalty). Indeed, Elia would rather know in advance when part of its contracted capacity is unavailable before requesting it in real time.
2. The penalty regime must ensure that the BSP has an incentive to deliver the service. In other words, in case the BSP does not do so, the penalty is strictly higher than the remuneration. The values proposed below for factor₁ and factor_{energy} provide this incentive. As for the factor_{capacity}, it may be justified based on the computation of the aFRR Capacity Underdelivery that does not take away the BSP's capacity remuneration as systematically as in the current design, ensuring a quality level as good as today.

After implementing the new penalty designs, Elia will monitor the quality of delivery of the services as well as the penalty levels and will propose modifications of the factors if necessary.

Motivation for the weekly granularity of the aFRR capacity penalty formula

With unbundled capacity and energy controls for aFRR, there is a need to choose a granularity for the settlement of the capacity control. As much as it makes sense for the energy to go for a quarter-hour granularity, it would not be the case for capacity. Indeed, for a given direction, the Obligation in a given direction is constant throughout a CCTU. During that CCTU, depending on the amount of capacity made available by the BSP, its position in the MOL and the aFRR Elia requests, it may be that the BSP is not activated during that CCTU (or only for a part of its Obligation). Therefore, the granularity for the settlement of the capacity control must be large enough to assess the real availability of the capacity.

This is illustrated in Figure 15: if the granularity is too low (QH, e.g.), the BSP would not be adequately incentivized, as it would keep the main part of its capacity remuneration whereas it may not be delivering the service properly.

In Figure 15, out of the 16 QHs for which BSP a given Obligation in the upward direction ('Obligation Up'), the aFRR Requested is different from zero only over 4 QHs, and the BSP does not respect its capacity obligation given the definition of the aFRR Capacity Requested and aFRR Capacity Underdelivery (as defined in Section 3.3). There are therefore good reasons to believe that the capacity was not available during the other QHs of the CCTU either. With a QH granularity, the BSP would keep the main part of its capacity remuneration linked to that CCTU, which would not give the BSP the right incentive to deliver the service properly when it is requested to do so.

On the other hand, as explained in Section 3.3 a too large granularity leads to a risks of arbitrage in case of large price spreads during the time-window.

The analysis of historical data that Elia has made showed that a **weekly granularity** for the capacity control is a good trade-off between the two extremes. With a weekly granularity, the time-window is large enough to correctly assess the full availability of the capacity of the BSP, and not too large to limit potential arbitrage in case of large price spreads. This parameter will also be monitored by Elia, as the connection to the aFRR-Platform might impact the activation frequency of the aFRR Energy Bids

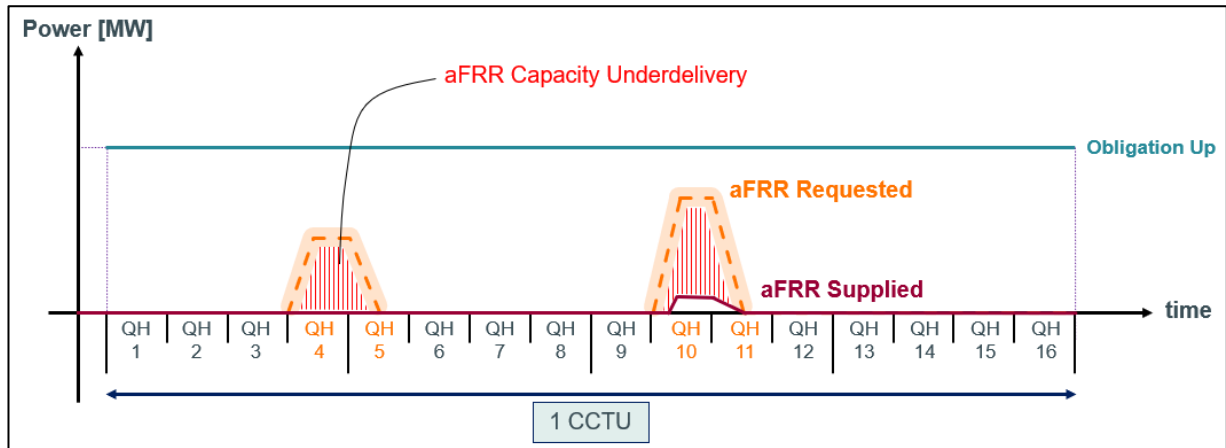


Figure 15 – Illustration of the granularity of the aFRR capacity control

4.2. Proposition of Values for the Penalty Factors

4.2.1. aFRR activation control penalty factors

Elia proposes the following constants for penalizing the capacity underdelivery and the energy discrepancy, as defined in Section 3.3.3:

$$factor_{capacity} = 2.5$$

$$factor_{energy} = 1.25$$

The motivation for choosing these factors holds in the following points:

1. The desired hierarchy between the different penalties is ensured, to limit arbitrage between the penalties and ensure that the BSPs are confident in the availability of their DPs.
2. For energy, the design is aligned with the mFRR activation control. For capacity, the volume of the discrepancy will be mechanically reduced. Therefore, the increase in factor is more necessary to guarantee the incentive to deliver the service adequately. However, the simulation did not consider a potential change in the BSPs' behavior, which is why the penalty levels will be closely monitored.

4.2.2. Penalty for aFRR MW Made Available factors

Elia proposes the following constants for the penalty for aFRR Made Available, in both directions:

$$factor_1 = 1.5$$

$$factor_2 = 3$$

Elia proposes the average compliance threshold at **95%**. In other words, when the BSP has, for a given day, an average compliance⁴ of 95% or better, it will be penalized at level 1 but if its average compliance drops below 95%, it be penalized at level 2.

The motivation for choosing these factors is the following: Elia has calculated the average compliance of the BSPs with the data of 2022 and has noticed that BSPs have an excellent average compliance distribution, as BSPs are often at 100% average compliance and the threshold of 95% is actually rarely hit. It is to be noted that the simulation did not consider a possible change in the BSPs behavior: with this new penalty design, BSPs will be better incentivized to report the unavailability of their DPs (by not submitting Energy Bids) as, on the one hand, the new penalty for the capacity underdelivery takes away a larger share of the capacity remuneration of the BSP than with the current design, and on the other hand, the new design proposal for the penalty for MW Made Available prevents too large penalty levels, thanks to the removal of the #CCTU_{non-compliant} factor.

The advantages of this calibration are the following:

1. Incentives are correct, leading a.o. to a possible improved image of the availability of energy bids, thanks to the hierarchy with the activation control.
2. Avoids very high penalties in some cases.
3. Incentivizes BSP to keep a high average compliance (thanks to the 2 penalty levels).

⁴ As defined in Section 3.2.3.

5. aFRR Availability Control

In this section, the design of the aFRR availability control is discussed. First, the AS IS design is reminded, then its associated issues and market feedback is given, and finally the new design proposal is presented.

5.1. AS IS Design

The availability of the aFRR capacity is monitored by Elia on the basis of availability tests. Availability tests only apply for aFRR Obligation and focus on testing the aFRR Capacity Requested. The goal is to test the availability of the capacity, not the ramping behavior or the follow-up of a setpoint.

An availability test consists of the activation of one or more aFRR contracted Energy Bid(s) for a duration of three quarter-hours, as shown in Figure 16. First and Third QHs are dedicated to the ramp-up and ramp-down, respectively (if the test is in the upwards direction), and during the second QH the aFRR Capacity Requested must be supplied by the BSP.

The BSP must use the Delivery Point(s) listed in the concerned tested aFRR Energy Bid(s) when performing the aFRR availability test.

Elia considers an availability test as failed if the BSP has failed to execute the communications foreseen, and/or if the BSP does not respect the compliancy criteria described hereunder.

Compliancy Criteria

For the second QH of the availability test, Elia determines the aFRR Power Supplied per Time Step “Ts”, as follows:

$$aFRR \text{ Power Supplied}(Ts) = \sum_{DP} [DP_{baseline, Ts_0} - DP_{measured}(Ts)]$$

Where **DP_{baseline, Ts₀}** is the last baseline received at the Time Step “Ts₀” at which the trigger of the availability test is sent by Elia, which means the baseline must be constant over the full period of the test. The rationale behind is to avoid a manipulation of the baseline during the test.

The availability test is failed if the aFRR Power Supplied is inferior (respectively inferior) to the aFRR Capacity Requested for more than 15 Time Steps in case of availability test in the upward direction (respectively downward direction).

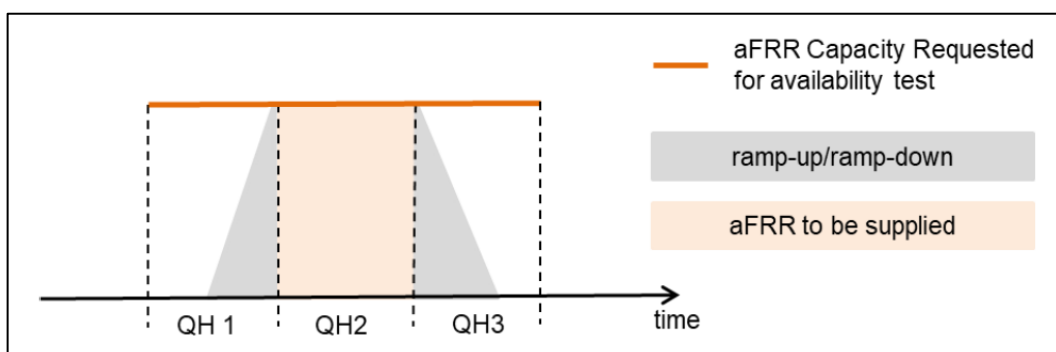


Figure 16 - aFRR availability test

5.2. Main Design Issues and Market Feedback

Several Market Parties have notified Elia of **the impossibility to maintain the baseline constant during the full period of the test, for various reasons**. Figure 17 **Error! Reference source not found.** illustrates an example of such impossibility to comply with the constant baseline requirement when an ID deal is fulfilled by the BSP during the test in the opposite direction of the tested capacity.

In T_{s0} , the test is triggered, meaning the BSP must *freeze* its baseline. However, BSP settled an ID deal for QH2 before the triggering of the availability test. Therefore, during QH2 of the test, BSP must also respect its ID deal, but if it keeps its baseline constant, it results in a failed test. If the BSP was allowed to modify its baseline (as illustrated in Figure 18), then it could succeed the test while respecting its ID deal.

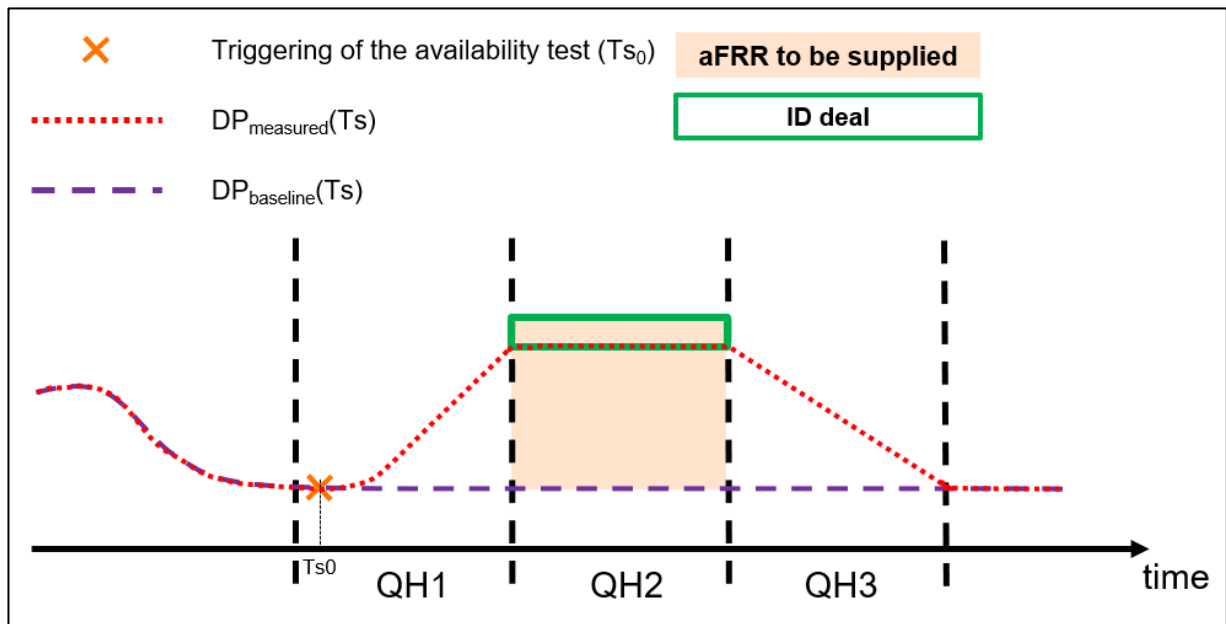


Figure 17 - ID deal occurring during aFRR availability test: constant baseline

5.3. New Design Proposal

The occurrence of an ID deal during the aFRR availability test is only one of the reasons why it may be justified for the BSP to modify its baseline (SoC management of a battery in line with its EMS, non or limited coordinable assets,...). **Elia proposes to authorize such baseline modification during the occurrence of an aFRR availability test, at the condition that the BSPs provides a sound ex-post justification to Elia within 7 working days following the test.**

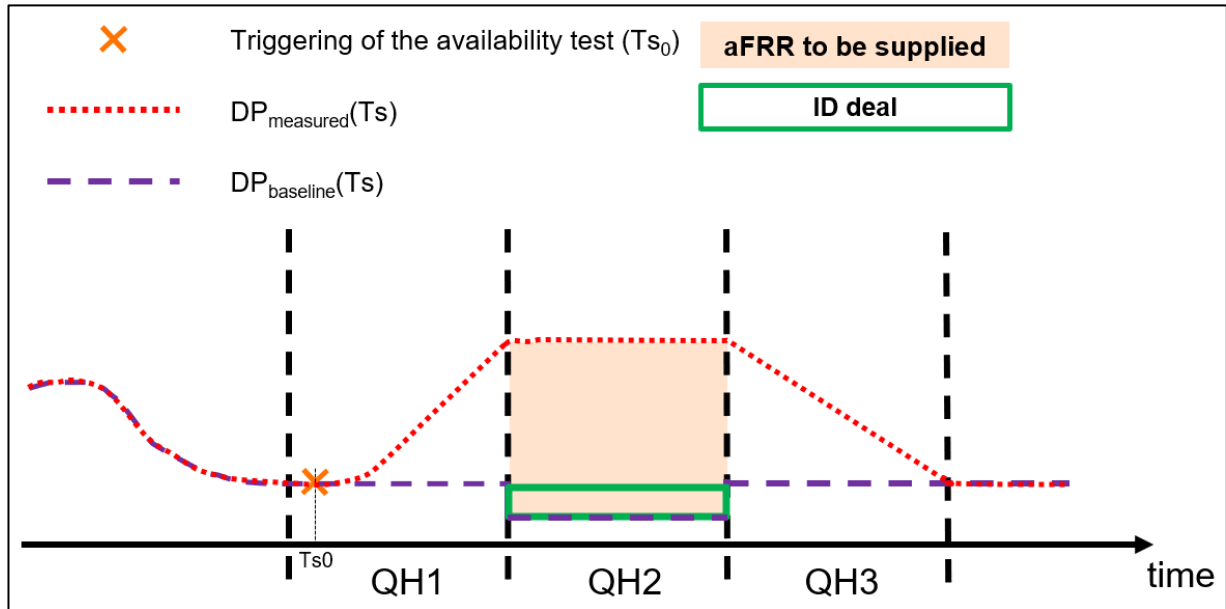


Figure 18 - ID deal occurring during aFRR availability test: baseline modification

6. Conclusion

In this report, Elia has reviewed the current design of the prequalification process, controls, and penalties related to the aFRR and mFRR services, and made proposals for a new PQ design as well as a change in the penalty for MW Made Available and in the penalty for activation control aFRR. To do so, Elia has, on the one hand, given the Market Parties the opportunity to address their feedback on the matter and, on the other hand, has studied on its side potential design issues linked to today's penalty schemes.

Elia is confident that the new prequalification design proposal will help reduce barriers to the participation to aFRR and mFRR services, facilitating the valorization of the flexibility of the stakeholders.

Elia is also confident that the new penalty design proposal is an improvement on several levels and addresses Market Parties' concerns.

Elia welcomes all feedback from Market Parties during this Public Consultation. It is reminded that the Public Consultation lasts one month exactly. As it has started on 22/09/2023, comments may be sent until 23/10/2023. Based on the feedback of the market parties, Elia will finalize the study and will propose an implementation plan.